



2600T Series Pressure Transmitters

Model 264HS Gauge

Model 264NS Absolute

high overload
overpressure up to 90MPa, 13050psi

■ **Base accuracy : $\pm 0.075\%$**

■ **Span limits**

- 0.65 to 60000kPa; 2.6inH₂O to 8700psi
- 1.1 to 16000kPa abs; 8mmHg to 2320psia



■ **Reliable sensing system coupled with very latest digital technologies**

- provides large turn down ratio up to 100:1

■ **Comprehensive sensor choice**

- optimize in-use total performance and stability

■ **5-year stability**

■ **Flexible configuration facilities**

- provided locally via local keys combined with LCD indicator or via hand held terminal or PC configuration platform



■ **Multiple protocol availability**

- provides integration with HART®, PROFIBUS PA and FOUNDATION Fieldbus platforms offering interchangeability and transmitter upgrade capabilities

■ **Full compliance with PED Category IV**

- suitable for safety accessory application

ABB 2600T Series
Engineered solutions
for all applications



Functional Specifications

Range and span limits

Sensor Code	Upper Range Limit (URL)	Lower Range Limit (LRL)	Minimum span	
			264HS gauge	264NS absolute
G	65kPa 650mbar 260inH ₂ O	0.07kPa abs 0.7mbar abs 0.5mmHg	0.65kPa 6.5mbar 2.6inH ₂ O	1.1kPa 11mbar 8mmHg
H	160kPa 1600mbar 642inH ₂ O	0.07kPa abs 0.7mbar abs 0.5mmHg	1.6kPa 16mbar 6.4inH ₂ O	2.67kPa 26.7mbar 20mmHg
M	600kPa 6bar 87psi	0.07kPa abs 0.7mbar abs 0.5mmHg	6kPa 0.06bar 0.87psi	10kPa 0.1bar 1.45psi
P	2400kPa 24bar 348psi	0.07kPa abs 0.7mbar abs 0.5mmHg	24kPa 0.24bar 3.5psi	40kPa 0.4bar 5.8psi
Q	8000kPa 80bar 1160psi	0.07kPa abs 0.7mbar abs 0.5mmHg	80kPa 0.8bar 11.6psi	134kPa 1.34bar 19.4psi
S	16000kPa 160bar 2320psi	0.07kPa abs 0.7mbar abs 0.5mmHg	160kPa 1.6bar 23.2psi	267kPa 2.67bar 38.7psi
V	60000kPa 600bar 8700psi	0.07kPa abs 0.7mbar abs 0.5mmHg	600kPa 6bar 87psi	

Span limits

Maximum span = URL

IT IS RECOMMENDED TO SELECT THE TRANSMITTER SENSOR CODE PROVIDING THE TURNDOWN VALUE AS LOWEST AS POSSIBLE TO OPTIMIZE PERFORMANCE CHARACTERISTICS.

Zero suppression and elevation

Zero and span can be adjusted to any value within the range limits detailed in the table as long as:

– calibrated span ≥ minimum span

Damping

Selectable time constant : 0, 0.25, 0.5, 1, 2, 4, 8 or 16s.

This is in addition to sensor response time

Turn on time

Operation within specification in less than 1s with minimum damping.

Insulation resistance

> 100MΩ at 1000VDC (terminals to earth)

Operative limits

Temperature limits °C (°F) :

Ambient (is the operating temperature)

Filling	Model 264HS		Model 264NS
	Sensors G to S	Sensor V	Sensors G to S
Silicone oil	–40 and +85 (-40 and +185)	–40 and +85 (-40 and +185)	–40 and +85 (-40 and +185)
Inert	–20 and +85 (-4 and +185)		–10 and +65 (+14 and +150)
Galde			
Inert Halocarbon	–20 and +85 (-4 and +185)		–10 and +65 (+14 and +150)
Inert		–20 and +85 (-4 and +185)	
Carbon Fluoride			

Lower ambient limit for LCD indicators: –20°C (–4°F)

Upper ambient limit for LCD indicators: +70°C (+158°F)

Note : For Hazardous Atmosphere applications see the temperature range specified on the certificate/approval relevant to the aimed type of protection

Process

Lower limit

– refer to lower ambient limits

Upper limit

– Silicone oil: 121°C (250°F) (1)

– Inert fluid (Galde or Halocarbon): 100°C (212°F) (2)

– Inert fluid (Carbon fluoride): 121°C (250°F)

(1) 100°C (212°F) for application below atmospheric pressure

(2) 65°C (150°F) for application below atmospheric pressure

Storage

Lower limit: –50°C (–58°F); –40°C (–40°F) for LCD indicators

Upper limit: +85°C (+185°F)

Pressure limits

Overpressure limits (without damage to the transmitter)

- 0.067kPa abs, 0.67mbar abs, 0.01psia (double with inert filling) to
- 21MPa, 210bar, 3045psi for sensor codes G to S
- 90MPa, 900bar, 13050psi for sensor code V

Proof pressure

- The transmitter can be exposed without leaking to line pressure of up to
- 40MPa, 400bar, 5800psi for sensor codes G to S
- 90MPa, 900bar, 13050psi for sensor code V

Meet ANSI/ISA-S 82.03 hydrostatic test requirements and SAMA PMC 27.1.

Environmental limits

Electromagnetic compatibility (EMC)

Comply with EN 61000-6-3 for emission and EN 61000-6-2 for immunity requirements and test;

Radiated electromagnetic immunity level: (according to IEC 1000-4-3, EN61000-4-3)	30V/m
Conducted electromagnetic immunity level : (according to IEC 1000-4-6, EN 61000-4-6)	30V
Surge immunity level (with surge protector): (according to IEC 1000-4-5 EN 61000-4-5)	4kV
Fast transient (Burst) immunity level: (according to IEC 1000-4-4 EN 61000-4-4)	4kV

Pressure equipment directive (PED)

Comply with 97/23/EEC Category IV Modules D and B.

(Category III Module H for sensor code V).

Humidity

Relative humidity:	up to 100% annual average
Condensing, icing:	admissible

Vibration resistance

Accelerations up to 2g at frequency up to 1000Hz
(according to IEC 60068-2-26)

Shock resistance

Acceleration:	50g
Duration:	11ms

(according to IEC 60068-2-27)

Wet and dust-laden atmospheres

The transmitter is dust and sand tight and protected against immersion effects as defined by EN 60529 (1989) to IP 67 (IP 68 on request) or by NEMA to 4X or by JIS to C0920.

Hazardous atmospheres

With or without output meter/integral display

- INTRINSIC SAFETY/EUROPE:
 - ATEX/ZELM approval
 - II 1 GD T50°C, EEx ia IIC T6 (-40°C ≤ Ta ≤ +40°C)
 - T95°C, EEx ia IIC T4 (-40°C ≤ Ta ≤ +85°C)
- TYPE "N"/EUROPE:
 - ATEX/ZELM type examination (for HART)
 - II 3 GD T50°C, EEx nL IIC T6 (-40°C ≤ Ta ≤ +40°C)
 - T95°C, EEx nL IIC T4 (-40°C ≤ Ta ≤ +85°C)
- (FOUNDATION Fieldbus/PROFIBUS PA): pending
- FLAMEPROOF/EUROPE:
 - ATEX/CESI approval
 - II 1/2 GD T85°C, EEx d IIC T6 (-40°C ≤ Ta ≤ +75°C)
- CANADIAN STANDARDS ASSOCIATION and FACTORY MUTUAL:
 - Explosionproof: Class I, Div. 1, Groups A, B, C, D
 - Dust ignitionproof : Class II, Div. 1, Groups E, F, G
 - Suitable for : Class II, Div. 2, Groups F, G; Class III, Div. 1, 2
 - Nonincendive: Class I, Div. 2, Groups A, B, C, D
 - Intrinsically safe: Class I, II, III, Div. 1, Groups A, B, C, D, E, F, G
 - AEx ia IIC T6/T4, Zone 0 (FM)
- STANDARDS AUSTRALIA (SAA): pending
- TS/WCA Approval
- Ex d IIC T5 (Tamb +85°C)/T6 (Tamb +70°C) Class 1 Zone 1;
- Ex ia IIC T4 (Tamb +85°C) /T5 (Tamb +55°C) T6 Class 1 Zone 0

Electrical Characteristics and Options

HART digital communication and 4 to 20mA output

Power Supply


The transmitter operates from 10.5 to 42VDC with no load and is protected against reverse polarity connection (additional load allows operations over 42VDC).

For EEx ia and other intrinsically safe approval power supply must not exceed 30VDC.

Ripple

20mV max on a 250Ω load as per HART specifications

MINIMUM OPERATING VOLTAGES

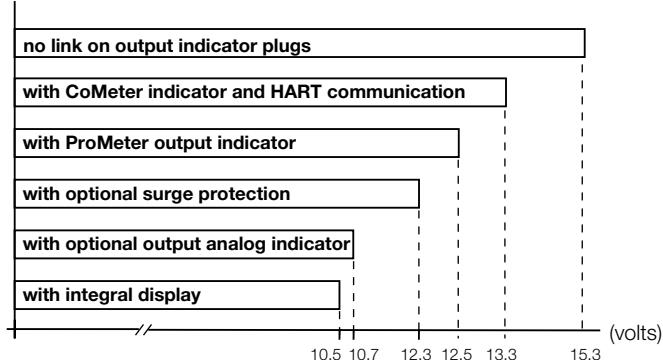

Load limitations

4 to 20mA and HART total loop resistance :

$$R(k\Omega) = \frac{\text{Supply voltage} - \text{min. operating voltage (VDC)}}{22.5}$$

A minimum of 250Ω is required for HART communication.

Optional indicators

Output meter

CoMeter and Prometer LCD :

5-digit (± 99999 counts) programmable with 7.6mm. high (3in), 7-segment numeric characters plus sign and digital point for digital indication of output value in percentage, current or engineer unit;

10-segment bargraph display (10% per segment) for analog indication of output in percentage;

7-digit with 6mm. high (2.3in), 14-segment alphanumeric characters, for engineer units and configuration display

Analog : 36mm (1.4in) scale on 90°.

Integral display

LCD, 15 lines x 56 column dot matrix providing 2 lines indication as

- top: 5-digit (numeric) plus sign or 7-digit alphanumeric
- bottom: 7-digit alphanumeric

and additional 50-segment bargraph for indication of analog output in percentage.

User-definable matrix display mode with HART communication:

- process variable in pressure unit or
- output signal as percentage, current or engineering units

Display also indicates in/out transfer function, static pressure, sensor temperature and diagnostic messages and provides configuration facilities.

Optional surge protection

Up to 4kV

- voltage 1.2μs rise time / 50μs delay time to half value
- current 8μs rise time / 20μs delay time to half value

Output signal

Two-wire 4 to 20mA, user-selectable for linear or 5th order or two 2nd order switching point selectable programmable polynomial output.

HART® communication provides digital process variable (% , mA or engineering units) superimposed on 4 to 20mA signal, with protocol based on Bell 202 FSK standard.

Output current limits (to NAMUR standard)

Overload condition

- Lower limit: 3.8mA
- Upper limit: 20.5mA

Transmitter failure mode (to NAMUR standard)

The output signal can be user-selected to a value of 3.7 or 22mA on gross transmitter failure condition, detected by self-diagnostics.

In case of CPU failure the output is driven <3.7mA or >22mA.

PROFIBUS PA output

Device type

Pressure transmitter compliant to Profiles 3.0 Class A & B; ident. number 052B HEX.

Power supply

The transmitter operates from 10.5 to 32VDC, polarity independent.

For EEx ia approval power supply must not exceed 17.5VDC. Intrinsic safety installation according to FISCO model.

Current consumption

operating (quiescent): 10.5mA

fault current limiting: 20mA max.

Output signal

Physical layer in compliance to IEC 1158-2/EN 61158-2 with transmission to Manchester II modulation, at 31.25kbit/sec.

Output interface

PROFIBUS PA communication according to Profibus DP50170 Part 2/ DIN 19245 part 1-3.

Output update time

25ms

Function blocks

2 analog input, 1 transducer, 1 physical

Integral display

LCD, 15 lines x 56 column dot matrix providing 2 lines indication as
– top: 5-digit (numeric) plus sign or 7-digit alphanumeric
– bottom: 7-digit alphanumeric

and additional 50-segment bargraph for indication of output in percentage of the analog input function block assigned to the primary variable.

User-definable matrix display mode:

- process variable in pressure units or
- primary variable in engineering units (output of transducer block) or
- output as percentage or engineering units of analog input function blocks

Display also indicates diagnostic messages and provides configuration facilities.

Secondary variable, static pressure and sensor temperature can be read.

Transmitter failure mode

On gross transmitter failure condition, detected by self-diagnostics, the output signal can be driven to defined conditions, selectable by the user as safe, last valid or calculated value. If electronic failure or short circuit occur the transmitter consumption is electronically limited at a defined value (20mA approx), for safety of the network.

FOUNDATION Fieldbus output

Device type

LINK MASTER DEVICE

Link Active Scheduler (LAS) capability implemented.

Power supply

The transmitter operates from 9 to 32VDC, polarity independent.

For EEx ia approval power supply must not exceed 24VDC (entity certification) or 17.5VDC (FISCO certification), according to FF-816.

Current consumption

operating (quiescent): 10.5mA

fault current limiting: 20mA max.

Output signal

Physical layer in compliance to IEC 1158-2/EN 61158-2 with transmission to Manchester II modulation, at 31.25kbit/sec.

Function blocks/execution period

2 standard Analog Input blocks/25ms max (each)

1 standard PID block/70ms max.

Additional blocks

1 standard Resource block,

1 custom Pressure with calibration transducer block.

Number of link objects

25

Number of VCRs

24

Output interface

FOUNDATION fieldbus digital communication protocol to standard H1, compliant to specification V. 1.5; FF registration number IT019000.

Integral display

LCD, 15 lines x 56 column dot matrix providing 2 lines indication as

- top: 5-digit (numeric) plus sign or 7-digit alphanumeric
- bottom: 7-digit alphanumeric

and additional 50-segment bargraph for indication of output in percentage of the analog input function block assigned to the primary variable.

User-definable matrix display mode:

- process variable in pressure units or
- primary variable in engineering units (output of transducer block) or
- output as percentage or engineering units of analog input function blocks

Display also indicates diagnostic messages and provides configuration facilities.

Secondary variable, static pressure and sensor temperature can be read.

Transmitter failure mode

The output signal is "frozen" to the last valid value on gross transmitter failure condition, detected by self-diagnostics which also indicate a BAD conditions. If electronic failure or short circuit occur the transmitter consumption is electronically limited at a defined value (20mA approx), for safety of the network.

Performance specifications

Stated at reference condition to IEC 60770 ambient temperature of 20°C (68°F), relative humidity of 65%, atmospheric pressure of 1013hPa (1013mbar), zero based range for transmitter with isolating diaphragms in AISI 316 L ss or Hastelloy and silicone oil fill and HART digital trim values equal to 4–20mA span end points, in linear mode.

Unless otherwise specified, errors are quoted as % of span.

Some performance data are affected by the actual turndown (TD) as ratio between Upper Range Limit (URL) and calibrated span.

IT IS RECOMMENDED TO SELECT THE TRANSMITTER SENSOR CODE PROVIDING THE TURNDOWN VALUE AS LOWEST AS POSSIBLE TO OPTIMIZE PERFORMANCE CHARACTERISTICS.

Dynamic performance (according to IEC 61298-1 definition)

Dead time: 40ms

Time constant (63.2% of total step change):

– sensor V: 150ms

– sensors M to S: $\leq 70\text{ms}$

– sensor H: 100ms

– sensor G: 130ms

Response time (total) = dead time + time constant

Accuracy rating

% of calibrated span, including combined effects of terminal based linearity, hysteresis and repeatability.

For fieldbus versions SPAN refer to analog input function block outscale range

Model 264HS

– $\pm 0.075\%$ for TD from 1:1 to 15:1

– $\pm 0.005\% \times \frac{\text{URL}}{\text{Span}}$ for TD from 15:1 to 60:1

Model 264NS

– $\pm 0.075\%$ for TD from 1:1 to 10:1

– $\pm 0.0075\% \times \frac{\text{URL}}{\text{Span}}$ for TD from 10:1 to 20:1

Operating influences

Ambient temperature

per 20K (36°F) change between the limits of -20°C to $+65^\circ\text{C}$ (-4 to $+150^\circ\text{F}$) :

Model	Sensor Code	for TD up to	
264HS	G to V	15:1	$\pm (0.04\% \text{ URL} + 0.065\% \text{ span})$
264NS	G to S	10:1	$\pm (0.04\% \text{ URL} + 0.065\% \text{ span})$

Optional CoMeter and ProMeter ambient temperature

Total reading error per 20K (36°F) change between the ambient limits of -20 and $+70^\circ\text{C}$ (-4 and $+158^\circ\text{F}$) :

$\pm 0.15\%$ of max span (16mA).

Supply voltage

Within voltage/load specified limits the total effect is less than 0.005% of URL per volt.

Load

Within load/voltage specified limits the total effect is negligible.

Radio frequency interference

Total effect : less than 0.10% of span from 20 to 1000MHz and for field strengths up to 30V/m when tested with shielded conduit and grounding, with or without meter.

Common mode interference

No effect from 100Vrms @ 50Hz, or 50VDC

Mounting position

No effect

Stability

$\pm 0.10\%$ of URL over a thirty-six-month period

Vibration effect

$\pm 0.10\%$ of URL (according to IEC 61298-3)

Physical Specification

(Refer to ordering information sheets for variant availability related to specific model or versions code)

Materials

Process isolating diaphragms (*)

AISI 316 L ss; Hastelloy C276™; Monel 400™; Tantalum;
Hastelloy C276™ on AISI 316 L ss gasket seat.

Process connection (*)

AISI 316 L ss; Hastelloy C276™; Monel 400™.

Sensor fill fluid

Silicone oil (DC200);
inert fill (Halocarbon 4.2™ or Galden™; carbon fluoride for sensor V)

Mounting bracket (**)

Zinc plated carbon steel with chrome passivation;
AISI 316 L ss.

Sensor housing

AISI 316 L ss.

Electronic housing and covers

Barrel version

- Copper-free content aluminium alloy with baked epoxy finish;
- Low-copper content aluminium alloy with baked epoxy finish;
- AISI 316 L ss.

Covers O-ring

Buna N.

Local zero and span adjustments:

Glass filled polycarbonate plastic (removable).

Tagging

AISI 316ss data plate attached to the electronics housing.

Calibration

Standard: at maximum span, zero based range, ambient temperature and pressure;

Optional: at specified range and ambient conditions.

Optional extras

Mounting brackets

For 60mm. (2in) pipes or wall mounting.

Output indicator

plug-in rotatable type, LCD or analog.

Supplemental customer tag

AISI 316 ss tag screwed/fastened to the transmitter for customer's tag data up to a maximum of 20 characters and spaces on one line for tag number and tag name, and up to a maximum of 3 spaced strings of 10 characters each for calibration details (lower and upper values plus unit). Special typing evaluated on request for charges.

Surge protection (only as external unit for PROFIBUS PA and FF)

Cleaning procedure for oxygen service

Test Certificates (test, design, calibration, material traceability)

Tag and manual language

Communication connectors

Process connections

1/2in NPT female or male; DIN EN837-1 G 1/2in B; adapter straight (180°) entry; adapter angle (90°) entry.

fixing threads on adapter entries: 7/16in-20 UNF at 41.3mm centre distance.

Electrical connections

Two 1/2 NPT or M20x1.5 or PG 13.5 or 1/2 GK threaded conduit entries, direct on housing.

Special communication connector (on request)

- HART : straight or angle Harting Han connector and one plug.
- FOUNDATION Fieldbus, PROFIBUS PA: M12x1 or 7/8.

Terminal block

HART version: three terminals for signal/external meter wiring up to 2.5mm² (14AWG) and three connection points for test and communication purposes.

Fieldbus versions: two terminals for signal wiring (bus connection) up to 2.5mm² (14AWG)

Grounding

Internal and external 6mm² (10AWG) ground termination points are provided.

Mounting position

Transmitter can be mounted in any position.

Electronics housing may be rotated to any position. A positive stop prevents over travel.

Mass (without options)

1.7kg approx (4lb); add 1.5kg (3.4lb) for AISI housing.
Add 650g (1.5lb) for packing.

Packing

Carton 26 x 26 x 18cm approx (10 x 10 x 7in).

Configuration

Transmitter with HART communication and 4 to 20 mA

Standard configuration

Transmitters are factory calibrated to customer's specified range. Calibrated range and tag number are stamped on the tag plate. If a calibration range and tag data are not specified, the transmitter will be supplied with the plate left blank and configured as follows:

Engineering Unit	Specify from table
4 mA	Zero
20 mA	Upper Range Limit (URL)
Output	Linear
Damping	1 sec.
Transmitter failure mode	Upscale
Software tag characters	Blank
Optional LCD indicator/display	0 to 100.0% linear

Any or all the above configurable parameters, including Lower range-value and Upper range-value which must be the same unit of measure, can be easily changed using the HART hand-held communicator or by a PC running the configuration software SMART VISION with DTM for 2600T. The transmitter database is customized with specified flange type and material, O-ring and drain/vent materials and meter code option.

Custom configuration (option)

The following data may be specified in addition to the standard configuration parameters:

Descriptor	16 alphanumeric characters
Message	32 alphanumeric characters
Date	Day, month, year

Transmitter with PROFIBUS PA communication

Transmitters are factory calibrated to customer's specified range. Calibrated range and tag number are stamped on the tag plate. If a calibration range and tag data are not specified, the transmitter will be supplied with the plate left blank and configured as follows:

Measure Profile	Pressure
Engineering Unit	kPa
Output scale 0%	Lower Range Limit (LRL)
Output scale 100%	Upper Range Limit (URL)
Output	Linear
Hi-Hi Limit	Upper Range Limit (URL)
Hi Limit	Upper Range Limit (URL)
Low Limit	Lower Range Limit (LRL)
Low-Low Limit	Lower Range Limit (LRL)
Limits hysteresis	0.5% of output scale
PV filter	0 sec.
Address (settable by local key)	126
Tag	32 alphanumeric characters

Any or all the above configurable parameters, including Lower range-value and Upper range-value which must be the same unit of measure, can be easily changed by a PC running the configuration software SMART VISION with DTM for 2600T.

The transmitter database is customized with specified flange type and material, O-ring and drain/vent materials and meter code option.

Custom configuration (option)

The following data may be specified in addition to the standard configuration parameters:

Descriptor	32 alphanumeric characters
Message	32 alphanumeric characters
Date	Day, month, year

Transmitter with FOUNDATION Fieldbus communication

Transmitters are factory calibrated to customer's specified range. Calibrated range and tag number are stamped on the tag plate. If a calibration range and tag data are not specified, the transmitter will be supplied with the plate left blank and the analog input function block FB1 is configured as follows:

Measure Profile	Pressure
Engineering Unit	kPa
Output scale 0%	Lower Range Limit (LRL)
Output scale 100%	Upper Range Limit (URL)
Output	Linear
Hi-Hi Limit	Upper Range Limit (URL)
Hi Limit :	Upper Range Limit (URL)
Low Limit	Lower Range Limit (LRL)
Low-Low Limit	Lower Range Limit (LRL)
Limits hysteresis	0.5% of output scale
PV filter time	0 sec.
Tag	32 alphanumeric characters

The analog input function block FB2 is configured for the sensor temperature measured in °C. Any or all the above configurable parameters, including the range values, can be changed using any host compliant to FOUNDATION fieldbus. The transmitter database is customized with specified flange type and material, O-ring and drain/vent materials and meter code option.

For any protocol available engineering units of pressure measure are :
 Pa, kPa, MPa
 inH₂O@4°C, mmH₂O@4°C, psi
 inH₂O@20°C, ftH₂O@20°C, mmH₂O@20°C
 inHg, mmHg, Torr
 g/cm², kg/cm², atm
 mbar, bar

TM Hastelloy is a Cabot Corporation trademark

TM Monel is an International Nickel Co. trademark


TM DC 200 is a Dow Corning Corporation trademark

TM Galden is a Montefluos trademark


TM Halocarbon is a Halocarbon Products Co. trademark

(*) Wetted parts of the transmitter.

(**) U-bolt material: AISI 400 ss; screws material: high-strength alloy steel or AISI 316 ss.

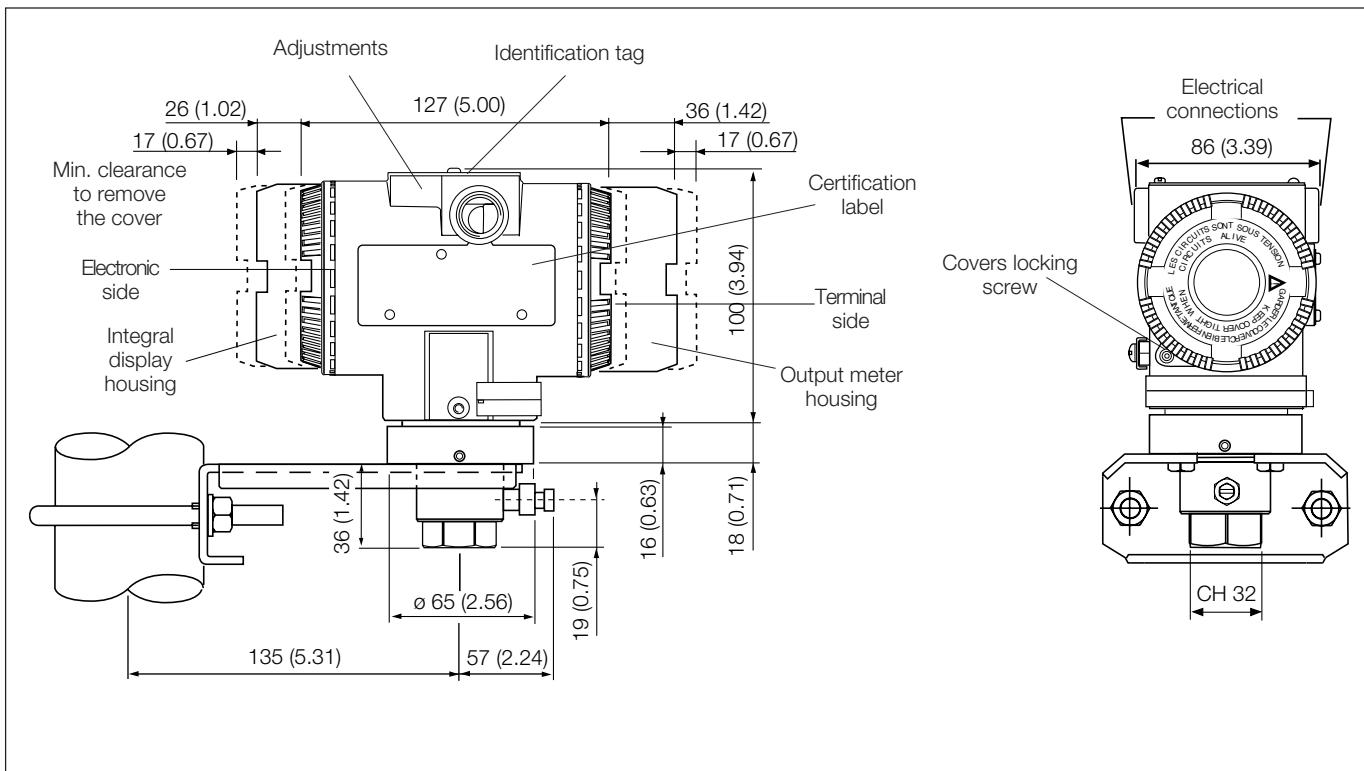MOUNTING DIMENSIONS (not for construction unless certified) – dimensions in mm (in)**Transmitter with barrel housing on bracket for 60mm (2in) pipe mounting**

1/2in – 14 NPT female connection for sensors G, H, M, P, Q, S

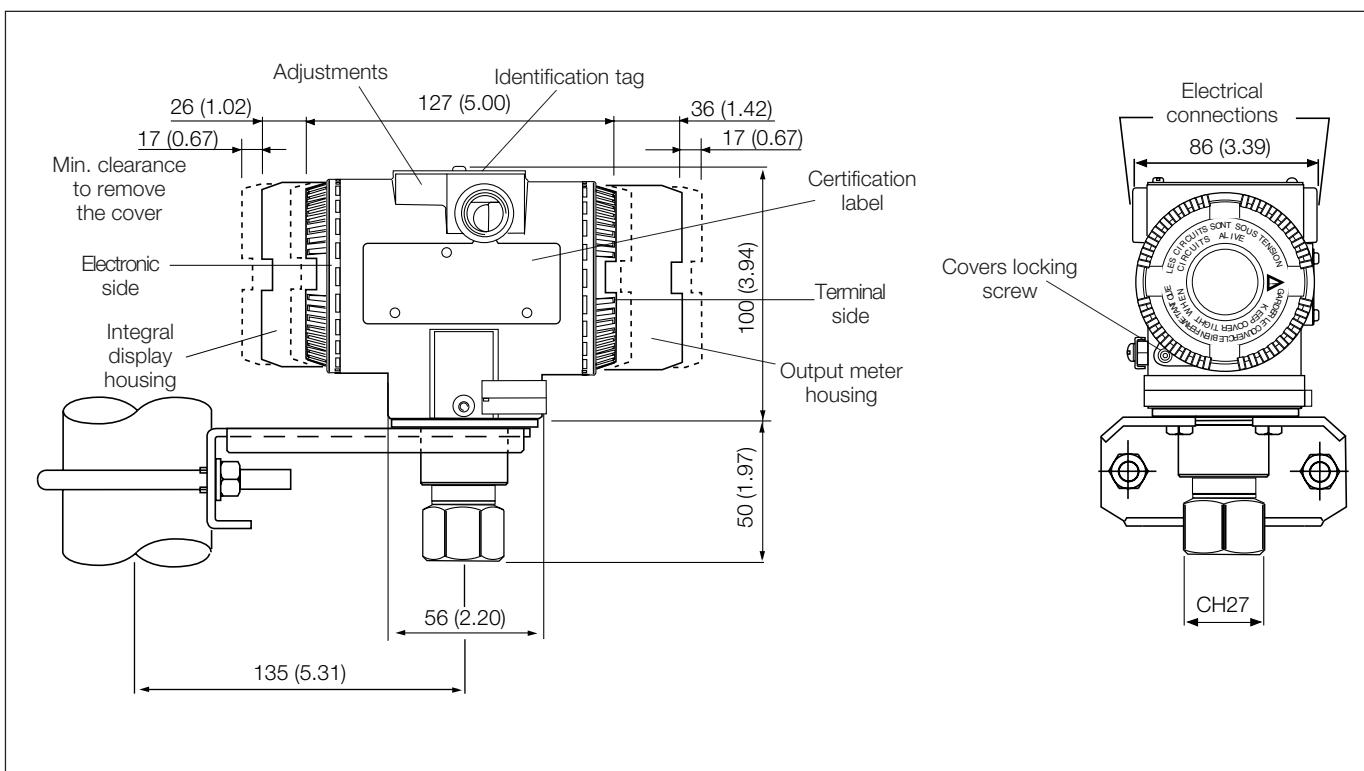


1/2in – 14 NPT female connection for sensor V (NOT FOR 264NS)


2600T Pressure Transmitters

Model 264HS, 264NS

SS/264HS/NS_3

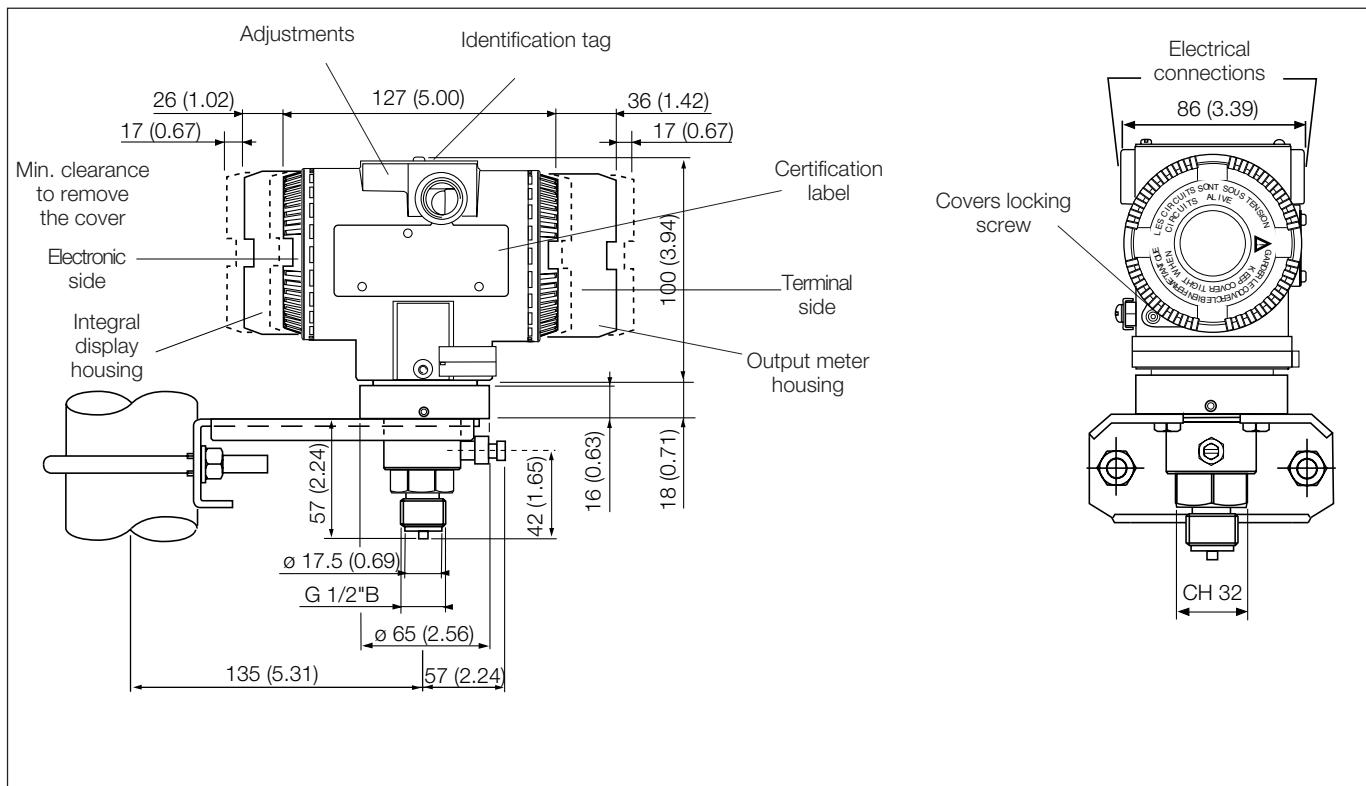

DIN-EN837-1 G 1/2in B connection for sensors G, H, M, P, Q, S

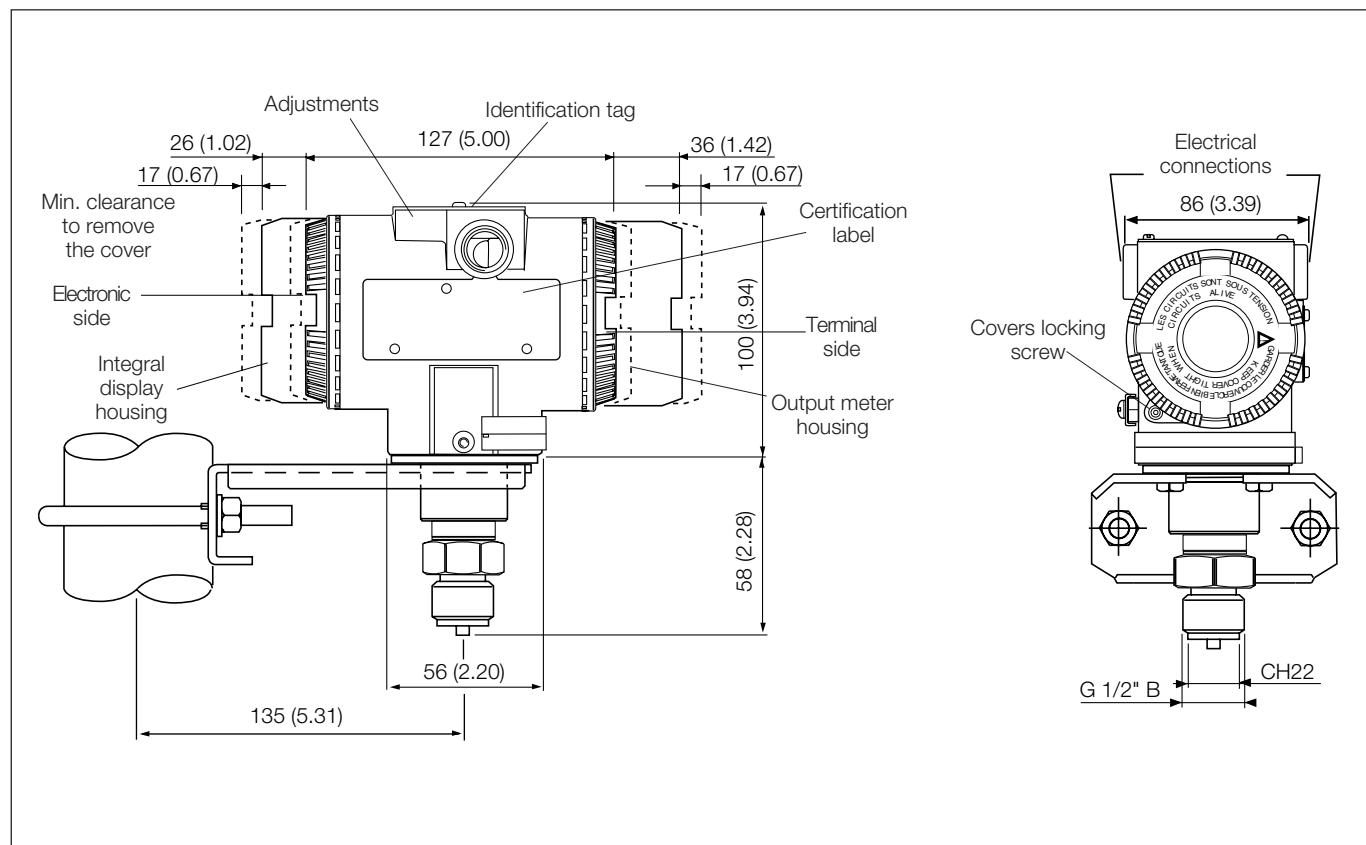


DIN-EN837-1 G 1/2in B connection for sensor V (NOT FOR 264NS)


2600T Pressure Transmitters

Model 264HS, 264NS

SS/264HS/NS_3

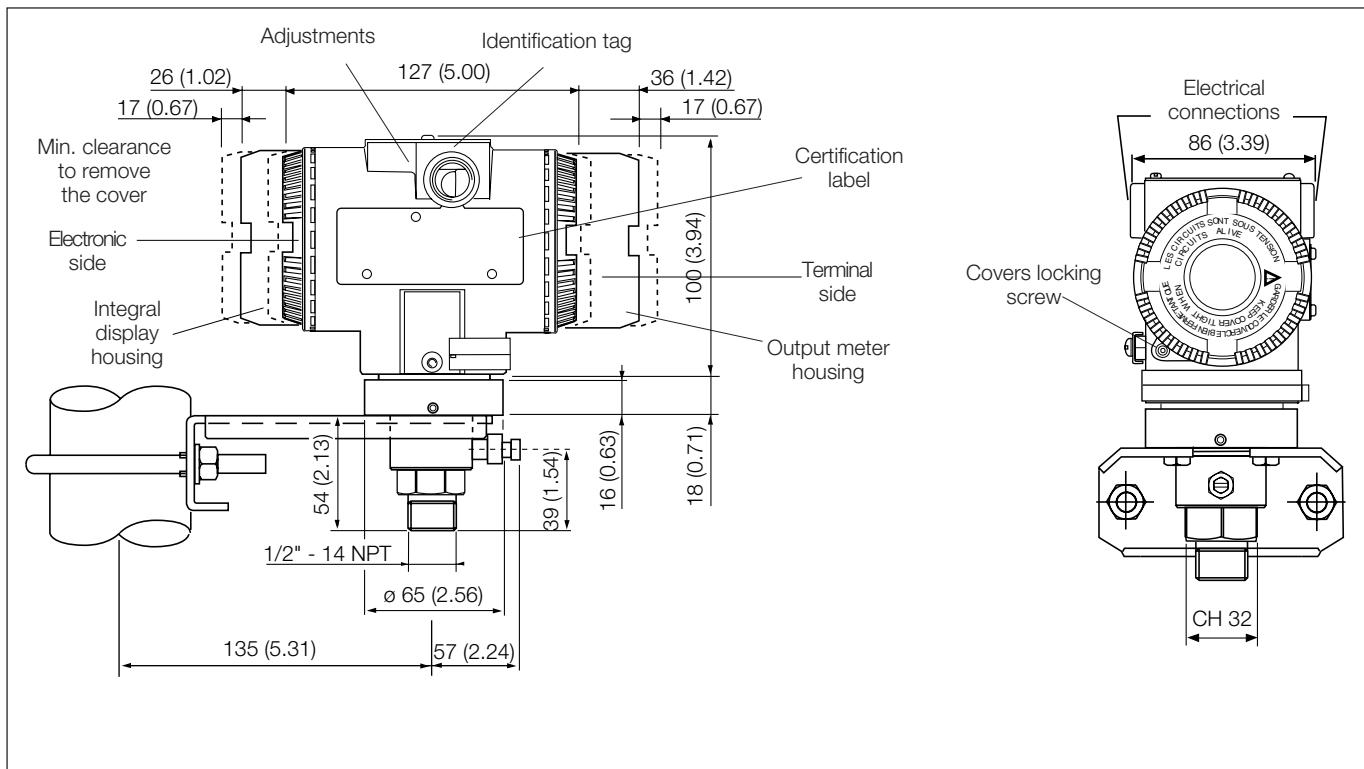

1/2 in – 14 NPT male connection for sensors G, H, M, P, Q, S

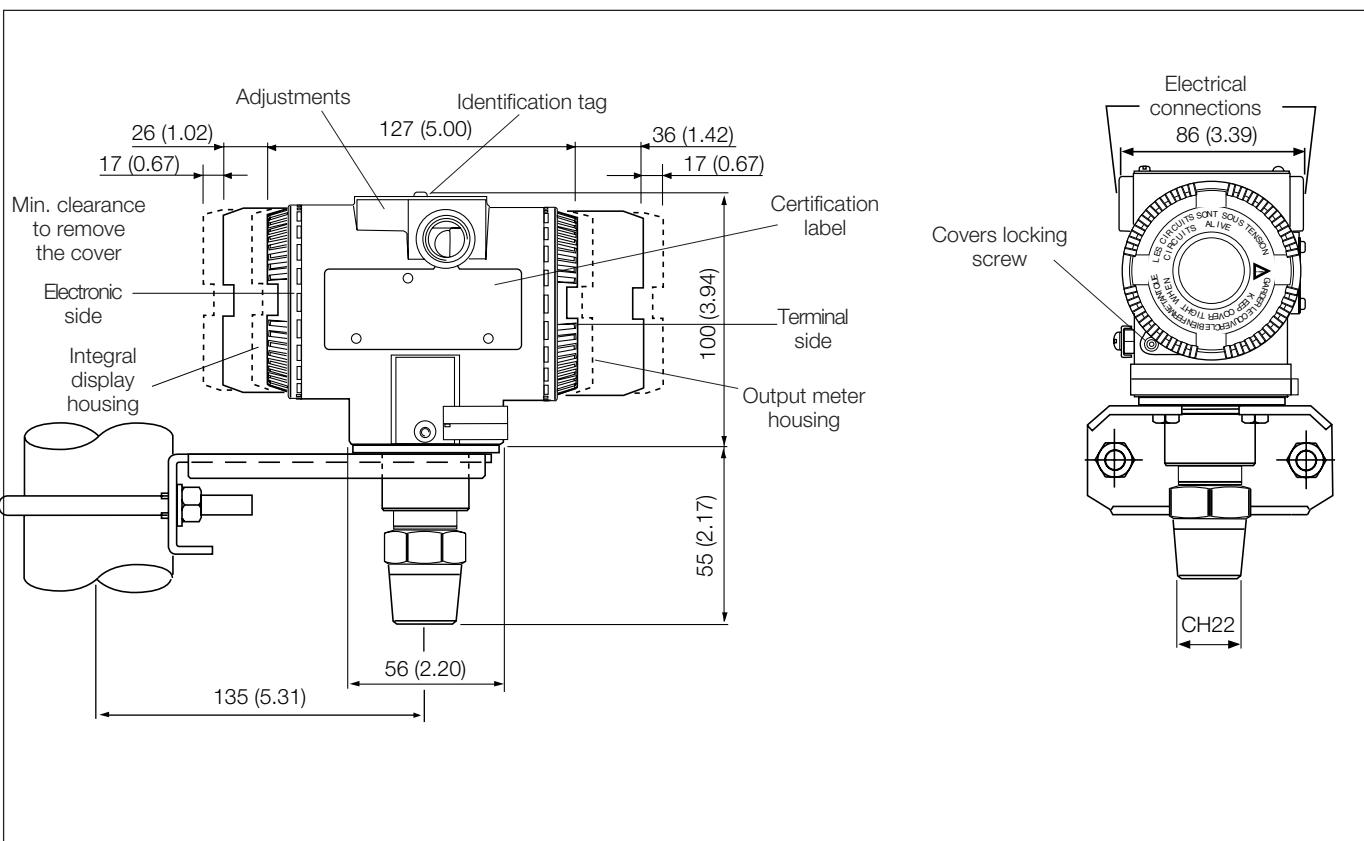


1/2 in – 14 NPT male connection for sensor V (NOT FOR 264NS)


2600T Pressure Transmitters

Model 264HS, 264NS

SS/264HS/NS_3

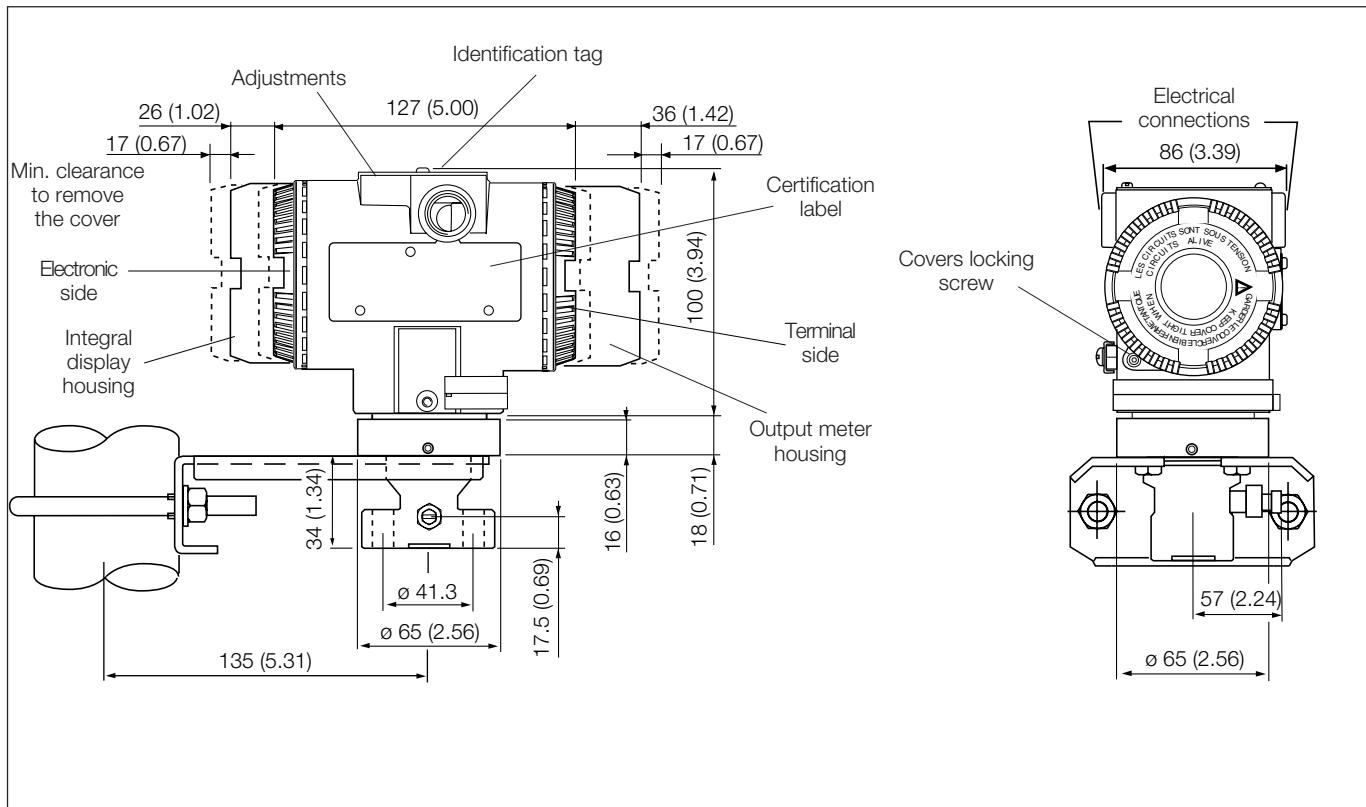


Adapter straight (180° entry connection ($7/16$ in – 20 UNF drilling) for sensors G, H, M, P, Q, S

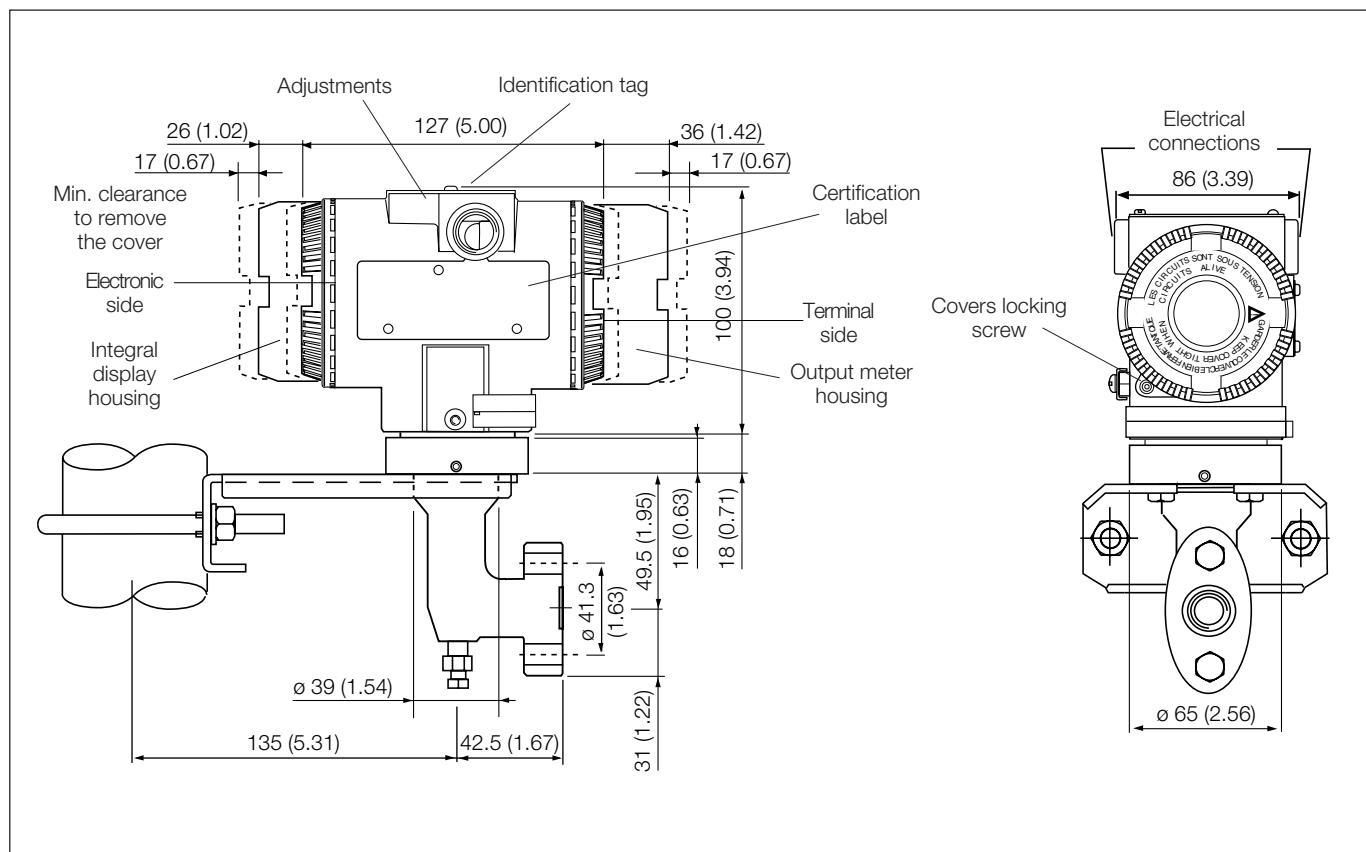


Adapter angle (90° entry connection ($7/16$ in – 20 UNF drilling) for sensors G, H, M, P, Q, S

Electrical connections

HART Version

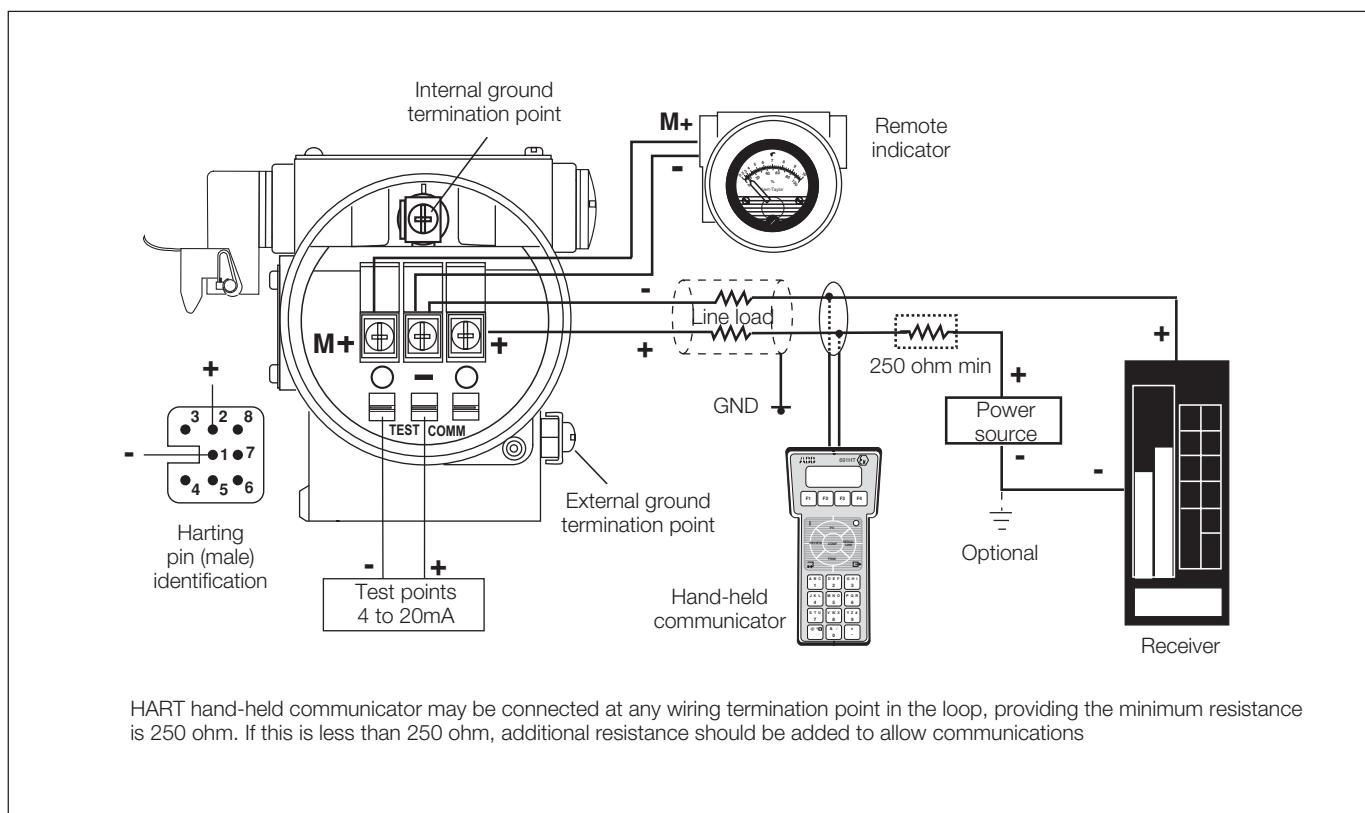

FIELDBUS Versions

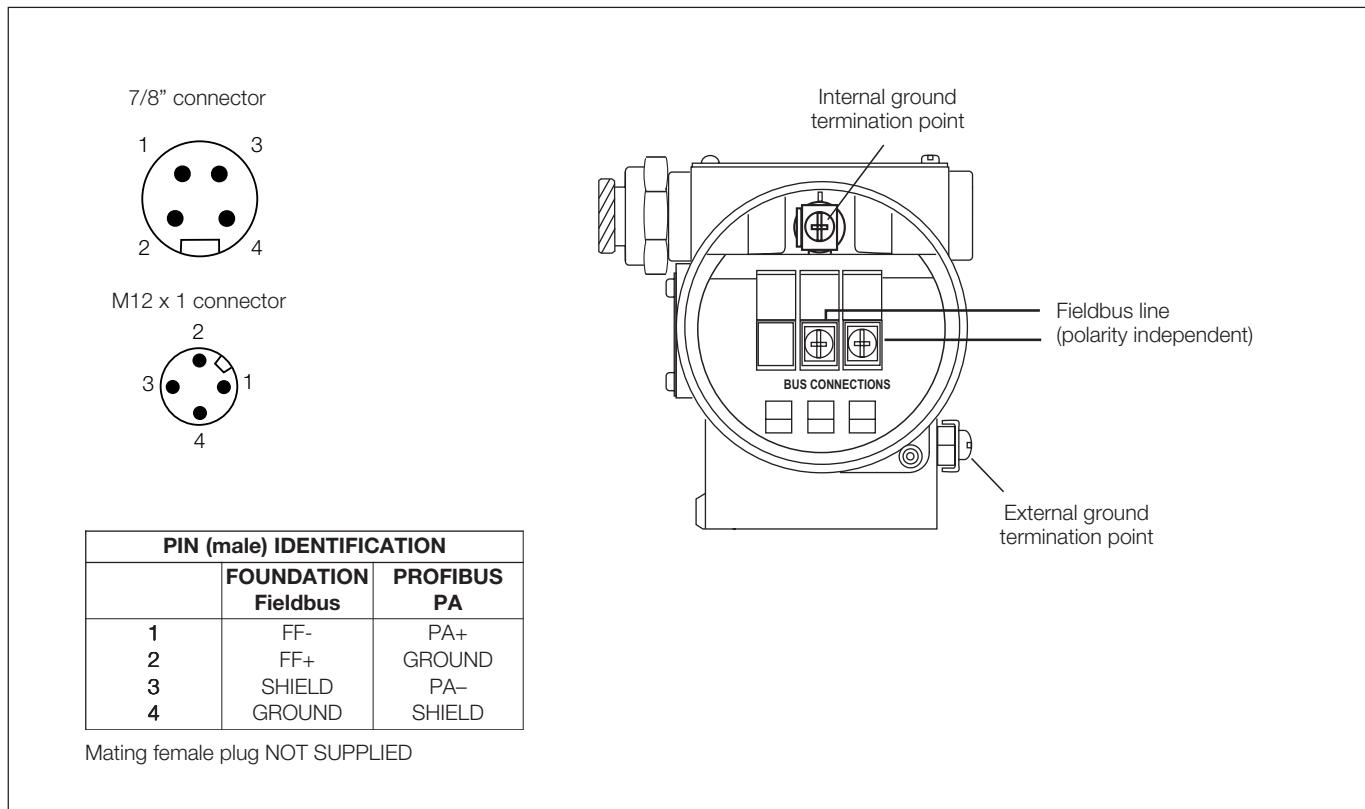

BASIC ORDERING INFORMATION model 264HS Gauge Pressure Transmitter

Select one character or set of characters from each category and specify complete catalog number.

Refer to additional ordering information code and specify one or more codes for each transmitter if additional options are required.

BASE MODEL – 1 st to 5 th characters	2	6	4	H	S	X	X	X	X	X	X
Gauge Pressure Transmitter – BASE ACCURACY 0.075%											
SENSOR - Span limits – 6th character											
0.65 and 65kPa	6.5 and 650mbar	2.6 and 260inH ₂ O				G					
1.6 and 160kPa	16 and 1600mbar	6.4 and 642inH ₂ O				H					
6 and 600kPa	0.06 and 6bar	0.87 and 87psi				M					
24 and 2400kPa	0.24 and 24bar	3.5 and 348psi				P					
80 and 8000kPa	0.8 and 80bar	11.6 and 1160psi				Q					
160 and 16000kPa	1.6 and 160bar	23.2 and 2320psi				S					
600 and 60000 kPa	6 and 600bar	87 and 8700 psi				V					
Diaphragm material / Fill fluid (wetted parts) – 7th character											
AISI 316 L ss	Silicone oil		(Note 2)			S					
Hastelloy C276™ (on AISI seat)	Silicone oil		(Note 2)		NACE	H					
Hastelloy C276™	Silicone oil				NACE	K					
Monel 400™	Silicone oil		(Note 2)		NACE	M					
Tantalum	Silicone oil		(Note 2)		NACE	T					
AISI 316 L ss	Inert fluid - Galden		(Notes 1, 2)		NACE	A					
Hastelloy C276™ (on AISI seat)	Inert fluid - Galden		(Notes 1, 2)		NACE	B					
Hastelloy C276™	Inert fluid - Galden (Carbon fluoride for sensor V)		(Note 1)		NACE	F					
Monel 400™	Inert fluid - Galden		(Notes 1, 2)		NACE	C					
Tantalum	Inert fluid - Galden		(Notes 1, 2)		NACE	D					
AISI 316 L ss	Inert fluid - Halocarbon		(Notes 1, 2)		NACE	L					
Hastelloy C276™ (on AISI seat)	Inert fluid - Halocarbon		(Notes 1, 2)		NACE	Q					
Hastelloy C276™	Inert fluid - Halocarbon		(Notes 1, 2)		NACE	P					
Monel 400™	Inert fluid - Halocarbon		(Notes 1, 2)		NACE	4					
Tantalum	Inert fluid - Halocarbon		(Notes 1, 2)		NACE	5					
Process connection material (wetted parts) – 8th character											
AISI 316 L ss	1/2in NPT female		(Note 3)		NACE	B					
AISI 316 L ss	1/2in NPT male		(Note 3)		NACE	T					
AISI 316 L ss	DIN EN837-1 G 1/2in B		(Note 3)		NACE	P					
AISI 316 L ss	Adapter straight (180°) entry (not available for bracket)		(Notes 2, 3)		NACE	A					
AISI 316 L ss	Adapter angle (90°) entry		(Notes 2, 3)		NACE	N					
Hastelloy C276™	1/2in NPT female		(Note 4)		NACE	E					
Hastelloy C276™	1/2in NPT male		(Note 4)		NACE	K					
Hastelloy C276™	DIN EN837-1 G 1/2in B		(Note 4)		NACE	D					
Hastelloy C276™	Adapter straight (180°) entry (not available for bracket)		(Notes 2, 4)		NACE	F					
Hastelloy C276™	Adapter angle (90°) entry		(Notes 2, 4)		NACE	C					
Monel 400™	1/2in NPT female		(Note 5)		NACE	1					
Monel 400™	1/2in NPT male		(Note 5)		NACE	2					
Monel 400™	DIN EN837-1 G 1/2in B		(Note 5)		NACE	3					
Housing material and electrical connection – 9th character											
Aluminium alloy (Barrel version)	1/2in NPT					A					
Aluminium alloy (Barrel version)	M20 x 1.5 (CM 20)					B					
Aluminium alloy (Barrel version)	Pg 13.5					D					
Aluminium alloy (Barrel version)	1/2in GK					C					
Aluminium alloy (Barrel version)	Harting Han connector					E					
Aluminium alloy (Barrel version)	Fieldbus connector					G					
Aluminium alloy copper-free (Barrel version)	1/2in NPT					H					
Aluminium alloy copper-free (Barrel version)	M20 x 1.5 (CM 20)					L					
Aluminium alloy copper-free (Barrel version)	Pg 13.5					N					
Aluminium alloy copper-free (Barrel version)	1/2in GK					M					
Aluminium alloy copper-free (Barrel version)	Harting Han connector					P					
Aluminium alloy copper-free (Barrel version)	Fieldbus connector					R					
AISI 316 L ss (Barrel version)	1/2in NPT					S					
AISI 316 L ss (Barrel version)	M20 x 1.5 (CM20)					T					
AISI 316 L ss (Barrel version)	Pg 13.5					V					
AISI 316 L ss (Barrel version)	1/2in GK					U					
AISI 316 L ss (Barrel version)	Fieldbus connector					Z					
Output/Additional options – 10th character											
HART digital communication and 4 to 20mA	No additional options					H					
HART digital communication and 4 to 20mA	Options requested (to be ordered by "Additional ordering code")					1					
PROFIBUS PA	No additional options					P					
PROFIBUS PA	Options requested (to be ordered by "Additional ordering code")					2					
FOUNDATION Fieldbus	No additional options					F					
FOUNDATION Fieldbus	Options requested (to be ordered by "Additional ordering code")					3					

ADDITIONAL ORDERING INFORMATION for model 264HS

Add one or more 2-digit code(s) after the basic ordering information to select all required options

		XX	XX														
Drain/vent valve (wetted parts)																	
AISI 316 L ss	(Notes 2, 9)																
Hastelloy C276™	(Notes 2, 10)																
Monel 400™	(Notes 2, 11)																
Electrical certification																	
ATEX Group II Category 1 GD – Intrinsic Safety EEx ia																	
ATEX Group II Category 1/2 GD – Flameproof EEx d																E1	
ATEX Group II Category 3 GD – Type of protection "N" EEx nL design compliance ((Note 12)																E2	
Canadian Standard Association (CSA) (only 1/2in NPT, M20 and Pg 13.5 housing)																E3	
Intrinsic Safety–Flameproof to Standards Australia SAA Ex ia IIC T6/T5/T4 + Ex d II C T6/T5 (Note 12)																E4	
Factory Mutual (FM) approval (only with 1/2in NPT, M20 and Pg 13.5 electrical connection)																E5	
																E6	
Output meter																	
ProMeter, Standard calibration	(Note 12)															D1	
ProMeter, Special calibration	(Note 12)															D2	
Analog output indicator linear 0–100% scale	(Note 12)															D3	
Analog output indicator, special graduation (to be specified for linear scale)	(Note 12)															D5	
Programmable signal meter and HART configurator (CoMeter)	(Note 12)															D7	
Programmable signal meter and HART configurator (CoMeter – customer configuration)	(Note 12)															D8	
Integral LCD																	
Digital LCD integral display															L1		
Mounting bracket (shape and material)																	
For pipe mounting (Not suitable for AISI housing)																B1	
For pipe mounting	Carbon steel AISI 316 L ss															B2	
Surge																	
Surge/Transient Protector	(Note 12)														S1		
Operating manual																	
German																M1	
Italian																M2	
French																M4	
Labels & tag language																	
German																T1	
Italian																T2	
French																T4	
Additional tag plate																I2	
Laser printing of tag on stainless steel plate																	
Configuration																	
Standard – Pressure = inH ₂ O/psi at 20° C; Temperature = deg. F																N2	
Standard – Pressure = inH ₂ O/psi at 4° C; Temperature = deg. F																N3	
Standard – Pressure = inH ₂ O/psi at 20° C; Temperature = deg.C																N4	
Standard – Pressure = inH ₂ O/psi at 4° C; Temperature = deg. C																N5	
Custom																N6	
Preparation procedure																	
Oxygen service cleaning (only available with inert fill)																P1	
P _{max} = 12MPa for Galden, 9MPa for Halocarbon or 21MPa for Carbon fluoride; T _{max} = 60° C/140° F																	
Certificates																	
Inspection certificate EN 10204-3.1.B of calibration (9-point)																C1	
Certificate of compliance with the order EN 10204-2.1 of instrument design																C6	
Material traceability																	
Certificate of compliance with the order EN 10204-2.1 of process wetted parts																H1	
Inspection certificate EN 10204-3.1.B of process wetted parts																H3	
Connector																	
Fieldbus 7/8	(RECOMMENDED for FOUNDATION Fieldbus)															(Notes 8, 13)	U1
Fieldbus M12x1	(RECOMMENDED for PROFIBUS PA)															(Notes 8, 13)	U2
Harting Han – straight entry																(Notes 7, 13)	U3
Harting Han – angle entry																(Notes 7, 13)	U4

Note 1: Suitable for oxygen service

Note 2: Not available with Sensor code V

Note 3: Not available with Hastelloy C, Monel and Tantalum diaphragm code K, T, F, D, P, M, C, 4, 5 combined with sensor codes G to S

Note 4: Not available with AISI 316 L ss, Hastelloy C on AISI seat and Monel diaphragm code S, H, A, B, L, Q, M, C, 4

Note 5: Not available with AISI 316 L ss, Hastelloy C on AISI seat, Hastelloy C and Tantalum diaphragm code S, H, K, T, A, B, F, D, L, Q, P, 5

Note 6: Select type in additional ordering code

Note 7: Not available with Electronic Housing code Z, R, G

Note 8: Not available with Electronic Housing code P, E

Note 9: Not available with Process connection code E, K, D, F, C, 1, 2, 3

Note 10: Not available with Process connection code B, T, A, P, N, 1, 2, 3

Note 11: Not available with Process connection code E, K, D, F, C, B, T, A, P, N

Note 12: Not available with PROFIBUS PA and FF output code 2 or 3

Note 13: Not available with Electronic housing code U, S, T, V, H, M, L, N, D, C, A, B

™ Hastelloy is a Cabot Corporation trademark

™ Monel is an International Nickel Co. trademark

™ Galden is a Montefluos trademark

™ Halocarbon is a Halocarbon Products Co. trademark

Standard delivery items (can be differently specified by additional ordering code)

- No drain/vent valve
- General purpose (no electrical certification)
- No meter/display, no mounting bracket, no surge protection
- English manual and labels
- Configuration with kPa and deg. C units
- No test, inspection or material traceability certificates

THE SELECTION OF SUITABLE WETTED PARTS AND FILLING FLUID FOR COMPATIBILITY WITH THE PROCESS MEDIA IS A CUSTOMER'S RESPONSIBILITY, IF NOT OTHERWISE NOTIFIED BEFORE MANUFACTURING.

BASIC ORDERING INFORMATION model 264NS Absolute Pressure Transmitter

Select one character or set of characters from each category and specify complete catalog number.

Refer to additional ordering information code and specify one or more codes for each transmitter if additional options are required.

			2	6	4	N	S	X	X	X	X	X
BASE MODEL – 1 st to 5 th characters	Absolute Pressure Transmitter – BASE ACCURACY 0.075%											
SENSOR - Span limits – 6 th character												
1.1 and 65kPa	11 and 650mbar	8 and 480mmHg						G				
2.67 and 160kPa	26.7 and 1600mbar	20 and 1200mmHg						H				
10 and 600kPa	0.1 and 6bar	1.45 and 87psi						M				
40 and 2400kPa	0.4 and 24bar	5.8 and 348psi						P				
134 and 8000kPa	1.34 and 80bar	19.4 and 1160psi						Q				
267 and 16000kPa	2.67 and 160bar	38.7 and 2320psi						S				
Diaphragm material / Fill fluid (wetted parts) – 7 th character												
AISI 316 L ss	Silicone oil							S				
Hastelloy C276™ (on AISI seat)	Silicone oil							NACE	H			
Hastelloy C276™	Silicone oil							NACE	K			
AISI 316 L ss	Inert fluid - Galden	(Note 1)						A				
Hastelloy C276™ (on AISI seat)	Inert fluid - Galden	(Note 1)						NACE	B			
Hastelloy C276™	Inert fluid - Galden	(Note 1)						NACE	F			
AISI 316 L ss	Inert fluid - Halocarbon	(Note 1)						L				
Hastelloy C276™ (on AISI seat)	Inert fluid - Halocarbon	(Note 1)						NACE	Q			
Hastelloy C276™	Inert fluid - Halocarbon	(Note 1)						NACE	P			
Process connection material (wetted parts) – 8 th character												
AISI 316 L ss	1/2in NPT female	(Note 2)						NACE	B			
AISI 316 L ss	1/2in NPT male	(Note 2)						NACE	T			
AISI 316 L ss	DIN EN837-1 G 1/2in B	(Note 2)						NACE	P			
AISI 316 L ss	Adapter straight (180°) entry (not available for bracket)	(Note 2)						NACE	A			
AISI 316 L ss	Adapter angle (90°) entry	(Note 2)						NACE	N			
Hastelloy C276™	1/2in NPT female	(Note 3)						NACE	E			
Hastelloy C276™	1/2in NPT male	(Note 3)						NACE	K			
Hastelloy C276™	DIN EN837-1 G 1/2in B	(Note 3)						NACE	D			
Hastelloy C276™	Adapter straight (180°) entry (not available for bracket)	(Note 3)						NACE	F			
Hastelloy C276™	Adapter angle (90°) entry	(Note 3)						NACE	C			
Housing material and electrical connection – 9 th character												
Aluminium alloy (Barrel version)	1/2in NPT								A			
Aluminium alloy (Barrel version)	M20 x 1.5 (CM 20)								B			
Aluminium alloy (Barrel version)	Pg 13.5								D			
Aluminium alloy (Barrel version)	1/2in GK								C			
Aluminium alloy (Barrel version)	Harting Han connector								E			
Aluminium alloy (Barrel version)	Fieldbus connector								G			
Aluminium alloy copper-free (Barrel version)	1/2in NPT								H			
Aluminium alloy copper-free (Barrel version)	M20 x 1.5 (CM 20)								L			
Aluminium alloy copper-free (Barrel version)	Pg 13.5								N			
Aluminium alloy copper-free (Barrel version)	1/2in GK								M			
Aluminium alloy copper-free (Barrel version)	Harting Han connector								P			
Aluminium alloy copper-free (Barrel version)	Fieldbus connector								R			
AISI 316 L ss (Barrel version)	1/2in NPT								S			
AISI 316 L ss (Barrel version)	M20 x 1.5 (CM20)								T			
AISI 316 L ss (Barrel version)	Pg 13.5								V			
AISI 316 L ss (Barrel version)	1/2in GK								U			
AISI 316 L ss (Barrel version)	Fieldbus connector								Z			
Output/Additional options – 10 th character												
HART digital communication and 4 to 20mA	No additional options								H			
HART digital communication and 4 to 20mA	Options requested (to be ordered by "Additional ordering code")								1			
PROFIBUS PA	No additional options								P			
PROFIBUS PA	Options requested (to be ordered by "Additional ordering code")								2			
FOUNDATION Fieldbus	No additional options								F			
FOUNDATION Fieldbus	Options requested (to be ordered by "Additional ordering code")								3			

ADDITIONAL ORDERING INFORMATION for model 264NS

Add one or more 2-digit code(s) after the basic ordering information to select all required options

		XX	XX	XX	XX	XX	XX	XX	XX	XX	XX	XX	XX	XX	XX	XX	XX	XX
Drain/vent valve (wetted parts)																		
AISI 316 L ss Hastelloy C276™	(Note 7) (Note 8)			NACE NACE	VA VB													
Electrical certification																		
ATEX Group II Category 1 GD – Intrinsic Safety EEx ia		E1																
ATEX Group II Category 1/2 GD – Flameproof EEx d		E2																
ATEX Group II Category 3 GD – Type of protection "N" EEx nL design compliance	(Note 9)	E3																
Canadian Standard Association (CSA) (only 1/2in NPT, M20 and Pg 13.5 housing)		E4																
Intrinsic Safety-Flameproof to Standards Australia SAA Ex ia IIC T6/T5/T4 + Ex d II C T6/T5 (Note 9)		E5																
Factory Mutual (FM) approval (only with 1/2in NPT, M20 and Pg 13.5 electrical connection)		E6																
Output meter																		
ProMeter, Standard calibration	(Note 9)	D1																
ProMeter, Special calibration	(Note 9)	D2																
Analog output indicator linear 0–100% scale	(Note 9)	D3																
Analog output indicator, special graduation (to be specified for linear scale)	(Note 9)	D5																
Programmable signal meter and HART configurator (CoMeter)	(Note 9)	D7																
Programmable signal meter and HART configurator (CoMeter – customer configuration)	(Note 9)	D8																
Integral LCD															L1			
Digital LCD integral display																		
Mounting bracket (shape and material)																		
For pipe mounting (Not suitable for AISI housing)	Carbon steel	B1																
For pipe mounting	AISI 316 L ss	B2																
Surge															S1			
Surge/Transient Protector	(Note 9)																	
Operating manual																		
German		M1																
Italian		M2																
French		M4																
Labels & tag language																		
German		T1																
Italian		T2																
French		T4																
Additional tag plate															I2			
Laser printing of tag on stainless steel plate																		
Configuration																		
Standard – Pressure = inH ₂ O/psi at 20° C; Temperature = deg. F		N2																
Standard – Pressure = inH ₂ O/psi at 4° C; Temperature = deg. F		N3																
Standard – Pressure = inH ₂ O/psi at 20° C; Temperature = deg.C		N4																
Standard – Pressure = inH ₂ O/psi at 4° C; Temperature = deg. C		N5																
Custom		N6																
Preparation procedure																		
Oxygen service cleaning (only available with inert fill) – P _{max} = 12MPa for Galden or 9MPa for Halocarbon; T _{max} = 60° C/140° F		P1																
Certificates																		
Inspection certificate EN 10204-3.1.B of calibration (9-point)		C1																
Certificate of compliance with the order EN 10204-2.1 of instrument design		C6																
Material traceability																		
Certificate of compliance with the order EN 10204-2.1 of process wetted parts		H1																
Inspection certificate EN 10204-3.1.B of process wetted parts		H3																
Connector																		
Fieldbus 7/8	(RECOMMENDED for FOUNDATION Fieldbus)	(Notes 6, 10)																U1
Fieldbus M12x1	(RECOMMENDED for PROFIBUS PA)	(Notes 6, 10)																U2
Harting Han – straight entry		(Notes 5, 10)																U3
Harting Han – angle entry		(Notes 5, 10)																U4

Note 1: Suitable for oxygen service

Note 2: Not available with Hastelloy C diaphragm code K, F, P

Note 3: Not available with AISI 316 L ss and Hastelloy C on AISI seat diaphragm code S, H, A, B, L, Q

Note 4: Select type in additional ordering code

Note 5: Not available with Electronic Housing code Z, R, G

Note 6: Not available with Electronic Housing code P, E

Note 7: Not available with Process connection code E, K, D, F, C

Note 8: Not available with Process connection code B, T, A, P, N

Note 9: Not available with PROFIBUS PA and FF output code 2 or 3

Note 10: Not available with Electronic housing code U, S, T, V, H, M, L, N, D, C, A, B

TM Hastelloy is a Cabot Corporation trademark

TM Galden is a Montefluos trademark

TM Halocarbon is a Halocarbon Products Co. trademark

Standard delivery items (can be differently specified by additional ordering code)

- No drain/vent valve
- General purpose (no electrical certification)
- No meter/display, no mounting bracket, no surge protection
- English manual and labels
- Configuration with kPa and deg. C units
- No test, inspection or material traceability certificates

THE SELECTION OF SUITABLE WETTED PARTS AND FILLING FLUID FOR COMPATIBILITY WITH THE PROCESS MEDIA IS A CUSTOMER'S RESPONSIBILITY, IF NOT OTHERWISE NOTIFIED BEFORE MANUFACTURING.

ABB has Sales & Customer Support
expertise in over 100 countries worldwide

www.abb.com/instrumentation

The Company's policy is one of continuous product
improvement and the right is reserved to modify the
information contained herein without notice.

Printed in Italy (04.04)

© ABB 2004

**ABB Ltd**

Howard Road, St. Neots
Cambridgeshire, PE19 3EU
UK
Tel: +44(0)1480 475321
Fax: +44(0)1480 217948

ABB Inc.

125 E. County Line Road
Warminster, PA 18974
USA
Tel: +1 215 674 6000
Fax: +1 215 674 7183

ABB SACE spa

Business Unit Instrumentation
Via Statale 113
22016 Lenno (CO) Italy
Tel: +39 0344 58111
Fax: +39 0344 56278