

## Technical Information

**Liquiphant M****FTL50, FTL51, FTL50H, FTL51H**

Vibronic

Point level switch for all kinds of liquids

**Application**

- Process temperatures from  $-50^{\circ}\text{C}$  to  $150^{\circ}\text{C}$  (-58 to 302 °F)
- Pressures up to 100 bar (1450 psi)
- Viscosities up to 10,000 mm<sup>2</sup>/s (cSt)
- For liquids with densities  $\geq 0.5 \text{ g/cm}^3$  (SGU)

FTL50: Compact design

FTL51: Extension pipe up to 3 m (9.8 ft) and up to 6 m (20 ft) on request

FTL50H, FTL51H: Certified for the food and pharmaceutical industries

Ideal substitute for float switches, as reliable function not affected by flow, turbulence, bubbles, foam, vibration, solids content or buildup.

**Your benefits**

- Recommended for safety systems requiring functional safety to SIL2/SIL3 as per IEC 61508/IEC 61511-1
- Design in accordance with ASME B31.3
- Recommended for use in sterile applications in the life science industry (design in accordance with ASME BPE)
- No adjustment: quick, low-cost startup
- No mechanically moving parts: no maintenance, no wear, long operating life
- Functional safety: Monitoring of tuning fork for damage
- Compact stainless steel housing (optional): the IP69 protection rating guarantees that the unit remains impermeable, even in the event of intensive cleaning or flooding for several hours

## Table of contents


<b>Application</b> .....	<b>4</b>	Connectable load .....	<b>14</b>
Point level detection .....	4		
<b>Function and system design</b> .....	<b>4</b>	<b>Electronic insert FEL56 (NAMUR L-H edge)</b> .....	<b>15</b>
Measuring principle .....	4	Power supply .....	15
Modularity .....	4	Electrical connection .....	15
Electronic versions .....	5	Output signal .....	15
Electronics for continuous density measurement .....	5	Signal on alarm .....	15
Galvanic isolation .....	5	Connectable load .....	15
Design .....	5		
<b>Input</b> .....	<b>5</b>	<b>Electronic insert FEL58 (NAMUR H-L edge)</b> .....	<b>16</b>
Measured variable .....	5	Power supply .....	16
Measuring range (detection range) .....	5	Electrical connection .....	16
Density .....	5	Output signal .....	16
<b>Electronic insert FEL51 (AC 2-wire)</b> .....	<b>6</b>	Signal on alarm .....	16
Power supply .....	6	Connectable load .....	16
Electrical connection .....	6		
Output signal .....	6	<b>Electronics FEL58 (NAMUR H-L edge, compact</b>	
Signal on alarm .....	6	<b>housing)</b> .....	<b>17</b>
Connectable load .....	6	Power supply .....	17
<b>Electronics FEL51 (AC, in compact housing)</b> .....	<b>8</b>	Electrical connection .....	17
Power supply .....	8	Output signal .....	17
Electrical connection .....	8	Signal on alarm .....	17
Output signal .....	8	Connectable load .....	17
Signal on alarm .....	8		
Connectable load .....	9		
<b>Electronic insert FEL52 (DC PNP)</b> .....	<b>10</b>	<b>Electronic insert FEL57 (PFM)</b> .....	<b>18</b>
Power supply .....	10	Power supply .....	18
Electrical connection .....	10	Electrical connection .....	18
Output signal .....	10	Output signal .....	19
Signal on alarm .....	10	Signal on alarm .....	19
Connectable load .....	10	Connectable load .....	19
<b>Electronics FEL52 (DC PNP, in compact housing)</b> ..	<b>11</b>		
Power supply .....	11	<b>Electronic insert FEL50A (PROFIBUS PA)</b> .....	<b>20</b>
Electrical connection .....	11	Power supply .....	20
Output signal .....	11	Electrical connection .....	20
Signal on alarm .....	12	Output signal .....	21
Connectable load .....	12	Signal on alarm .....	21
<b>Electronic insert FEL54 (AC/DC with relay output)</b> ..	<b>13</b>		
Power supply .....	13	<b>Electronic insert FEL50D (density)</b> .....	<b>22</b>
Electrical connection .....	13	Power supply .....	22
Output signal .....	13	Electrical connection .....	22
Signal on alarm .....	13	Signal on alarm .....	22
Connectable load .....	13	Adjustment .....	22
<b>Electronic insert FEL55 (8/16 mA)</b> .....	<b>14</b>	Operating principle .....	23
Power supply .....	14	Light signals .....	23
Electrical connection .....	14		
Output signal .....	14		
Signal on alarm .....	14		
Connectable load .....	14		
<b>Connection and function</b> .....	<b>24</b>		
Connecting cables .....	24		
Safety mode .....	24		
Switching time .....	24		
Switch-on behavior .....	24		
<b>Performance characteristics</b> .....	<b>24</b>		
Reference operating conditions .....	24		
Maximum measured error .....	24		
Repeatability .....	24		
Hysteresis .....	24		

Influence of medium temperature .....	24	Accessories .....	51
Influence of medium density .....	24	Weld-in adapter .....	51
Influence of medium pressure .....	24	Weather protection cover .....	52
Switching delay .....	24	Lap joint flange .....	53
<b>Operating conditions.....</b>	<b>25</b>	Lap joint flanges .....	53
Installation .....	25	Sliding sleeves for unpressurized operation .....	54
Examples of mounting .....	25	High pressure sliding sleeves .....	55
Orientation .....	27	Cover with sight glass .....	56
<b>Environment.....</b>	<b>27</b>	Cover with sight glass .....	56
Ambient temperature range .....	27	Circular connector .....	56
Storage temperature .....	27	<b>Documentation.....</b>	<b>57</b>
Installation height as per IEC61010-1 Ed.3 .....	27	Operating Instructions .....	57
Climate class .....	27	Technical Information .....	58
Degree of protection .....	28	Functional safety (SIL) .....	58
Vibration resistance .....	28	Safety Instructions (ATEX) .....	58
Electromagnetic compatibility .....	28	Safety Instructions (NEPSI) .....	59
<b>Medium conditions .....</b>	<b>29</b>	Control Drawings .....	59
Medium temperature .....	29	System information .....	59
Thermal shock .....	29		
Medium pressure pe .....	29		
Test pressure .....	29		
State of aggregation .....	29		
Density .....	29		
Viscosity .....	29		
Solids content .....	29		
Lateral loading capacity .....	29		
<b>Mechanical construction .....</b>	<b>30</b>		
Design .....	30		
Dimensions .....	31		
Weights .....	36		
Materials and surfaces .....	36		
Process connections .....	37		
<b>Human interface .....</b>	<b>38</b>		
Electronic inserts .....	38		
Compact housing .....	38		
Operating concept .....	41		
<b>Certificates and approvals .....</b>	<b>41</b>		
CE mark .....	41		
RoHS .....	41		
RCM-tick mark .....	41		
EAC conformity .....	41		
CRN approval .....	41		
Pressure Equipment Directive 2014/68/EU (PED) .....	41		
Process seal according to ANSI/ISA 12.27.01 .....	42		
General approvals .....	42		
Other certificates .....	43		
Manufacturer declarations .....	43		
Use in hazardous zones .....	43		
ASME B 31.3 .....	43		
Pressure equipment directive .....	43		
<b>Ordering information .....</b>	<b>43</b>		
Product structure for Liquiphant M FTL50, FTL51 .....	44		
Product structure for Liquiphant M FTL50H, FTL51H .....	48		

## Application

### Point level detection

Maximum or minimum detection in tanks or pipes containing all kinds of liquids, including use in hazardous areas, food and pharmaceuticals.

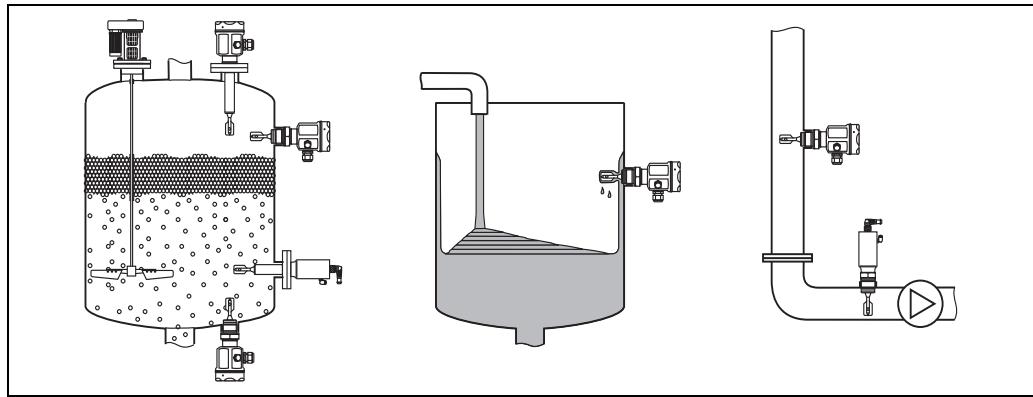

## Function and system design


### Measuring principle

The sensor's fork vibrates at its intrinsic frequency. This frequency is reduced when covered with liquid. This change in frequency causes the point level switch to switch.

### Modularity


#### Point level switch

Liquiphant M FTL with electronic versions  
FEL51, FEL52, FEL54

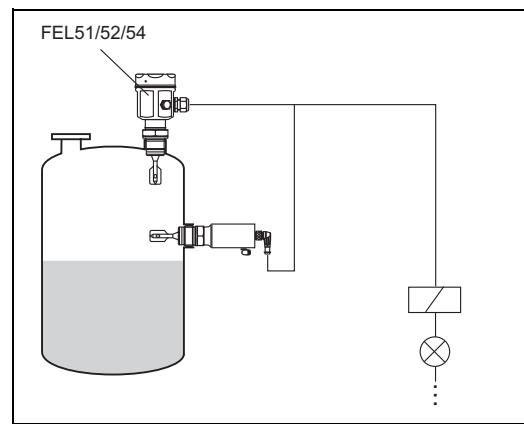

#### Point level switch

Liquiphant M FTL with electronic versions  
FEL55, FEL56, FEL57, FEL58  
for connecting to a separate switching unit  
or an isolating amplifier FEL50A  
for connecting to a PROFIBUS PA segment

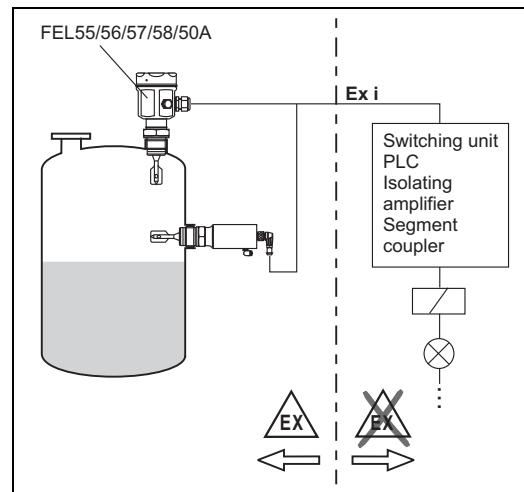

<b>Electronic versions</b>	<p>FEL51: Two-wire AC version; Switches the load directly into the power supply circuit via an electronic switch.</p> <p>FEL52: Three-wire DC version; Switches the load via the transistor (PNP) and separate connection e.g. in conjunction with programmable logic controllers (PLCs), DI modules as per EN 61131-2.</p> <p>FEL54: Universal current version with relay output; Switches the loads via 2 floating change-over contacts.</p> <p>FEL55: Signal transmission 16/8 mA on two-wire cabling e.g. in conjunction with programmable logic controllers (PLCs), AI modules 4 to 20 mA as per EN 61131-2.</p> <p>FEL56: For separate switching unit; signal transmission L-H edge 0.6 to 1.0 / 2.2 to 2.8 mA to EN 50227 (NAMUR) on two-wire cabling.</p> <p>FEL58: For separate switching unit; signal transmission H-L edge 2.2 to 3.5 / 0.6 to 1.0 mA to EN 50227 (NAMUR) on two-wire cabling. Checking of connecting cabling and other devices by pressing a key on the electronic insert.</p> <p>FEL57: For separate switching unit; PFM signal transmission; Current pulses superposed on the power supply along the two-wire cabling. Proof test from the switching unit without changing levels.</p> <p>FEL50A: For connecting to PROFIBUS PA; Cyclic and acyclic data exchange acc. to PROFIBUS-PA Profile 3.0 Discrete Input</p>
<b>Electronics for continuous density measurement</b>	FEL50D: For connecting to Density Computer FML621
<b>Galvanic isolation</b>	FEL51, FEL52, FEL50A: between sensor and power supply FEL54: between sensor and power supply and load FEL55, FEL56, FEL57, FEL58, FEL50D: see connected switching unit
<b>Design</b>	FTL50: Compact FTL51: With extension pipe FTL50H: Compact, with polished tuning fork and hygienic process connections FTL51H: With extension pipe, polished tuning fork and hygienic process connections

## Input

<b>Measured variable</b>	Level (limit value)
<b>Measuring range (detection range)</b>	FTL50: dependent on mounting point FTL51: dependent on mounting point and the extension pipe ordered. Standard extension pipe up to 3 m (9.8 ft) and up to 6 m (20 ft) on request.
<b>Density</b>	Setting on the electronic insert > 0.5 g/cm <sup>3</sup> (SGU) or > 0.7 g/cm <sup>3</sup> (SGU) (others on request)

## Electronic insert FEL51 (AC 2-wire)

### Power supply

Supply voltage: AC 19 to 253 V  
 Power consumption: < 0.83 W  
 Residual current consumption: < 3.8 mA  
 Short-circuit protection  
 Overvoltage protection FEL51: overvoltage category III

### Electrical connection


#### Two-wire AC connection

Switches the load directly into the power supply circuit via an electronic switch.

Always connect in series with a load!

Check the following:

- The residual current in blocked state (up to 3.8 mA)
- That for low voltage
  - the voltage drop across the load is such that the minimum terminal voltage at the electronic insert (19 V) when blocked is not undershot.
  - the voltage drop across the electronics when switched through is observed (up to 12 V)
- That a relay cannot de-energize with holding power below 3.8 mA.  
 If this is the case, a resistor should be connected parallel to the relay. An RC module is available under the part number: 71107226
- When selecting the relay, pay attention to the holding power / rated power (see "Connectable load")

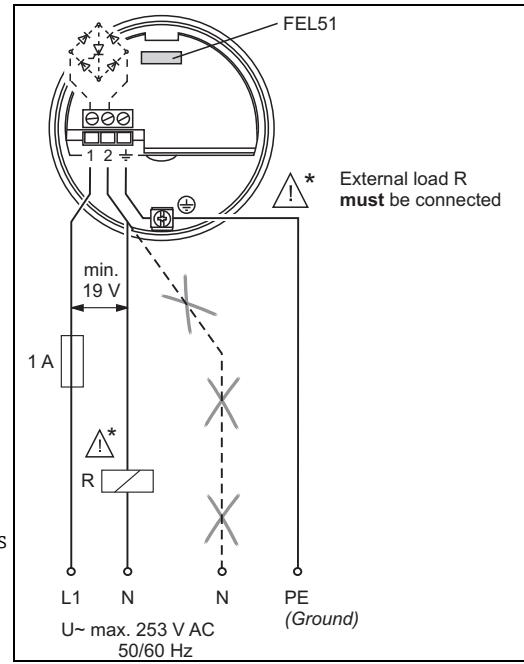

L00-FTL5xxxx-04-05-xx-en-007

### Output signal

$I_L$  = load current (switched through)

< 3.8 mA = residual current (blocked)

= lit

= unlit

L00-FTL2xxxx-07-05-xx-xx-000

Safety mode	Level	Output signal	LEDs
			green red
MAX		1 $\xrightarrow{I_L}$ 2	
		1 $\xrightarrow{< 3.8 \text{ mA}}$ 2	
MIN		1 $\xrightarrow{I_L}$ 2	
		1 $\xrightarrow{< 3.8 \text{ mA}}$ 2	

L00-FTL5xxxx-04-05-xx-xx-001

### Signal on alarm

Output signal on power failure or in the event of damaged sensor: < 3.8 mA

### Connectable load


- Voltage drop via FEL51  $\leq 12 \text{ V}$
- Residual current if electrical switch is blocked:  $\leq 3.8 \text{ mA}$
- Load switched directly into the power supply circuit via the thyristor.  
 Transient (40 ms)  $\leq 1.5 \text{ A}$ ,  $\leq 375 \text{ VA}$  at 253 V or  $\leq 36 \text{ VA}$  at 24 V (not short-circuit-proof)

The load is switched via an electronic switch directly in the power circuit.

Always connect in series with a load!

Not suitable for connection to low-voltage PLC inputs!

## Selection guide for relays

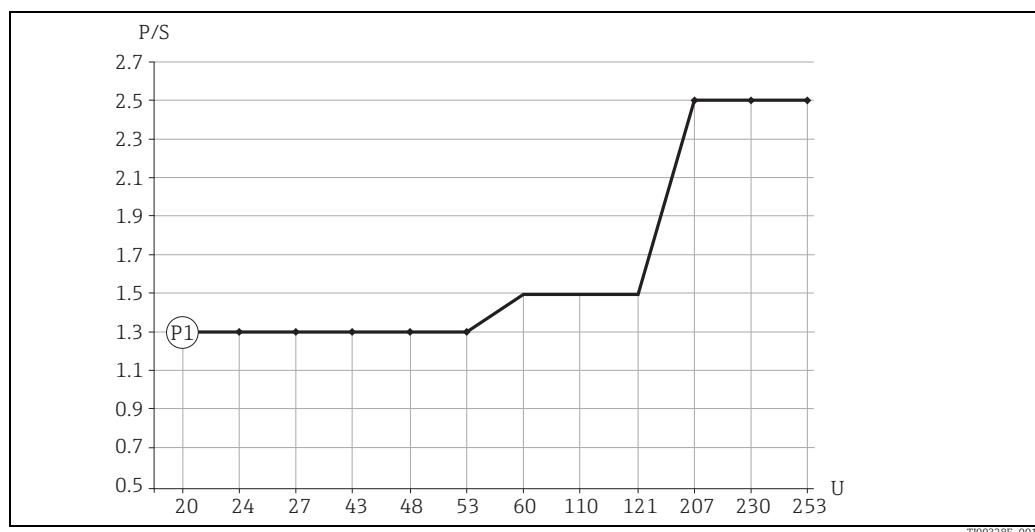

*Minimum nominal power of load*

*P/S nominal power in [W] / [VA]*

*U operating voltage in [V]*

Position	Operating voltage	Nominal power	
		min.	max.
P1	24 V	> 1.3 VA	< 8.4 VA
AC operation	110 V	> 1.5 VA	< 38.5 VA
	230 V	> 2.5 VA	< 80.5 VA

Relays with less nominal power can be operated via an RC module connected in parallel (optional).





## Electronics FEL51 (AC, in compact housing)

### Power supply

Supply voltage: AC 19 to 253 V  
 Power consumption: < 0.83 W  
 Residual current consumption: < 3.8 mA  
 Short-circuit protection  
 Overvoltage protection FEL51: overvoltage category III

### Electrical connection

#### Two-wire AC connection

Connector	MAX	MIN
FTL5#(H)- #####C3# 		
FTL5#(H)- #####D3# (Pg11) oder FTL5#(H)- #####E3# (NPT 1/2") 		

L00-FTL5xxxx-04-05-xx-xx-012

### Output signal

Safety mode	Level	Output signal	LEDs
			green red
MAX		1 → $I_L$ → 3	
		1 → 3	
		1 → $I_L$ → 2	
		1 → 2	

L00-FTL2xxxx-07-05-xx-xx-000

### Signal on alarm

Output signal on power failure or in the event of damaged sensor: < 3.8 mA


**Connectable load**

- Voltage drop via FEL51  $\leq 12$  V
- Residual current if electrical switch is blocked:  $\leq 3.8$  mA
- Load switched directly into the power supply circuit via the thyristor.  
Transient (40 ms)  $\leq 1.5$  A,  $\leq 375$  VA at 253 V or  $\leq 36$  VA at 24 V (not short-circuit-proof)

The load is switched via an electronic switch directly in the power circuit.

Always connect in series with a load!

Not suitable for connection to low-voltage PLC inputs!

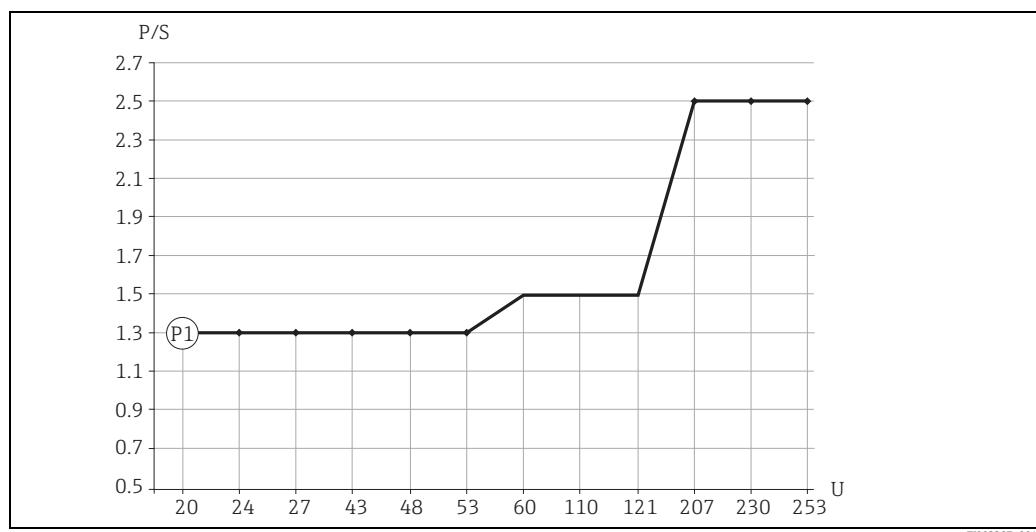**Selection guide for relays**

*Minimum nominal power of load*

*P/S* nominal power in [W] / [VA]

*U* operating voltage in [V]

T100328F\_001

Position	Operating voltage	Nominal power	
		min.	max.
P1	24 V	> 1.3 VA	< 8.4 VA
AC operation	110 V	> 1.5 VA	< 38.5 VA
	230 V	> 2.5 VA	< 80.5 VA

Relays with less nominal power can be operated via an RC module connected in parallel (optional).

## Electronic insert FEL52 (DC PNP)


### Power supply

Supply voltage: DC 10 to 55 V  
 Ripple:  $\leq 1.7$  V, 0 to 400 Hz  
 Current consumption:  $\leq 15$  mA  
 Power consumption:  $\leq 0.83$  W  
 Reverse polarity protection  
 Overtoltage protection FEL52: overvoltage category III

### Electrical connection

#### Three-wire DC connection

Switches the load via the transistor (PNP) and separate connection.  
 Preferably used with programmable logic controllers (PLC),  
 DI modules as per EN 61131-2.  
 Positive signal at switching output of the electronics (PNP); Output blocked on reaching point level.

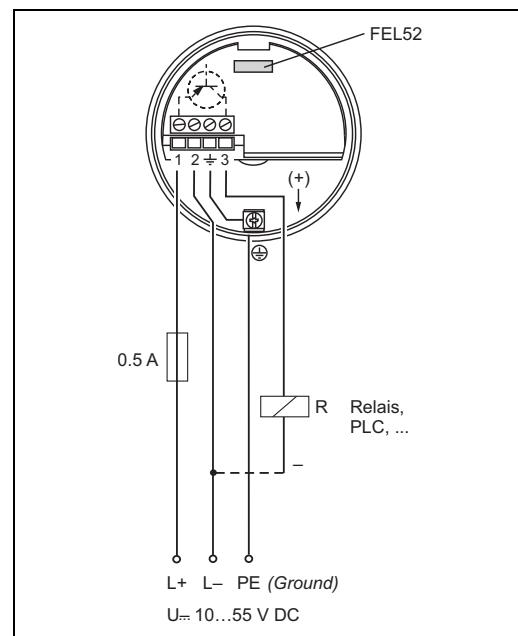

L00-FTL5xxxx-04-05-xx-xx-030

### Output signal

$I_L$  = load current (switched through)

$< 100 \mu\text{A}$  = residual current (blocked)

= lit

= unlit

L00-FTL2xxxx-07-05-xx-xx-000

Safety mode	Level	Output signal	LEDs
			green red
MAX		$L+ \xrightarrow{1} I_L \rightarrow 3$	
		$1 \xrightarrow{< 100 \mu\text{A}} 3$	
MIN		$L+ \xrightarrow{1} I_L \rightarrow 3$	
		$1 \xrightarrow{< 100 \mu\text{A}} 3$	

L00-FTL5xxxx-04-05-xx-xx-004

### Signal on alarm

Output signal on power failure or in the event of damaged sensor:  $< 100 \mu\text{A}$

### Connectable load


- Load switched via the transistor and separate PNP connection,  $\leq$  DC 55 V
- Load current  $\leq 350$  mA (pulsed overload and short-circuit protection)
- Residual current  $< 100 \mu\text{A}$  (with transistor blocked).
- Capacitance load  $\leq 0.5 \mu\text{F}$  at 55 V,  $\leq 1.0 \mu\text{F}$  at 24 V
- Residual voltage  $< 3$  V (with transistor switched through);

## Electronics FEL52 (DC PNP, in compact housing)

Power supply	Supply voltage: DC 10 to 55 V Ripple: $\leq 1.7$ V, 0 to 400 Hz Current consumption: $\leq 15$ mA Power consumption: $\leq 0.83$ W Reverse polarity protection Overvoltage protection FEL52: overvoltage category III
--------------	--

### Electrical connection

#### Three-wire DC connection

	Connector	MAX	MIN
Preferably used with programmable logic controllers (PLC), DI module as per EN 61131-2. Positive signal at switching output of the electronics (PNP); Output blocked on reaching point level.  Note! When using in conjunction with a cable end (FTL5#(H)- #####C3#), the compact housing should only be used in enclosed areas.	 		
			
			

L00-FTL5xxxx-04-05-xx-xx-004

### Output signal

#### With valve connector or cable tail

$I_L$  = load current (switched through)

$< 100 \mu\text{A}$  = residual current (blocked)

 = lit

 = unlit

L00-FTL2xxxx-07-05-xx-xx-000

Safety mode	Level	Output signal	LEDs
			green red
MAX		$L+ \xrightarrow{3} I_L \xrightarrow{2} +$	 
		$L+ \xrightarrow{3} < 100 \mu\text{A} \xrightarrow{2} +$	 
MIN		$L+ \xrightarrow{2} I_L \xrightarrow{3} +$	 
		$L+ \xrightarrow{2} < 100 \mu\text{A} \xrightarrow{3} +$	 

L00-FTL5xxxx-04-05-xx-xx-004

## With M12x1 connector 52010285 / 52024216 (without LEDs)



L00-FTL5xxxx-16-05-xx-xx-002

$I_L$  = load current  
(switched through)

$< 100 \mu\text{A}$  = residual current  
(blocked)

= lit


= unlit

L00-FTL2xxxx-07-05-xx-xx-000

Safety mode	Level	Output signal	LEDs
MAX		$L^+ \xrightarrow{1} I_L \xrightarrow{2}$	
		$L^+ \xrightarrow{1} < 100 \mu\text{A} \xrightarrow{2}$	
MIN		$L^+ \xrightarrow{1} I_L \xrightarrow{4}$	
		$L^+ \xrightarrow{1} < 100 \mu\text{A} \xrightarrow{4}$	

L00-FTL5xxxx-04-05-xx-xx-010

## With M12x1 connector 52018763 (with LEDs)



L00-FTL5xxxx-16-05-xx-xx-001

$I_L$  = load current  
(switched through)

$< 100 \mu\text{A}$  = residual current  
(blocked)

= lit

= unlit

L00-FTL2xxxx-07-05-xx-xx-000

Safety mode	Level	Output signal	LEDs
MAX		$L^+ \xrightarrow{1} I_L \xrightarrow{2}$	
		$L^+ \xrightarrow{1} < 100 \mu\text{A} \xrightarrow{2}$	
MIN		$L^+ \xrightarrow{1} I_L \xrightarrow{4}$	
		$L^+ \xrightarrow{1} < 100 \mu\text{A} \xrightarrow{4}$	

L00-FTL5xxxx-04-05-xx-xx-011

## Signal on alarm

Output signal on power failure or in the event of damaged sensor:  $< 100 \mu\text{A}$ 

## Connectable load

- Load switched via the transistor and separate PNP connection,  $\leq \text{DC } 55 \text{ V}$
- Load current  $\leq 350 \text{ mA}$  (pulsed overload and short-circuit protection)
- Residual current  $< 100 \mu\text{A}$  (with transistor blocked).
- Capacitance load  $\leq 0.5 \mu\text{F}$  at 55 V,  $\leq 1.0 \mu\text{F}$  at 24 V
- Residual voltage  $< 3 \text{ V}$  (with transistor switched through);

## Electronic insert FEL54 (AC/DC with relay output)

<b>Power supply</b>	Supply voltage: AC 19 to 253 V, 50/60 Hz or DC 19 to 55 V Power consumption: $\leq 1.3$ W Reverse polarity protection Overvoltage protection FEL54: overvoltage category III
---------------------	---


<b>Electrical connection</b>	<b>Universal current connection with relay output</b>
------------------------------	---

Power supply:  
Please note the different  
voltage ranges for AC and DC.  
AC.

Output:  
When connecting an instrument with  
high inductance, provide a spark arrester  
to protect the relay contact.  
A fine-wire fuse (depending on the  
load connected) protects the relay  
contact on short-circuiting.  
Both relay contacts switch simultaneously.

\* When jumpered, the relay  
output works with NPN logic.

\*\* See "Connectable load"

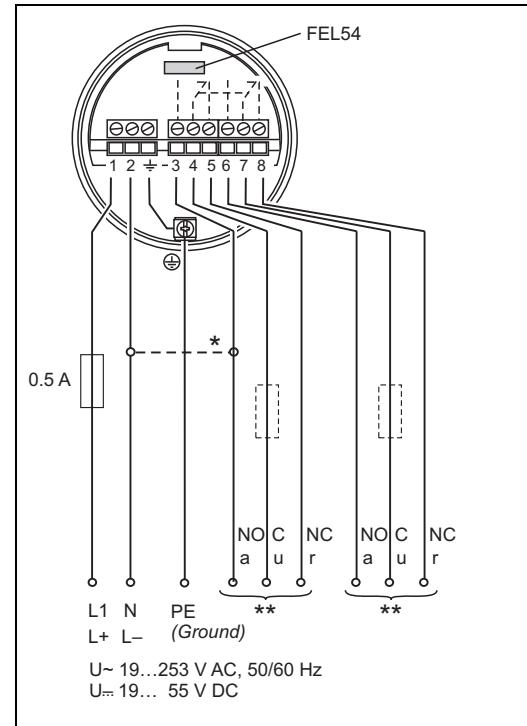

L00-FTL5xxxx-04-05-xx-xx-002

### Output signal

Safety mode	Level	Output signal	LEDs
		green	red
MAX	3 4 5	3 4 5	●
	6 7 8	6 7 8	
MIN	3 4 5	3 4 5	●
	6 7 8	6 7 8	

Legend for output signals:

- 3 4 5 = relay energized
- 6 7 8 = relay de-energized
- = lit
- = unlit

L00-FTL2xxxx-07-05-xx-xx-001

L00-FTL5xxxx-04-05-xx-xx-005

### Signal on alarm

Output signal on power failure or in the event of damaged sensor: relay de-energized

### Connectable load

- Loads switched via 2 floating change-over contacts (DPDT).
- $I_{\text{~}} \leq 6$  A (Ex de 4 A),  $U_{\text{~}} \leq \text{AC } 253$  V;  $P_{\text{~}} \leq 1500$  VA,  $\cos \varphi = 1$ ,  $P_{\text{~}} \leq 750$  VA,  $\cos \varphi > 0.7$
- $I_{\text{~}} \leq 6$  A (Ex de 4 A) to DC 30 V,  $I_{\text{~}} \leq 0.2$  A to 125 V
- When connecting a low-voltage circuit with double insulation according to IEC 1010, the following applies: the sum of the voltages of the relay output and power supply is  $\leq 300$  V
- The electronic insert FEL52 DC-PNP is preferred for low DC load currents (e.g. when connecting to a PLC)
- Relay contact material: silver/nickel AgNi 90/10

## Electronic insert FEL55 (8/16 mA)

### Power supply


Supply voltage: DC 11 to 36 V  
 Power consumption: < 600 mW  
 Reverse polarity protection  
 Overvoltage protection FEL55: overvoltage category III

### Electrical connection

#### Two-wire connection for separate switching unit

For separate switching unit.  
 Signal transmission 16/8 mA on two-wire cabling.  
 For connection to programmable logic controllers (PLC) for example, AI modules 4 to 20 mA to EN 61131-2.  
 Output signal jump from high to low current on point level.

Fuse required for non-Ex applications!  
 Only use power units with safe galvanic isolation (e.g. SELV).

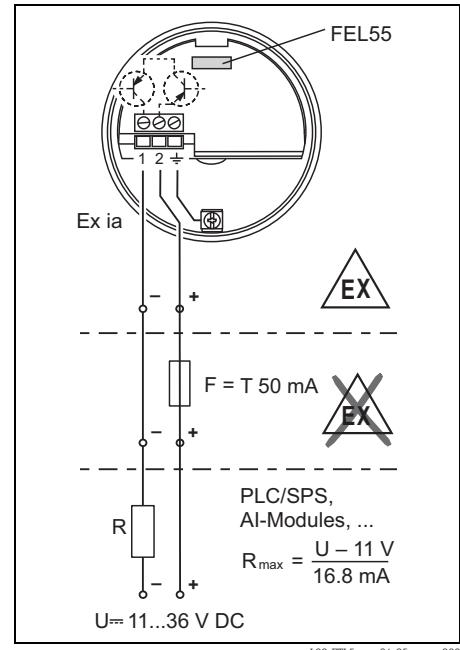

L00-FTL5xxxx-04-05-xx-en-000

### Output signal

Safety mode	Level	Output signal	LEDs green	red
MAX		+ 2 → ~16 mA 1		
		+ 2 → ~8 mA 1		
MIN		+ 2 → ~16 mA 1		
		+ 2 → ~8 mA 1		

L00-FTL2xxxx-07-05-xx-000

L00-FTL5xxxx-04-05-xx-006

### Signal on alarm

Output signal on power failure or in the event of damaged sensor: < 3.6 mA

### Connectable load

- $R = (U - 11 V) : 16.8 \text{ mA}$
- $U = \text{connection voltage: DC 11 to 36 V (in wet environments DC 11 to 35 V)}$

Example: PLC with  $250 \Omega$  with 2-wire version

$$250 \Omega = (U - 11V) / 16.8 \text{ mA}$$

$$4.2 [\Omega / A] = U - 11 V$$

$$U = 15.2 V$$

## Electronic insert FEL56 (NAMUR L-H edge)

<b>Power supply</b>	Supply voltage: DC 8.2 V $\pm 20\%$ Power consumption: < 6 mW at $I < 1$ mA; < 38 mW at $I = 2.8$ mA Connection data interface: IEC 60947-5-6
---------------------	---


### Electrical connection

#### Two-wire connection for separate switching unit

For connecting to isolating amplifiers acc. to NAMUR (IEC 60947-5-6), e.g. FTL325N, FTL375N from Endress+Hauser.  
Output signal jump from low to high current on point level.

(L-H edge)

Connecting to multiplexer:  
Set clock time to min. 2 s.

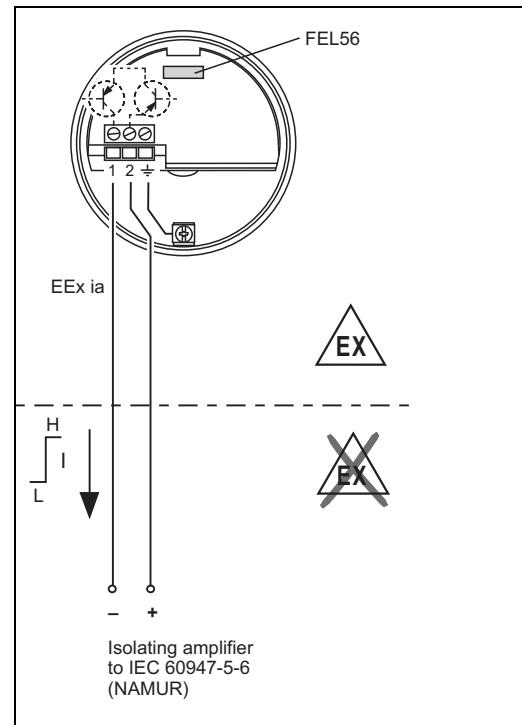

L00-FTL5xxxx-04-05-xx-en-004

### Output signal

Safety mode	Level	Output signal	LEDs
			green red
MAX		+ 0.6 ... 1.0 mA 2 → 1	
		+ 2.2 ... 2.8 mA 2 → 1	
MIN		+ 0.6 ... 1.0 mA 2 → 1	
		+ 2.2 ... 2.8 mA 2 → 1	

L00-FTL5xxxx-07-05  
xx-xx-002

L00-FTL5xxxx-04-05-xx-xx-003

### Signal on alarm

Output signal in the event of damaged sensor: > 2.2 mA

### Connectable load

▪ See Technical Data of the isolating amplifier connected according to IEC 60947-5-6 (NAMUR)

## Electronic insert FEL58 (NAMUR H-L edge)

### Power supply

Supply voltage: DC 8.2 V  $\pm 20\%$   
 Power consumption: < 6 mW at  $I < 1$  mA; < 38 mW at  $I = 3.5$  mA  
 Connection data interface: IEC 60947-5-6

### Electrical connection

#### Two-wire connection for separate switching unit


For connecting to isolating amplifiers as per NAMUR (IEC 60947-5-6), e.g. FTL325N, FTL375N from Endress+Hauser.  
 Output signal jump from high to low current on point level.

(H-L edge)

Additional function:  
 Test key on the electronic insert.  
 Pressing the key breaks the connection to the isolating amplifier.

 Note!  
 In Ex-d applications, the additional function can only be used if the housing is not exposed to an explosive atmosphere.

Connecting to multiplexer:  
 Set clock time to min. 2 s.

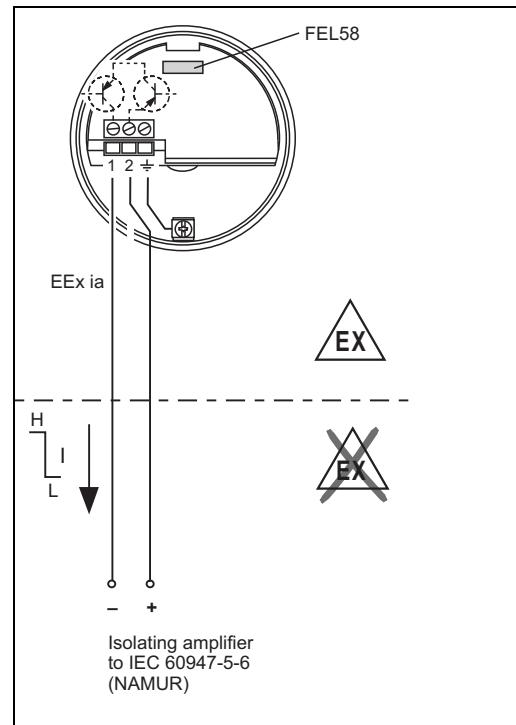

L00-FTL5xxxx-04-05-xx-en-002

### Output signal

Safety mode	Level	Output signal	LEDs green yellow
MAX		+ 2.2 ... 2 mA → 1	 
		+ 0.6 ... 2 mA → 1	 
MIN		+ 2.2 ... 2 mA → 1	 
		+ 0.6 ... 2 mA → 1	 

L00-FTL5xxxx-07-05-  
xx-xx-002

L00-FTL5xxxx-04-05-xx-xx-007

### Signal on alarm

Output signal in the event of damaged sensor: < 1.0 mA

### Connectable load











- See Technical Data of the isolating amplifier connected according to IEC 60947-5-6 (NAMUR)
- Connection also to isolating amplifiers which have special safety circuits ( $I > 3.0$  mA)

## Electronics FEL58 (NAMUR H-L edge, compact housing)

Power supply	Supply voltage: DC 8.2 V $\pm 20\%$ Power consumption: < 6 mW at $I < 1$ mA; < 38 mW at $I = 3.5$ mA Connection data interface: IEC 60947-5-6
--------------	---


### Electrical connection

#### Two-wire connection for separate switching unit

Connector	MAX	MIN
 <b>FTL5#(H)- #####N3# (M12x1)</b> 52018763		
 <b>FTL5#(H)- #####N3# (M12x1)</b> 52010285 / 52024216		
 <b>FTL5#(H)- #####D3# (Pg11)</b> <b>FTL5#(H)- #####E3# (NPT 1/2")</b> -30°C ≤ TA ≤ +70°C -22°F ≤ TA ≤ +158°F		
 <b>FTL5#(H)- #####C3#</b>		

L00-FTL5xxxx-04-05-xx-xx-013

### Output signal

Safety mode	Level	Output signal	LEDs green yellow
MAX		+ 2.2... 1 → 3.5 mA → 3	
		+ 0.6... 1 → 1.0 mA → 3	
MIN		+ 2.2... 1 → 3.5 mA → 2	
		+ 0.6... 1 → 1.0 mA → 2	

L00-FTL5xxxx-07-05-xx-xx-002

L00-FTL5xxxx-04-05-xx-xx-007a



#### Note!

The light emitting diodes are not readable on the version FTL5x(H)-## ## ## #C 3# (compact IP66/68 316L with a 5 m cable).

Signal on alarm	Output signal in the event of damaged sensor: < 1.0 mA
-----------------	--

Connectable load	<ul style="list-style-type: none"> <li>See Technical Data of the isolating amplifier according to IEC 60947-5-6 (NAMUR)</li> <li>Connection also to isolating amplifiers which have special safety circuits (<math>I &gt; 3.0</math> mA)</li> </ul>
------------------	---

## Electronic insert FEL57 (PFM)

### Power supply

Supply voltage: DC 9.5 to 12.5 V  
 Current consumption: 10 to 13 mA  
 Power consumption: < 150 mW  
 Reverse polarity protection

### Electrical connection

#### Two-wire connection for separate switching unit

For connecting to Endress+Hauser switching units Nivotester FTL320, FTL325P, FTL370, FTL372, FTL375P (also with proof test).

Output signal jump of the PFM signal from high to low frequency when sensor is covered. Switching between minimum/maximum safety in the Nivotester.

Additional function "proof test":  
 After interruption of the power supply, a test cycle is activated which checks the sensor and electronics without any change in level.  
 Approved for overfill protection acc. to WHG (German Water Resources Act).  
 The following can be switched at the electronic insert:

##### - Standard (STD):

Corrosion of the fork unlikely;  
 simulation approx. 8 s  
 tuning fork exposed – covered – exposed.  
 For proof testing, the Nivotester tests the sensor's level notification function.

##### - Extended (EXT):


Corrosion of the fork possible;  
 Simulation approx. 41 s: tuning fork exposed – covered – corroded – exposed.  
 For proof testing, the Nivotester tests the sensor's level notification function and fault notification (alarm) function.

The check is activated and monitored at the switching unit.

The twin-core connecting cable (instrument cable) with a cable resistance of  $\leq 25 \Omega$  per core is connected to the screw terminals (conductor cross-sections 0.5 to 2.5 mm<sup>2</sup> / 0.02 to 0.1 in) in the connection compartment. Protective circuits against reverse polarity, HF influences and overvoltage peaks are installed.

Maximum cable length up to 1000 m (3281 ft).

A shielded connecting cable is recommended in the event of strong electromagnetic interference. Here the shielding must be connected to the sensor and the power supply.

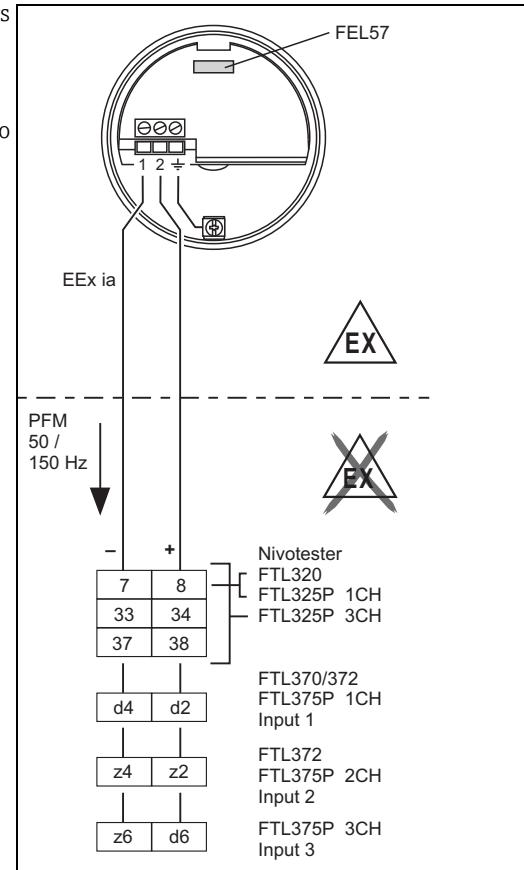

L00-FTL5xxxx-04-05-xx-en-003

## Switching behavior of the connected device:

Fail-safe mode set at switching unit	Setting at FEL57	Fork	Switching status of relay in switching unit	
			on = energised	off = de-energised
			↑ Test start ↓ (power off) ↓ > 3 s	↓ End of test start ↓ (power on)
MAX	STD	free	on   off	~ 5 s off   ~ 2 s on   ~ 2 s off   on
MAX	EXT	free	on   off	~ 5 s off   ~ 2 s on   ~ 35 s off   //   on
MAX	STD	covered	off   off	off
MAX	EXT	covered	off   off	off
MIN	STD	free	off   ~ 3 s on	~ 5 s off   ~ 3 s on   off
MIN	EXT	free	off   ~ 3 s on	~ 7 s off   ~ 30 s on   //   off
MIN	STD	covered	on   ~ 3 s on	~ 5 s off   on
MIN	EXT	covered	on   ~ 3 s on	~ 5 s off   ~ 35 s on   //   ~ 3 s off   on

L00-FTL5xxxx-05-05-xx-en-000

\* De-energized on power supply failure

Please note this switching response and function of the plant especially when replacing a Liquiphant incorporating electronic insert EL17Z or FEL37 with a Liquiphant M incorporating electronic insert FEL57.

## Output signal



= lit



= unlit

L00-FTL2xxxx-07-05-  
xx-xx-000

Safety mode	Level	Output signal (PFM)	LEDs green yellow
		 150 Hz	
		 50 Hz	

L00-FTL5xxxx-04-05-xx-xx-000

## Signal on alarm

Output signal on power failure or in the event of damaged sensor: 0 Hz

## Connectable load

- Floating relay contacts in the connected switching unit Nivotester FTL325P, FTL375P
- For contact load, see the Technical Data of the switching unit.

## Electronic insert FEL50A (PROFIBUS PA)

### Power supply

Bus voltage: DC 9 to 32 V

Bus current:

- 12.5 mA +/- 1.0 mA (software version: 01.03.00, hardware version: 02.00)
- 10.5 mA +/- 1.0 mA (software version: 01.03.00, hardware version: 01.00)



### Electrical connection

Two-wire connection for power supply and data transfer

For connecting to PROFIBUS PA

Additional functions:

- Digital communication enables the representation, reading and editing of the following parameters:  
Fork frequency, switch-on frequency, switch-off frequency, switch-on time and switch-off time, status, measured value, density switch.
- Matrix locking possible
- Switch to WHG mode possible (WHG approval)
- For a detailed description, see BA00198F

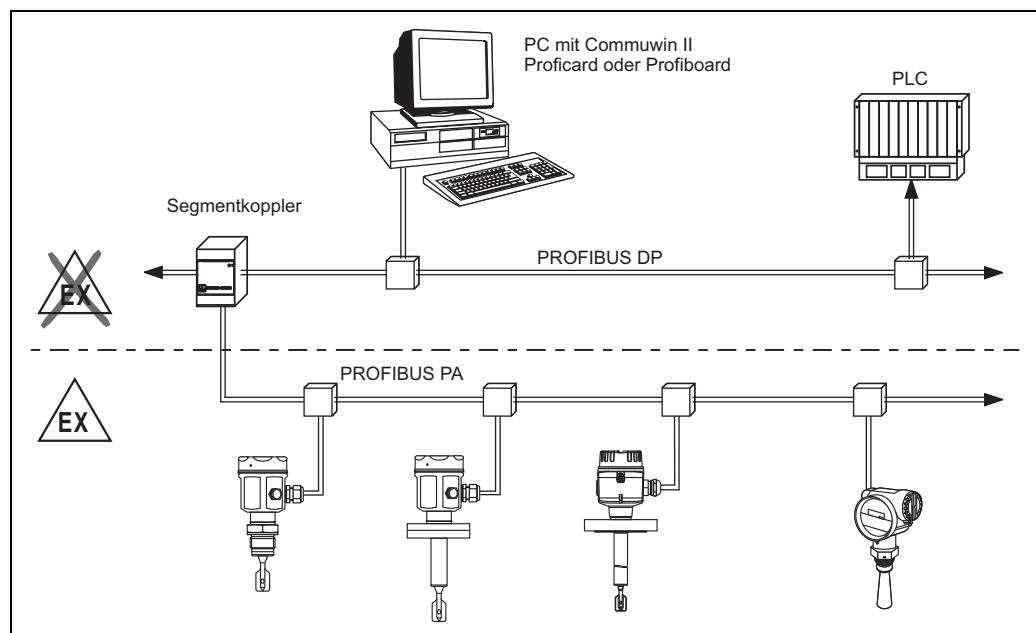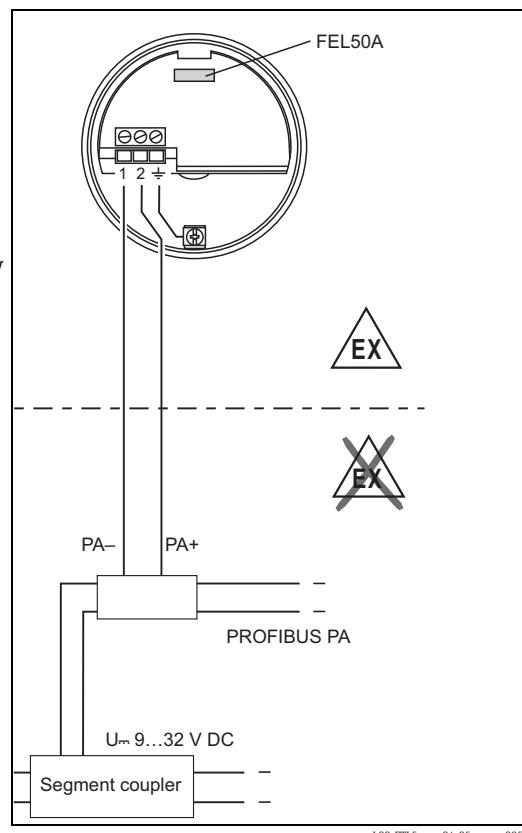

## Output signal

 = lit  
 = unlit

L00-FTL2xxxx-07-05-  
xx-xx-000

Setting	Level	LEDs		FEL50A
		green	yellow	
not inverted	 			OUT_D = 0 PA bus signal
				OUT_D = 1 PA bus signal
inverted	 			OUT_D = 0 PA bus signal
				OUT_D = 1 PA bus signal

L00-FTL5xxxx-04-05-xx-009

## Signal on alarm

- Failure information can be opened using the following interfaces:  
Yellow LED flashing, status code, diagnostic code; see BA00198F

## Electronic insert FEL50D (density)

### Power supply

Frequency range: 300 to 1500 Hz  
 Signal level: 4 mA  
 Pulse height: 16 mA  
 Pulse width: 20  $\mu$ s

### Electrical connection


**Two-wire connection at Density Computer FML621**  
 For connecting to the density and concentration computer FML621.

The output signal is based on pulse technology.  
 With the aid of this signal, the fork frequency is constantly forwarded to the switching unit.



**Caution!**  
 Operation with other switching units,  
 such as FTL325P, is not permitted.

This electronic insert cannot be installed in devices that were

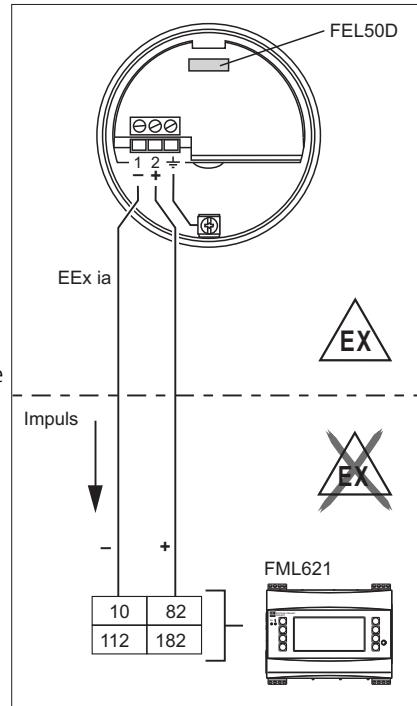

TI420Fen004

### Signal on alarm

Output signal on power failure or in the event of damaged sensor: 0 Hz

### Adjustment

In the Liquiphant M modular system, the option of an adjustment is also provided in addition to the electronics  
 (see feature 60: "Accessories").

There are three types of adjustment:

**Standard adjustment** (see ordering information for additional option, basic version A)

- Here, two fork parameters are determined to describe the sensor characteristics, indicated in the adjustment report and provided with the product.

These parameters must be transmitted to the Density Computer FML621.

**Special adjustment** (see ordering information for additional option, special adjustment, density  $H_2O$  (K) or special adjustment, density  $H_2O$  with 3.1 certificate (L))

- Here, three fork parameters are determined to describe the sensor characteristics, indicated in the adjustment report and provided with the product.

These parameters must be transmitted to the Density Computer FML621.

Greater accuracy is achieved with this type of adjustment (see also "Performance characteristics").

### Field Adjustment

- During field adjustment, a density value actually determined by the customer is entered and the system is automatically adjusted to this value (wet adjustment).




### Note!

More information on Liquiphant M Density is available in Technical Information TI00420F. This can be downloaded from [www.endress.com](http://www.endress.com) => Download.

**Operating principle**

Measuring the density of a liquid medium in pipes and tanks. Also suitable for use in hazardous areas, and preferably for applications in the chemical and food industry.

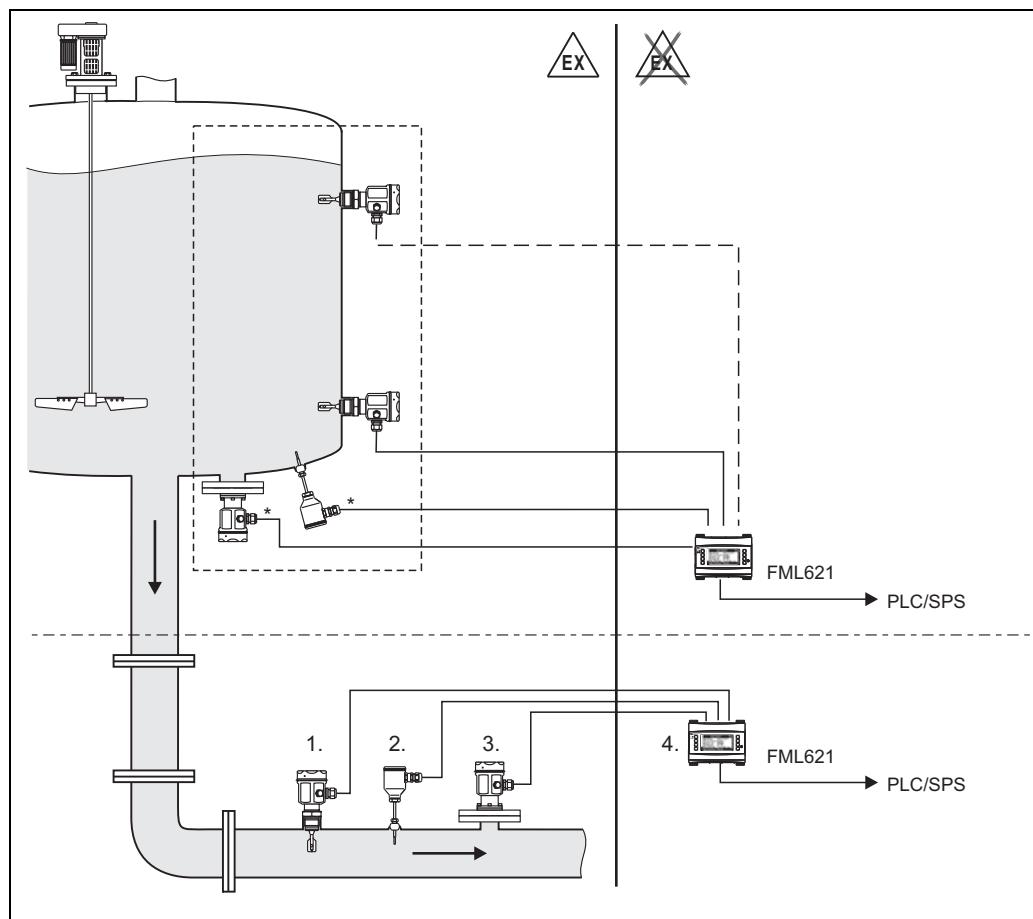

TI420Fx016

\* Pressure and temperature information required depending on the application.

1. Liquiphant M sensor with electronic insert FEL50D (pulse output);
2. Temperature sensor (e.g. 4 to 20 mA output);
3. Pressure transmitter (4 to 20 mA output);
4. Liquiphant density and concentration computer FML621 with display and operating unit


**Light signals**

	LED	Symbol	Information
Yellow	Yellow	○ - □	Measurement valid
		○ □	Unstable process situation
		●	Maintenance required
Green	Green	○ ○	Power on
		○ ●	Power off
Red	Red	↖ ●	No fault
		○	Maintenance required
		○	Device failure

## Connection and function

<b>Connecting cables</b>	<ul style="list-style-type: none"> <li>■ Electronic inserts: cross-section <math>\leq 2.5 \text{ mm}^2</math> (14 AWG); strand in ferrule as per DIN 46228</li> <li>■ Protective ground in housing: cross-section <math>\leq 2.5 \text{ mm}^2</math> (14 AWG)</li> <li>■ External equipotential bonding connection on housing: cross-section <math>\leq 4 \text{ mm}^2</math> (12 AWG)</li> </ul>
<b>Safety mode</b>	<p>Minimum/maximum residual current safety selectable on electronic insert. (with FEL57 on Nivotester only)</p> <p>MAX = maximum safety: The output switches to the power fail response when the fork is covered For use with overfill protection for example</p> <p>MIN = minimum safety: The output switches to the power fail response when the fork is exposed For use with dry running protection for example</p>
<b>Switching time</b>	<p>When fork is covered: approx. 0.5 s When fork is exposed: approx. 1.0 s Additionally configurable for PROFIBUS PA: 0.5-60 s Other switching times available on request.</p>
<b>Switch-on behavior</b>	<p>When switching on the power supply, the output assumes the alarm signal. After <math>\leq 3</math> s it assumes the correct switching mode (exception: FEL57)</p>

## Performance characteristics

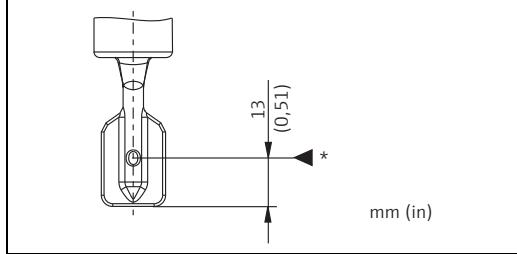
<b>Reference operating conditions</b>	<p>Ambient temperature: 23 °C (73 °F) Medium temperature: 23 °C (73 °F) Medium density (water): 1 g/cm<sup>3</sup> (SGU) Medium viscosity: 1 mm<sup>2</sup>/s (cSt) Medium pressure <math>p_e</math>: 0 bar (0 psi) Sensor mounting: vertical from above Density switch: to <math>&gt; 0.7 \text{ g/cm}^3</math> (SGU)</p>	 <p>13 (0.51) mm (in)</p> <p>L00-FTL5xxxx-06-05-xx-xx-031</p> <p>* Switch point under reference operating conditions</p>
<b>Maximum measured error</b>	Under reference operating conditions: max. $\pm 1 \text{ mm}$ (0.04 in)	
<b>Repeatability</b>	0.1 mm (0.004 in)	
<b>Hysteresis</b>	approx. 2 mm (0.08 in)	
<b>Influence of medium temperature</b>	max. +1.8 to -2.8 mm (-50 to +150 °C / -58 to 302 °F)	
<b>Influence of medium density</b>	max. +4.8 to -3.5 mm ((0.5 to 1.5 g/cm <sup>3</sup> (SGU)) max. +0.19 to -0.14 in	
<b>Influence of medium pressure</b>	max. 0 to -2.5 mm (-1 to 64 bar (-14.5 to 928 psi)) max. 0 to -0.1 in	
<b>Switching delay</b>	<ul style="list-style-type: none"> <li>■ When fork is covered: 0.5 s</li> <li>■ When fork is exposed: 1.0 s</li> <li>■ Available on request: 0.2 s; 1.5 s or 5 s (when the tuning fork is covered or exposed)</li> </ul>	

## Operating conditions

### Installation

#### Installation instructions

Switch points  $\downarrow$  on the sensor depend on the mounting position, with reference to water, Density 1 g/cm<sup>3</sup> (SGU), 23 °C (73 °F),  $p_e$  0 bar (0 psi).

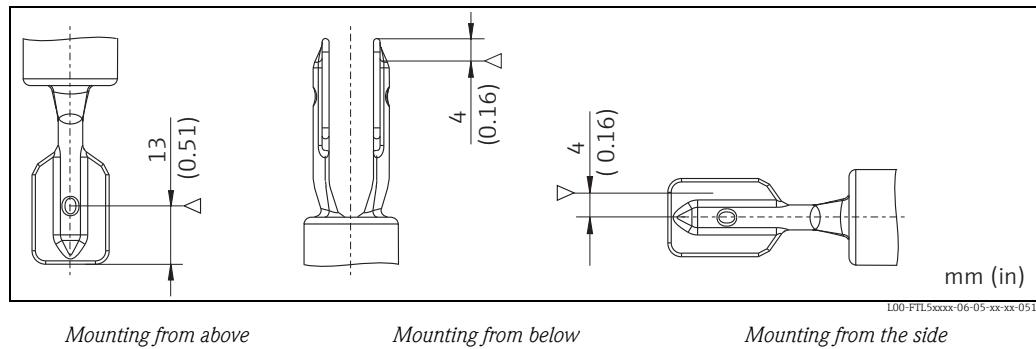

#### Note!


- The switch points of the Liquiphant M are at other positions to those of the previous version Liquiphant II.
- Minimum distance between the tip of the fork and the tank wall or pipe wall: 10 mm

### Examples of mounting

Examples of mounting with regard to the viscosity  $\nu$  of the liquid and the tendency to form buildup

#### Optimum mounting, without problem even with high viscosity:

Position the fork so that the narrow edge of the tines is vertical to ensure that the liquid can run off easily.

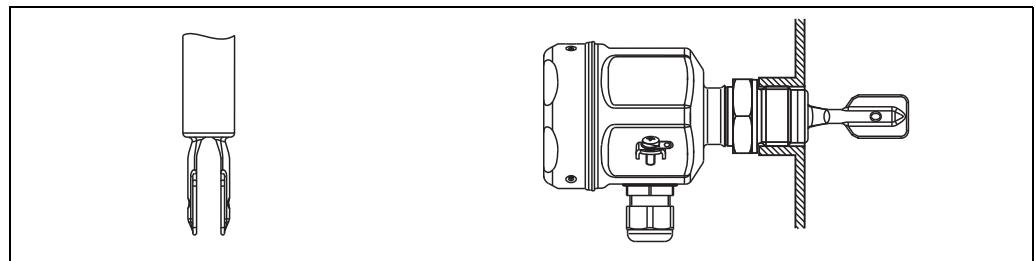


Vertical from above

Flush-mounted from the side

#### With buildup on the tank walls:

\* Ensure that there is sufficient distance between the buildup expected on the tank wall and the fork.

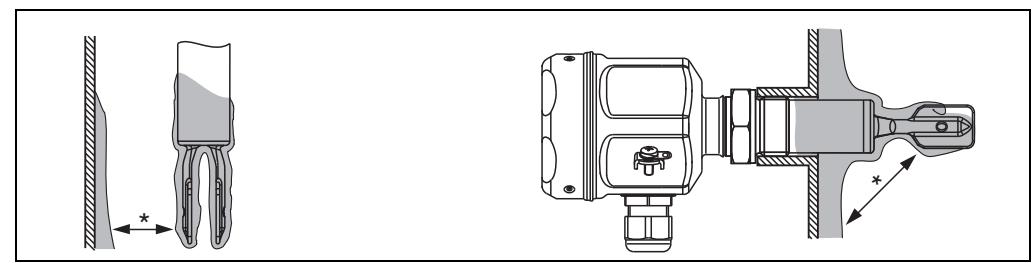


Vertical from above

Protruding into the tank from the side

**Mounting positions in the case of low viscosity up to 2000 mm<sup>2</sup>/s (cSt):**


\* Deburr the nozzle surfaces

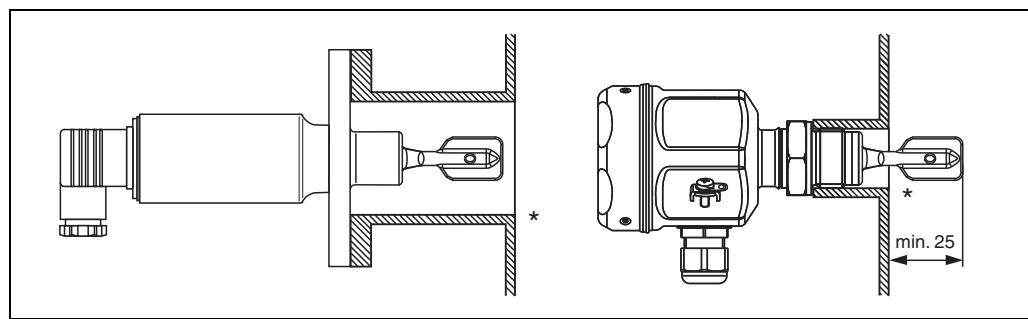

L00-FTL5xxxx-11-05-xx-en-003

**Mounting in piping from 2"**


Flow velocities up to 5 m/s for viscosity of 1 mm<sup>2</sup>/s (cSt) and density 1 g/cm<sup>3</sup> (SGU).  
(Check the function for other medium conditions.)

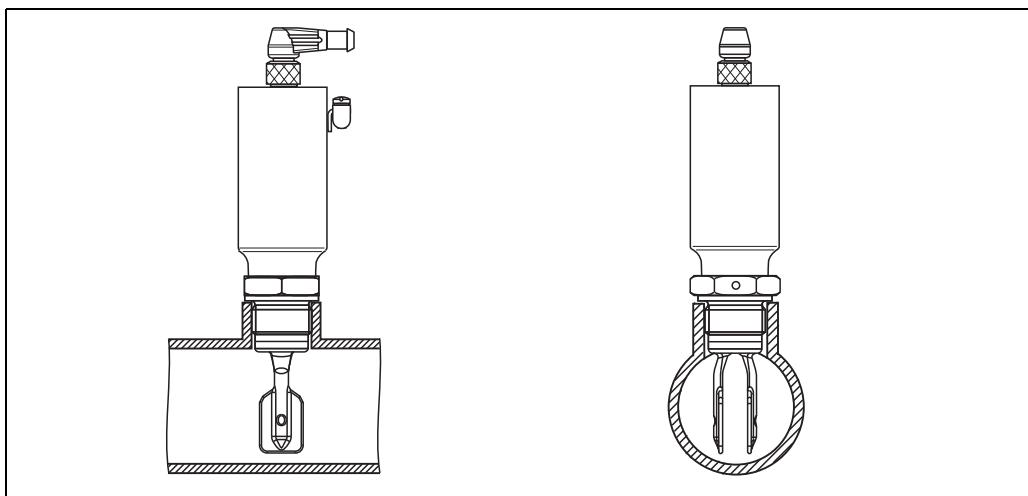

L00-FTL5xxxx-11-05-xx-xx-004


**Dynamic load**

Support the Liquiphant M FTL51(H) in the event of a severe dynamic load.

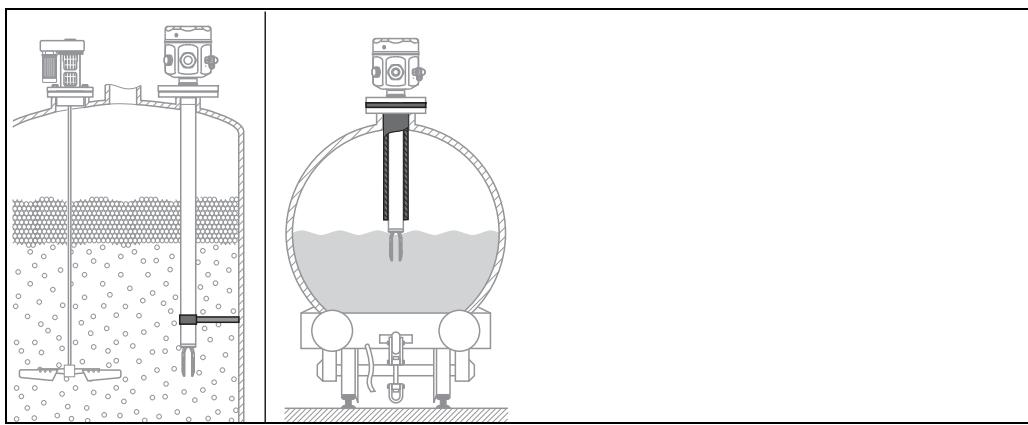

L00-FTL5xxxx-11-05-xx-xx-005

Ensure adequate space outside the tank for mounting, connection and configuration.

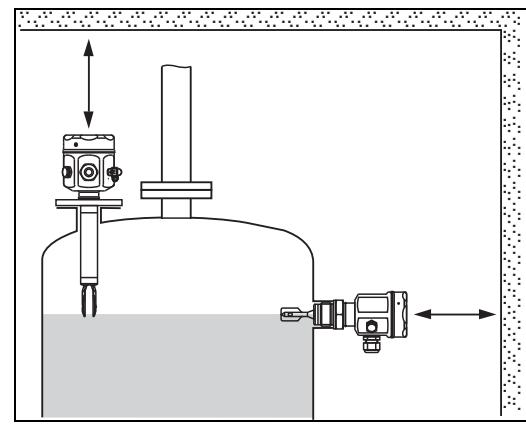


#### Orientation

- FTL50(H) and FTL51(H) with short pipe up to approx. 500 mm (19.7 in): any position
- FTL51(H) with long pipe: vertical

## Environment

#### Ambient temperature range

Permitted ambient temperature  $T_a$  at the housing depending on the medium temperature  $T_p$  in the tank:

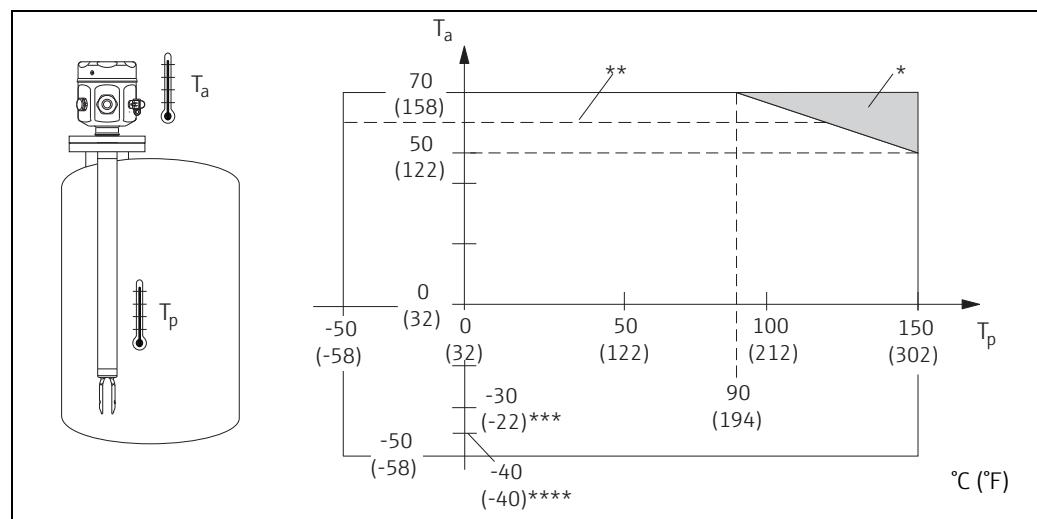

- \* Additional temperature range for devices with a temperature spacer or pressure-tight feedthrough.
- \*\* Maximum ambient temperature with FEL50D/FEL50A in hazardous areas.
- \*\*\* The following applies for devices with a compact housing according to version D3, E3:  $-30 \text{ }^\circ\text{C} \leq T_a \leq +70 \text{ }^\circ\text{C}$
- \*\*\*\* The following applies for the F16 housing:  $-40 \text{ }^\circ\text{C} \leq T_a \leq +70 \text{ }^\circ\text{C}$

#### Storage temperature

-50 to +80 °C (-58 to 176 °F)

#### Installation height as per IEC61010-1 Ed.3

Up to 2000 m (6600 ft) above sea level.

Can be extended up to 3000 m (9800 ft) above sea level if overvoltage protection is used, for example HAW562 or HAW569.

#### Climate class

Climate protection to IEC 68, Part 2-38, Fig. 2a

## Degree of protection

Types of housing	IP65	IP66*	IP67*	IP68*	IP69	NEMA type**
Compact housing with valve connector Pg11/NPT 1/2	X	-	-	-	-	-
Compact housing with 5 m (16 ft) cable tail	-	X	-	X	-	-
Compact housing with M12x1 connector (52010285) 316L (metal)	-	X	-	X	-	-
Compact housing with elbowed connector (52024216) / L= 5 m (16 ft), without integrated LEDs	-	X	-	X	X	-
Compact housing with elbowed connector (52018763) / L= 5 m (16 ft), with integrated LEDs	-	X	-	X	X	-
Polyester housing F16	-	X	X	-	-	4X
Stainless steel housing F15	-	X	X	-	-	4X
Aluminum housing F17	-	X	X	-	-	4X
Aluminum housing F13****	-	X	-	X***	-	4X/6P
Stainless steel housing F27	-	X	-	X	-	4X/6P
Aluminum housing T13 with separate connection compartment (Ex d)	-	X	-	X***	-	4X/6P

\* As per EN60529

\*\* As per NEMA 250

\*\*\* only with M20 cable entry or G1/2 thread

\*\*\*\* F13 housing only in conjunction with XP or Ex d approval

## Vibration resistance

As per IEC 68, parts 2-6 (10 to 55 Hz, 0.15 mm (0.01 in), 100 cycles)

In the event of increased vibrations, the following additional option is recommended: feature "060" version "P" 100 bar (1450 psi) process pressure.

## Electromagnetic compatibility

Interference emission to EN 61326, Electrical Equipment Class B


Interference immunity to EN 61326; Annex A (Industrial) and NAMUR Recommendation NE 21 (EMC)

## Medium conditions

**Medium temperature**  $-50$  to  $+150$  °C ( $-58$  to  $302$  °F); for exceptions, see "Process connections"

**Thermal shock**  $\leq 120$  °C/s ( $248$  °F/s)

**Medium pressure  $p_e$**

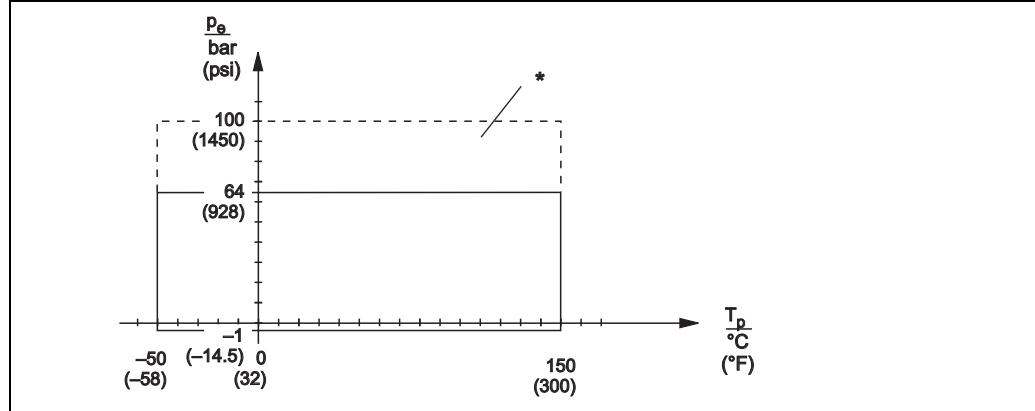

L00-FTL5xxxx-05-05-xx-xx-003

\* Permitted pressure rating when the "100 bar (1450 psi)" option is selected (see "Product structure FTL51", feature 060, from → 43).

See "Process connections" → 33 for exceptions.

Canadian CRN approval: Additional details on maximum pressure values are available in the download area of the product page at "www.endress.com".

Please refer to the standards listed for the permitted pressure values of the flanges at higher temperatures:

- pREN 1092-1: 2005  
With regard to their stability-temperature property, the materials 1.4435 and 1.4404 are identical and are grouped together in EN 1092-1 Tab. 18 under 13E0. The chemical composition of the two materials can be identical.
- ASME B 16.5 - 2013 Tab. 2-2.2 F316
- ASME B 16.5 - 2013 Tab. 2-3.8 N10276
- JIS B 2220

The lowest value from the derating curves of the device and selected flange applies in each case.

**Test pressure**

$p_e = 64$  bar (928 psi):

- $\leq 100$  bar (1450 psi) or 1.5 times the medium pressure  $p_e$
- Sensor burst pressure at 200 bar (2900 psi)

$p_e = 100$  bar (1450 psi):

- $\leq 150$  bar (2175 psi) or 1.5 times the medium pressure  $p_e$
- Sensor burst pressure at 400 bar (5800 psi)



Note!

The device function is restricted during pressure testing.

**State of aggregation**

Liquid

**Density**

0.7 g/cm<sup>3</sup> (SGU) = delivery status

0.5 g/cm<sup>3</sup>\* (SGU) can be adjusted via switches

\* Density settings for the compact housing on request

**Viscosity**

$\leq 10,000$  mm<sup>2</sup>/s (cSt)

**Solids content**

$\leq \phi 5$  mm (0.2 in)

**Lateral loading capacity**

$\leq 75$  Nm

## Mechanical construction



### Note!

2D and 3D drawings containing individual dimensions can be generated and downloaded in the Configurator on the product pages of the Liquiphant FTL5x at [www.endress.com](http://www.endress.com).


### Design

### Summary of all electrical and mechanical versions


#### Housing




L00-FTL5xxxx-03-05-xx-xx-019




L00-FTL5xxxx-03-05-xx-xx-001




L00-FTL5xxxx-03-05-xx-xx-002



L00-FTL5xxxx-03-05-xx-xx-031



L00-FTL5xxxx-03-05-xx-xx-033



L00-FTL5xxxx-03-05-xx-xx-004

#### Compact

Pipe housing (316L) F16  
Polyester (PBT)

#### F16

Polyester (PBT)

#### F15

Stainless steel (316L)  
Housing coated

#### F17

Aluminum  
Housing coated


#### F27

Stainless steel (316L)  
F13Aluminum  
(also for Ex d/XP),  
housing coated

#### T13

Aluminum with separate  
connection compartment  
(also Ex de and Ex d), housing  
coated

#### Plug-in electronic inserts to mount in the housing



L00-FTL5xxxx-03-05-xx-xx-000

FEL51\*: Two-wire AC connection

FEL52\*: Three-wire DC connection PNP

FEL54: Universal current connection, 2 relay outputs

FEL55: Output 16/8 mA for separate switching unit

FEL56: Output 0.6 to 1.0 / 2.2 to 2.8 mA for separate switching unit (NAMUR)

FEL58\*: Output 2.2 to 3.5 / 0.6 to 1.0 mA for separate switching unit (NAMUR)

FEL57: Output 150/50 Hz, PFM, for separate switching unit (Nivotester)

FEL50A: Digital communication PROFIBUS PA

FEL50D: Pulse output for Density Computer FML621

\* Electronics also available as compact housing. The electronics cannot be exchanged!

If the housing is ordered with a cable gland: the cable gland is ready-mounted upon delivery. A second cable gland is included in conjunction with FEL54.


#### Temperature spacer and pressure-tight feedthrough

##### Temperature spacer (optional)


Provides sealed insulation for the vessel and  
normal ambient temperatures for the housing.

##### Pressure-tight feedthrough (optional)


Protects the housing from pressures up to 100 bar  
(1450 psi) if the sensor is damaged. Provides  
sealed insulation for the vessel and normal  
ambient temperatures for the housing.

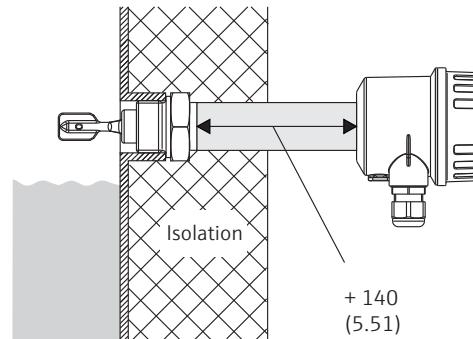


L00-FTL5xxxx-06-05-xx-xx-091

*Process connections*


L00-FTL5xxxx-03-05-xx-xx-006



L00-FTL5xxxx-03-05-xx-xx-007



L00-FTL5xxxx-03-05-xx-xx-008



L00-FTL5xxxx-03-05-xx-xx-009

G 3/4, DIN ISO 228/I  
R 3/4, EN10226  
NPT 3/4, ASME B 1.20.1  
(AF 32)


G 1, DIN ISO 228/I  
R 1, EN10226  
NPT 1, ASME B 1.20.1  
(AF 41)

Diverse  
hygienic and  
aseptic  
connections

Flanges as per DIN,  
ASME,  
JIS  
from DN 25 / 1"

*Sensors*

Compact, with extension pipe up to 3 m (up to 6 m on request)  
or special "length L II" (see → 33ff.)



L00-FTL5xxxx-03-05-xx-xx-018

 $p_e$  = bar/psi


64/928	64/928	64/928
100/1450	100/1450	

**Dimensions**


Dimensions in mm (in)!

**Housing FTL50(H), FTL51(H) with sensor FTL50(H)**

*Compact housing, primarily for  
hygiene applications*

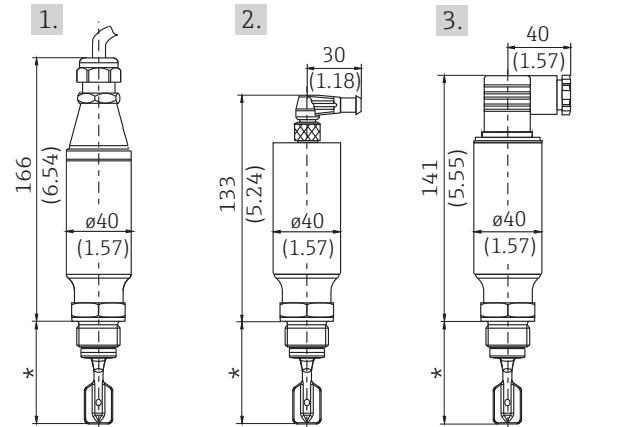


1. 5 m cable
2. M12 connector
3. Pg11/NPT 1/2 connector

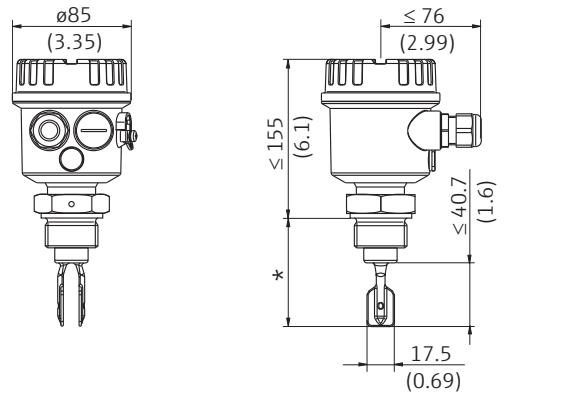*Polyester housing F16*


L00-FTL5xxxx-06-05-xx-xx-086

*F15 stainless steel housing primarily for hygiene applications*

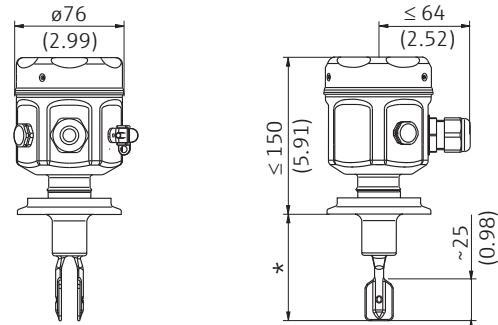

L00-FTL5xxxx-06-05-xx-xx-087


*Aluminum housing F17*

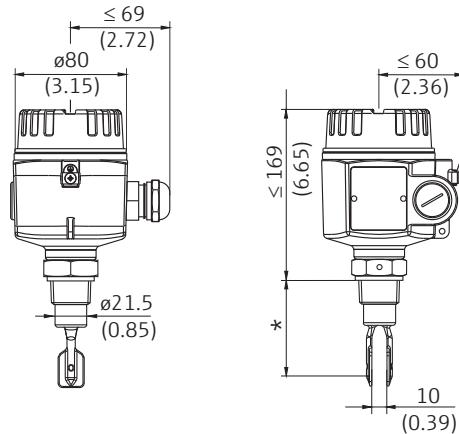

L00-FTL5xxxx-06-05-xx-xx-088

*Stainless steel housing (316L) F27*


*Aluminum housing F13*

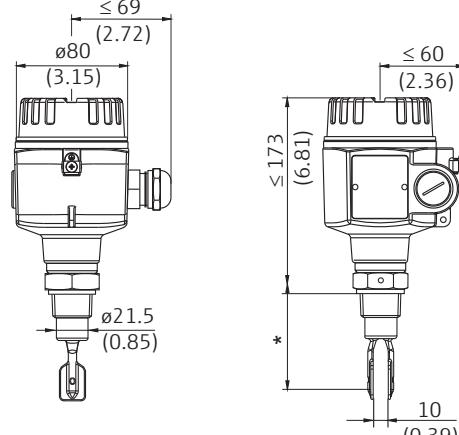

L00-FTL5xxxx-06-05-xx-xx-089

*Aluminum housing T13*

*with separate connection compartment*

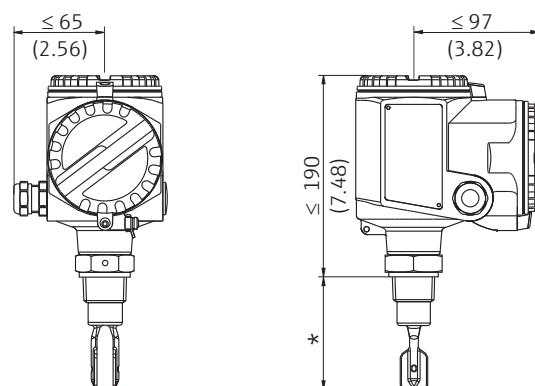

L00-FTL5xxxx-06-05-xx-xx-090

\* See "Process connections"









## Note!




The switch points of the LiquiphantM are at other positions to those of the previous version LiquiphantII.

## Process connections for FTL50(H) and FTL51(H)

Process connection		Dimensions	Accessories	Pressure Temperature
<b>G 3/4</b> DIN ISO 228/1 with defined thread start; Flat seal to DIN 7603: supplied	GQ2 GQ6			$\leq 100$ bar / only FTL51 ( $\leq 1450$ psi) $\leq 150$ °C (302 °F)
<b>G 3/4</b> DIN ISO 228/1 with defined thread start for flush-mounted installation in weld-in adapter	GQ2 GQ6		<b>Weld-in adapter</b> (with defined thread start) with silicone O-ring only FTL50, FTL50H  See "Accessories" In conformity with FDA*	$\leq 25$ bar (363 psi) $\leq 150$ °C (302 °F) $\leq 40$ bar (580 psi) $\leq 100$ °C (212 °F)
<b>G 1</b> DIN ISO 228/1 Flat seal to DIN 7603: supplied	GR2 GR6			$\leq 100$ bar / only FTL51 (1450 psi) $\leq 150$ °C (302 °F)
<b>G 1</b> DIN ISO 228/1 with defined thread start  With seal surface for flush-mounted installation in weld-in adapter	GW2		<b>Weld-in adapter</b> (with defined thread start) with silicone O-ring  See "Accessories" In conformity with FDA*	$\leq 25$ bar (363 psi) $\leq 150$ °C (302 °F) $\leq 40$ bar (580 psi) $\leq 100$ °C (212 °F)
<b>NPT 3/4</b> ASME B 1.20.1 or <b>R 3/4</b> DIN/EN 10226	GM2 GM6  GE2 GE6			$\leq 100$ bar / only FTL51 (1450 psi) $\leq 150$ °C (302 °F)
<b>NPT1</b> ASME B 1.20.1 or <b>R 1</b> DIN/EN 10226	GN2 GN6  GF2 GF6			$\leq 100$ bar / only FTL51 (1450 psi) $\leq 150$ °C (302 °F)

\* FDA-compliant material in accordance with 21 CFR Part 177.2600 (silicone)

Process connection		Dimensions	Accessories	Pressure Temperature
<b>Flanges</b> ASME B 16.5 EN 1092-1 (DIN 2527 B) JIS B2220	A## B## C## F## N## K##	 L00-FTL5xxxx-06-05-xx-xx-098	Seal depending on design installed on site	See nominal pressure of flange, however ≤ 100 bar (1450 psi) (only FTL51) ≤ 150 °C (302 °F)
			For higher chemical-resistance, AlloyC22-plated flanges are available. The flange carrier material is made of 316L and is welded with a 2 to 3 mm (0.08 to 0.12 in) thick AlloyC22 disk.	
<b>Tri-Clamp</b> ISO 2852 DN25-38 (1 to 1 ½") DIN 32676 DN25-40 ø D = 50.5 mm (1.99 in)	TC2 TE2	 L00-FTL5xxxx-06-05-xx-xx-099	Clamping ring and front seal installed on site**	≤ 25 bar (363 psi) ≤ 150 °C (302 °F)
ISO 2852 DN40-51 (2") DIN 32676 DN50 ø D = 64.0 mm (2.52 in)			Mounting with NA connector only in conjunction with T13, F13 and compact housing. Other housings on request.	
<b>Threaded pipe joint</b> DN 32 DN 40 DN 50 DIN 11851  with thread adapter nut	MA2 MC2 ME2	 L00-FTL5xxxx-06-05-xx-xx-100	Sealing ring with collar, installed on site**	DN 32, DN 40: ≤ 40 bar (580 psi) up to 100 °C (212 °F) ≤ 25 bar (363 psi) up to 140 °C (284 °F)  DN 50: ≤ 25 bar (363 psi) ≤ 140 °C (284 °F)
<b>Flush-mounted for weld-in adapter</b> Factory standard Endress+Hauser with silicone seal and thread adapter nut: supplied	EE2	 L00-FTL5xxxx-06-05-xx-xx-101	<b>Weld-in adapter</b> (fork can be positioned)  See "Accessories" In conformity with FDA*	≤ 40 bar (580 psi) ≤ 100 °C (212 °F)  ≤ 25 bar (363 psi) ≤ 150 °C (302 °F)
<b>Aseptic</b> DN 50 DIN 11864-1 Form A for pipe DIN 11850 with thread adapter nut	HE2	 L00-FTL5xxxx-06-05-xx-xx-102	sealing ring installed on site**	≤ 25 bar (363 psi) ≤ 140 °C (284 °F)
<b>DRD</b> With clamped flange	PE2	 L00-FTL5xxxx-06-05-xx-xx-103	Welding flange with PTFE flat seal (fork can be positioned)  See "Accessories" (or installed on site)**  In conformity with FDA*	≤ 40 bar (580 psi) ≤ 100 °C (212 °F)  ≤ 25 bar (363 psi) ≤ 150 °C (302 °F)

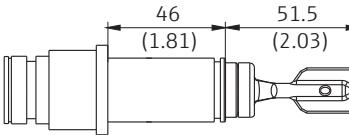Process connection	Dimensions	Accessories	Pressure Temperature
<p>* FDA-compliant material in accordance with 21 CFR Part 177/2600 (silicone), 21 CFR Part 177.1550 (PTFE)  ** The maximum temperature and the maximum pressure are dependent on the clamping ring used and the seal used. The lowest value applies in each case.</p>			
<p><b>SMS</b>  2"  (DN 51)  with thread adapter  nut</p>			
UE2		sealing ring installed on site**	≤ 25 bar (363 psi) ≤ 140 °C (284 °F)
<b>Varivent</b> for piping ≥ DN 65 ≥ O.D. 3" ≥ I.P.S. 3"	WE2		Clamping ring and O-ring seal, installed on site**  However, see specification as per Tuchenhagen VARIVENT-Inline housing: ≤ 25 bar (363 psi) ≤ 150 °C (302 °F)
<b>Ingold fitting</b>  DN 25 Fitting length 46 mm (2.52 in)  Thread adapter nut G 1 1/4  with O-ring seal, EPDM (FDA- compliant, USP Class VI*)	TT2		≤ 16 bar (232 psi) ≤ 150 °C (302 °F)
<p>* FDA-compliant material in accordance with 21 CFR Part 177/2600 (EPDM)  ** The maximum temperature and the maximum pressure are dependent on the clamping ring used and the seal used. The lowest value applies in each case.</p>			

Sensor length L for FTL51 and FTL51H, depending on process connection

Thread: G 3/4 G 1	Thread: NPT 3/4 NPT1 R 3/4 R 1	Flanges and flange-like process connections
LO0-FTL5xxxx-06-05-xx-xx-107	LO0-FTL5xxxx-06-05-xx-xx-017	LO0-FTL5xxxx-06-05-xx-xx-018
From seal surface of thread adapter	From lower edge of thread	
Customized length L:		
<ul style="list-style-type: none"> <li>■ 148 mm to 3000 mm (6 to 115 in); special version (TSP) on request up to 6000 mm (235 in)</li> <li>■ Length tolerances L: &lt; 1 m (-5 mm), 1 to 3 m (-10 mm) / &lt; 3.3 ft (-0.2 in), 3.3 to 9.8 ft (-0.39 in)</li> </ul>		



#### Note!

The switch points of the Liquiphant M are at other positions to those of the previous version Liquiphant II.

#### Special length "L II":

With vertical mounting from above approximately the same switch point as for the Liquiphant II FTL360, FTL365, FDL30, FDL35

#### "L II" depends on process connection:

L = 115 mm (4.53 in) for flanges and flange-like process connections such as Clamp, DRD...

L = 99 mm (3.9 in) for threads NPT and R (BSPT)

L = 118 mm (4.65 in) for threads G1 (BSP 1)

L = 115 mm (4.53 in) for threads G 3/4 (BSP 3/4)

L = 104 mm (4.09 in) for flush-mounted 1" (G1" Endress+Hauser welding bosses)

## Weights

See "Ordering information" → 43ff

## Materials and surfaces

Material specifications as per AISI and DIN-EN.

### Parts in contact with process

- Process connection and extension pipe:
  - FTL5x → 316L (1.4404 or 1.4435) optional 2.4602 (AlloyC22)
  - FTL5xH → 316L (1.4435)
- Tuning fork: 316L (1.4435) optional 2.4602 (AlloyC22)
- Flanges:
  - ASME: 316/316L
  - EN: 316L (1.4404)
  - JIS: 316L (1.4404)
- Flange plating: AlloyC22 (2.4602)
- Flat seal for process connection G 3/4 or G 1: elastomer fiber, asbestos-free

### Surface roughness

Choice of mechanically polished surface roughness (version → probe length → type):

- Ra < 1.5 µm (59.1 µin), with EHEDG approval

- Ra < 0.3 µm (11.8 µin), 3-A and EHEDG approval and CoC-ASME-BPE



Note!

The surface is electropolished if the additional option "B" (CoC - ASME BPE) is selected in addition to surface roughness quality Ra < 0.3 µm (11.8 µin). The surface roughness is then: Ra < 0.38 µm (15.0 µin). With this combination, the wetted parts are made of 316L (1.4435) in accordance with BN2 (delta-ferrite content < 1 %).

#### Parts with no process contact

- Tuning fork/housing seal: EPDM
- Temperature spacer: 316 L (1.4435)
- Pressure-tight feedthrough: 316L (1.4435)
- Ground terminal on housing (external): 316L (1.4404)
- Cable glands
  - Housing F13, F15, F16, F17: polyamide (PA)
    - With B or C approval (→ 43 ordering information): nickel-plated brass
    - Housing F27: polyamide PA, with approval "B" or "C" 316L (1.4435)
    - Housing T13: nickel-plated brass
- Polyester housing F16: PBT-FR with PBT-FR cover or with PA12 transparent cover
  - Cover seal: EPDM
  - Nameplate glued: polyester film (PET)
  - Pressure compensation filter: PBT-GF20
- Stainless steel housing F15: 316L (1.4404)
  - Cover seal: silicone
  - Safety claw: 304 (1.4301)
  - Pressure compensation filter: PBT-GF20, PA
- Aluminum housing F17/F13: EN-AC-AlSi10Mg, plastic-coated
  - Nameplate: aluminum, anodized
  - Cover seal: EPDM
  - Safety claw: nickel-plated brass
  - Pressure compensation filter: silicone
- Stainless steel housing F27: 316L
  - Nameplate: 316L (1.4404)
  - Cover seal: FVMQ (optional: EPDM seal available as spare part)
  - Safety claw: 316L (1.4435)
- Aluminum housing T13: EN-AC-AlSi10Mg, plastic-coated,
  - Nameplate: aluminum, anodized
  - Cover seal: EPDM
  - Safety claw: nickel-plated brass
- Compact housing (valve connector or M12 connector): 316L (1.4435)

#### Process connections

- Parallel thread G 3/4, G 1 to DIN ISO 228/I with flat seal to DIN 7603
- Tapered thread R 3/4, R 1 to EN10226
- Tapered thread 3/4 -14 NPT, 1 - 11 1/2 NPT as per ASME B 1.20.1
- Flush-mounted installation with weld-in adapter to factory standard Endress+Hauser (G 3/4, G 1)
- Flush-mounted installation with weld-in adapter to factory standard Endress+Hauser (1"), sensor can be positioned
- Tri-Clamp 1 1/2", 2" to ISO 2852
- Threaded pipe joint DN 32, 40, 50 to DIN 11851
- Aseptic connection DN 50 to DIN 11864-1
  - Form A for pipe DIN 11850
- SMS connection 2" (DN 51)
- DRD flange
- Varivent® DN 50 (50/40) to factory standard Tuchenhagen
- Flanges: as per EN/DIN 1092-1 from DN 25, as per ASME B 16.5 from 1", as per JIS B2220 (RF)
- Ingold DN25 fitting length 46 mm (1.81 in) with thread adapter nut G1 1/4

Further details at Ordering information → 43.

## Human interface

### Electronic inserts

#### With FEL51, FEL52, FEL54, FEL55:

- 2 switches for safety mode and density change
- green LED to indicate operational status
- red LED to indicate the switching status, flashes in the event of corrosion damage on sensor or if the electronics are defective

#### With FEL56:

- 2 switches for safety mode and density change
- green LED flashes to indicate operational status
- red LED to indicate the switching status, flashes in the event of corrosion damage on sensor or if the electronics are defective

#### With FEL57:


- 2 switches for density change and Testing
- green LED to indicate operational status
- yellow LED to indicate the covered status, flashes in the event of corrosion damage on sensor or if the electronics are defective

#### With FEL58:

- 2 switches for safety mode and density change
- green LED
  - flashes quickly to indicate operational status,
  - flashes slowly in the event of corrosion damage to the sensor or if the electronics are defective
- yellow LED to indicate the switching status, Test key – breaks the cable connection

#### With FEL50A:


- 8 switches for configuring the device address
- green LED to indicate operational status, pulsing to indicate communication;
- yellow LED to indicate the switching status, flashes in the event of corrosion damage on sensor or if the electronics are defective

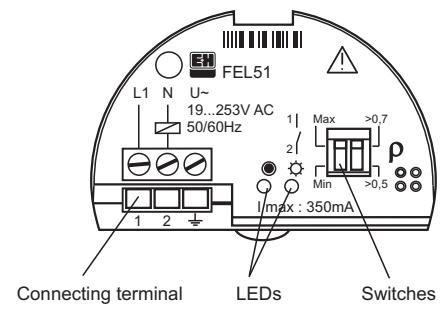


L00-FTL5xxxx-03-05-xx-en-001



L00-FTL5xxxx-03-05-xx-xx-013

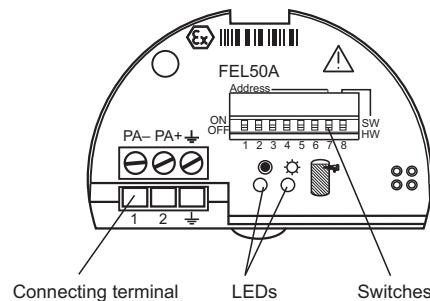

L00-FTL5xxxx-03-05-xx-en-002

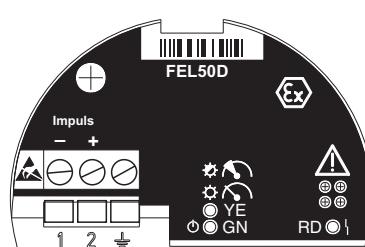

TI328Fxx004


### Compact housing

#### Function test with test magnet

*Versions AC, DC-PNP and NAMUR:*

During the test, the current state of the electronic switch is reversed.


Hold the test magnet against the marking on the nameplate: The switching status is changed.

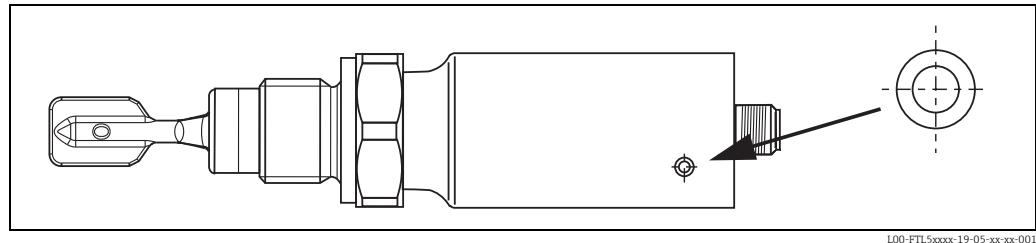

L00-FTL5xxxx-19-05-xx-xx-001

### Light signals

*Versions AC and DC-PNP with valve connector or cable tail*

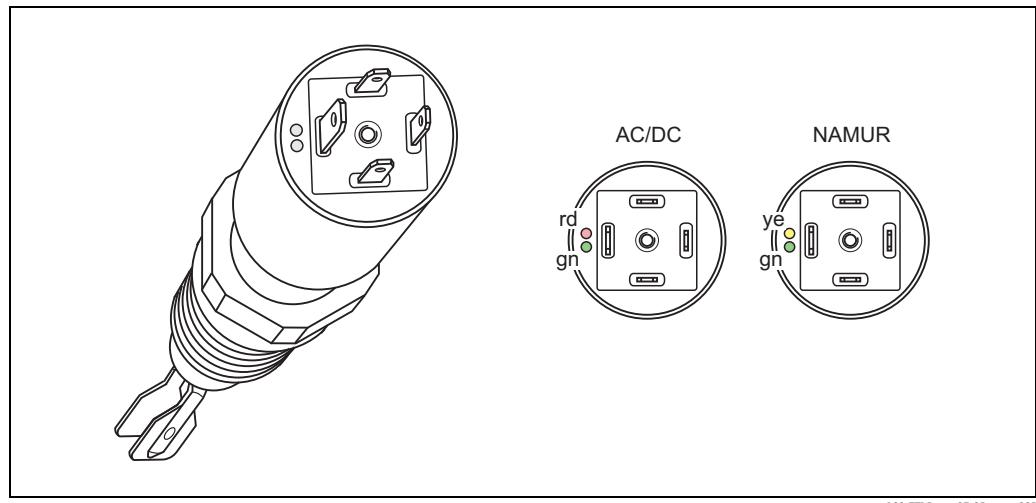

L00-FTL5xxxx-07-05-xx-xx-005

#### Green light (gn) lights up (AC/DC):

Liquiphant M is connected to the power supply and is operational.

#### Green light (gn) flashing (NAMUR):

Liquiphant M is connected to the power supply and is operational.

#### Red light (rd) lights up (AC/DC):

MAX application mode (overfill protection): sensor is immersed in liquid.

MIN application mode (dry running protection): sensor is not immersed in liquid.

#### Yellow light (ye) lights up (NAMUR):


MAX application mode (overfill protection): sensor is not immersed in liquid.

MIN application mode (dry running protection): sensor is immersed in liquid.

#### Red light (rd) flashing (AC/DC):

Liquiphant M has detected a fault.

*Version NAMUR and DC-PNP with M12x1 round connector 316L*

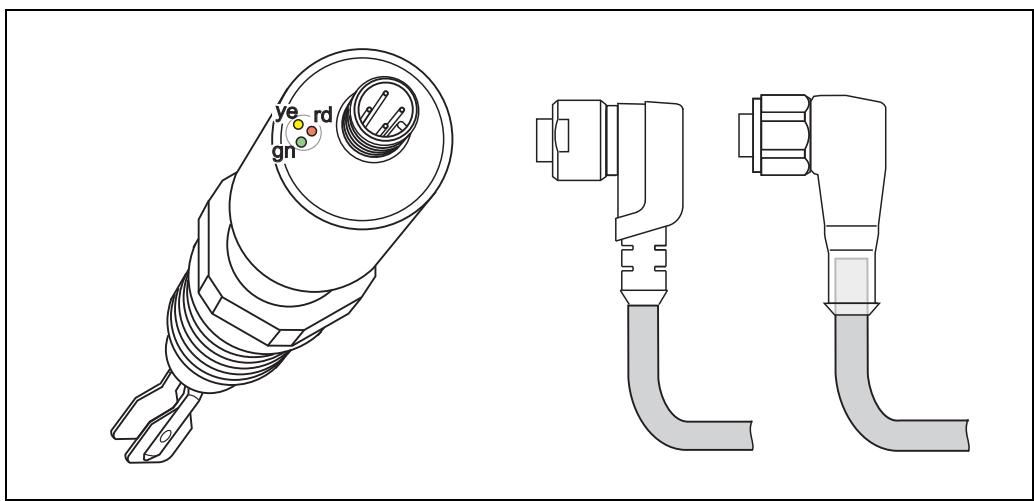

L00-FTL5xxxx-07-05-xx-xx-003

**Green light (gn) lights up (DC-PNP):**

Liquiphant M is connected to the power supply and is operational.

**Green light (gn) flashing with 1 Hz (NAMUR):**

Liquiphant M is connected to the power supply and is operational.

**Yellow light (ye) lights up (DC-PNP):**

Sensor is immersed in liquid.

**Yellow light (ye) lights up (NAMUR):**

MAX application mode (overfill protection): sensor is not immersed in liquid.  
MIN application mode (dry running protection): sensor is immersed in liquid.


**Red light (rd) flashing (DC-PNP):**

Liquiphant M has detected a fault.

**Green light (gn) flashing with 0.3 Hz (NAMUR):**

Liquiphant M has detected a fault.

*Version DC-PNP with M12x1 round connector 316L*

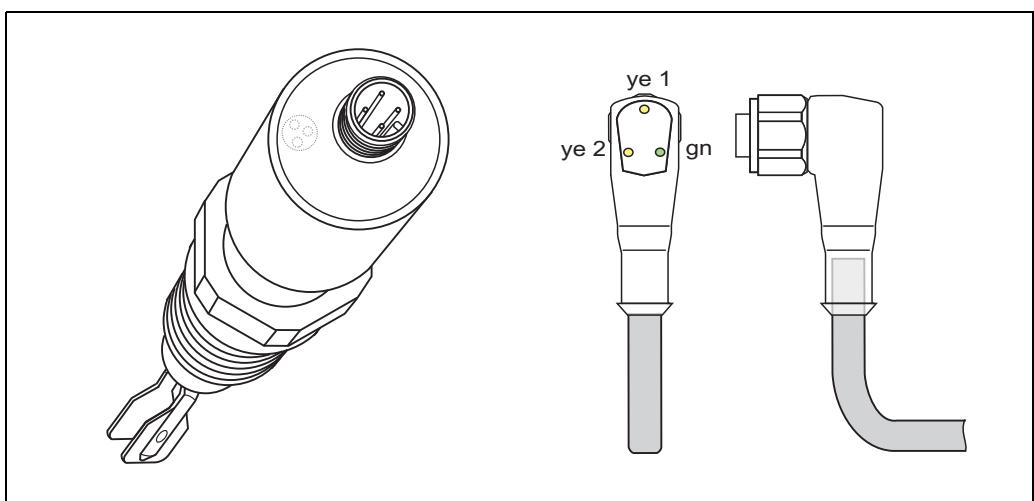

L00-FTL5xxxx-07-05-xx-xx-004

**Green light (gn) lights up:**

Liquiphant M is connected to the power supply and is operational.

**Yellow light (ye 1) lights up:**

MAX application mode (overfill protection): sensor is not immersed in liquid.

MIN application mode (dry running protection): sensor is not immersed in liquid.

**Yellow light (ye 2) lights up:**

MAX application mode (overfill protection): sensor is immersed in liquid.

MIN application mode (dry running protection): sensor is immersed in liquid.

**Green light (gn) lights up, both yellow lights (ye 1+2) do not light up:**

Liquiphant M has detected a fault.

<b>Operating concept</b>	Onsite configuration
--------------------------	----------------------

## Certificates and approvals

<b>CE mark</b>	The measuring system meets the legal requirements of the applicable EC Directives. These are listed in the corresponding EC Declaration of Conformity along with the standards applied. Endress+Hauser confirms successful testing of the device by affixing to it the CE mark.
----------------	---

<b>RoHS</b>	The measuring system complies with the substance restrictions of the EU Directive on the restriction of the use of certain hazardous substances 2011/65/EU (RoHS 2).
-------------	--

<b>RCM-tick mark</b>	The product or measuring system supplied complies with the regulations of the Australian Communications and Media Authority (ACMA) for network integrity, performance characteristics and health and safety requirements. The specifications for electromagnetic compatibility, in particular, are observed. The products bear the RCM-tick mark on their nameplate.
----------------------	--



A0029561

<b>EAC conformity</b>	The measuring system meets the legal requirements of the applicable EAC Directives. These are listed in the corresponding EAC Declaration of Conformity along with the standards applied. Endress+Hauser confirms successful testing of the device by affixing to it the EAC mark.
-----------------------	--

<b>CRN approval</b>	Versions with a CRN approval (Canadian Registration Number) are marked with a "*" in ordering information feature 20 "process connection" (s. Seite 43 ff.). CRN-approved devices are assigned the registration number CRN: OF10904.5CADD1 on the nameplate.
---------------------	--

<b>Pressure Equipment Directive 2014/68/EU (PED)</b>	<b>Pressure instruments with permitted pressure <math>\leq</math> 200 bar (2 900 psi)</b> Pressure instruments with permitted pressure $\leq$ 200 bar (2 900 psi) Pressure instruments with a flange and threaded boss that do not have a pressure-bearing housing do not fall within the scope of the Pressure Equipment Directive, irrespective of the maximum permitted pressure.
--	---

**Reason:**

According to Article 2, point 5 of EU Directive 2014/68/EU, pressure accessories are defined as "devices with an operational function and having pressure-bearing housings".

If a pressure instrument does not have a pressure-bearing housing (no identifiable pressure chamber of its own), there is no pressure accessory present within the meaning of the Directive.

**Note:**

A separate analysis must be performed for pressure instruments that are part of safety equipment designed to protect a pipe or vessel from exceeding allowable limits (safety accessory in accordance with Pressure Equipment Directive 2014/68/EU, Article 2, point 4).

**Process seal according to  
ANSI/ISA 12.27.01**

Practice in North America for the installation of process seals

Endress+Hauser devices are designed as either single seal or dual seal devices with an alarm in accordance with ANSI/ISA 12.27.01. This means that the user does not need to install an external secondary process seal in the thermowell which is required in ANSI/NFPA 70 (NEC) and CSA 22.1 (CEC). These devices comply with installation practice in North America and enable very safe, low-cost installation in pressurized applications with hazardous media.

Further information is provided in the Safety Instructions (XA) for the specific device → 58 ff.

Product	Type	Max. process pressure	Marking	Listing
Liquiphant M	FTL50-S/T##... FTL50-P/Q/R##...	64 bar (928 psi)	Single Seal	CSA/FM
	FTL51-S/T##... FTL51-P/Q/R##...	64/100 bar (928/1450 psi)	Single Seal	CSA/FM
	FTL50H-S/T##... FTL50H-P/Q/R##...	64 bar (928 psi)	Single Seal	CSA/FM
	FTL51H-S/T##... FTL51H-P/Q/R##...	64 bar (928 psi)	Single Seal	CSA/FM

**General approvals**

The following approvals are available for Liquiphant M FTL50H, FTL51H:

- EHEDG: certification (from TNO, The Netherlands), Report No. V99.394:
- 3A: 3A certificate (USA), Authorization no. 459: 74-06 Sensors and Sensor Fittings and Connections
- Certificate of Compliance as per ASME BPE-2012. (Order code: additional option = B)

Process connections	Order code	ASME BPE + CoC		
		Ra (µm)		
		<0.3	< 0.38	< 1.5
Thread ISO228 G3/4, 316L, installation Thread ISO228 G1, 316L, installation Accessories: weld-in adapter	GQ2 GW2	X	X	-
Tri-Clamp ISO2852 DN25-38 (1 to 1-1/2"), 316L Tri-Clamp ISO2852 DN40-51 (2"), 316L	TC2 TE2	X	X	X
DIN11851 DN32 PN25 slotted nut, 316L DIN11851 DN40 PN25 slotted nut, 316L DIN11851 DN50 PN25 slotted nut, 316L	MA2 MC2 ME2	X	X	X
Flush-mounted, 316L, installation Accessories, weld-in adapter	EE2	X	X	X
DIN11864-1 A DN50 pipe DIN11850, Slotted nut, 316L	HE2	X	X	X
DRD 65mm, 316L	PE2	X	-	-
SMS 2" PN25, 316L	UE2	X	X	X
Varivent N pipe DN65-162 PN10, 316L	WE2	X	X	X
Ingold fitting 25x46mm, 316L	TT2	-	-	X

**Warning!**

To avoid risk of contamination, install according to the "Hygienic Equipment Design Criteria (HDC)" as stated in the Subgroup Design Principles of the EHEDG, Doc. 8, July 1993.

The flow of liquid during cleaning is important and should be in compliance with the HDC.

**Note!**

- For CIP (Clean in Place) and SIP (Sterilize in Place) processes the pressure and temperature specifications of the process connections must be observed.

- Suitable fittings and seals must be used to ensure hygiene-compliant design according to 3A, EHEDG, ASME BPE etc.
- Surfaces with ASME-BPE option:  $R_a < 0.38 \mu\text{m}$  ( $< 15 \mu\text{in}$ ) electropolished and passivated or  $R_a < 1.5 \mu\text{m}$  ( $59 \mu\text{in}$ ) mechanically polished.

**Other certificates**

- Material certificate as per EN 10204/3.1 for all wetted parts NACE MR0175/MR0103, AD2000
- Leak detection system in conjunction with WHG approval  
Approval number: Z-65.40-446 (see also "Ordering information" s. Seite 43 ff.)
- TSE Certificate of Suitability  
The following applies to wetted device components:
  - They do not contain any materials derived from animals.
  - No additives or operating materials derived from animals are used in production or processing.

**Note!**

Wetted device components are listed in the "Mechanical construction" (→ 30 ff.) and "Ordering information" (→ 43 ff.) sections.

**Manufacturer declarations**

The following documents can be ordered together with the document, depending on the desired device configuration:

- FDA conformity
- TSE-free: Materials not derived from animals
- Regulation (EC) no. 2023/2006 (GMP)
- Regulation (EC) No. 1935/2004 materials in contact with food

The applicable European guidelines and standards can be found in the relevant EU Declarations of Conformity.

Regulation (EU) No. 10/2011: The regulation on plastic materials does not apply to the Liquiphant FTL5x, as the wetted materials are made exclusively of stainless steel.

The silicone seals supplied comply with BFR recommendation XV (commodities based on silicones from the Federal Institute for Risk Assessment - BFR), and the EPDM seals provided comply with BFR recommendation XXI (commodities based on natural and synthetic rubber).

**Use in hazardous zones**

Pay particular attention to the information provided in the documentation: Safety Instructions, Control Drawings etc. → 58

**ASME B 31.3**

Design and materials in accordance with ASME B31.3 The welding seals are through-penetration welded and comply with ASME Boiler and Pressure Vessel Code Section IX and EN ISO 15614-1.

**Pressure equipment directive**

The Pressure Equipment Directive 97/23/EC does not apply to the Liquiphant FTL5x, as it does not have a pressurized housing in accordance with Article 1, Paragraph 2.1.4 of the directive.

## Ordering information

Detailed ordering information is available from the following sources:

- In the Product Configurator on the Endress+Hauser website: [www.endress.com](http://www.endress.com) → Click "Corporate" → Select your country → Click "Products" → Select the product using the filters and search mask → Open the product page → The "Configuration" button to the right of the product image opens the Product Configurator.
- From your Endress+Hauser Sales Center: [www.addresses.endress.com](http://www.addresses.endress.com)

**Note!**

Product Configurator - the tool for individual product configuration

- Up-to-the-minute configuration data
- Depending on the device: direct input of information specific to measuring point, such as measuring range or operating language
- Automatic verification of exclusion criteria
- Automatic creation of the order code and its breakdown in PDF or Excel output format
- Ability to order directly from the Endress+Hauser online shop

**Note!**

Versions that are mutually exclusive are not indicated in this table.

**Product structure for  
Liquiphant M FTL50, FTL51**

<b>Design</b>		<b>Basic weight</b>				
FTL50	Compact			0.6 kg		
FTL51	With extension pipe			0.6 kg		
10	<b>Approval:</b>					
	A Non-hazardous area B ATEX II 3G Ex nC IIC T6, WHG, ATEX II 3D Ex tc IIIC T85°C, NEPSI II 3G Ex nC IIC T6 C ATEX II 3G Ex nA IIC T6, WHG, ATEX II 3D Ex tc IIIC T85°C, NEPSI II 3G Ex nA IIC T6 D Non-hazardous area, WHG E ATEX II 1/2G Ex de IIC T6, WHG F ATEX II 1/2GD Ex ia IIC T6, WHG/IECEx G ATEX II 1/2GD Ex ia IIC T6/IECEx Zone0/1 H ATEX II 1G Ex ia IIC T6 I ATEX II 1/2G Ex de IIC T6/IECEx Zone0/1 J ATEX II 1G Ex ia IIC T6, WHG K ATEX II 1/2G Ex d IIC T6/IECEx Zone0/1 L ATEX II 1/2G Ex d IIC T6, WHG M NEPSI Ex ia IIC T6 N NEPSI Ex d IIC T6 P FM IS Cl.I,II,III Div.1 Gr.A-G, Zone 0,1,2,20,21,22 Q FM XP Cl.I,II,III Div.1 Gr.B-G, Gr.A-G if E5 housing selected, Zone 1,2 R FM NI Cl.I Div.2 Gr.A-D, Zone 0,1,2,20,21,22 S CSA C/US Cl I,II,III Div.1 Gr.A-G, Zone 0,1,2 T CSA C/US XP Cl I,II,III Div.1 Gr.A-G, Zone 1,2 U CSA C/US General Purpose V TIIS Ex ia IIC T3 W TIIS Ex d IIB T3 7 TIIS Ex d IIC T3 8 TIIS Ex d IIC T6 1 INMETRO Ex ia IIC T6 Ga/Gb 2 INMETRO Ex d IIC T6 Ga/Gb 3 INMETRO Ex de IIC T6 Ga/Gb Y Special version, TSP-No. to be spec.					
20	<b>Process connection:</b>			<b>Additional weight</b>		
	Note! For 100 bar (1450 psi) process pressure, select the appropriate option under "Additional option"					
	GQ2	G ¾	316L	Thread ISO 228		
		Installation > accessories: weld-in adapter				
	GQ6	G ¾	AlloyC22	Thread ISO 228		
	GR2	G 1	316L	Thread ISO 228		
	GR6	G 1	AlloyC22	Thread ISO 228		
	GW2*	G 1	316L	Thread ISO 228		
		Installation > accessories: weld-in adapter				
	GM2*	NPT ¾	316L	Thread ASME		
	GM6	NPT ¾	AlloyC22	Thread ASME		
	GN2*	NPT1	316L	Thread ASME		
	GN6	NPT1	AlloyC22	Thread ASME		
	GE2	R ¾	316L	Thread EN10226		
	GE6	R ¾	AlloyC22	Thread EN10226		
	GF2	R 1	316L	Thread EN10226		
	GF6	R 1	AlloyC22	Thread EN10226		
	BA2	DN32	PN6 A	316L	Flange EN 1092-1 (DIN 2527 B)	1.2 kg
	BB2	DN32	PN25/40 A	316L	Flange EN 1092-1 (DIN 2527 B)	2.0 kg
	BC2	DN40	PN6 A	316L	Flange EN 1092-1 (DIN 2527 B)	1.4 kg
	BD2	DN40	PN25/40 A	316L	Flange EN 1092-1 (DIN 2527 B)	2.4 kg
	BE2	DN50	PN6 A	316L	Flange EN 1092-1 (DIN 2527 B)	1.6 kg
	BG2	DN50	PN25/40 A	316L	Flange EN 1092-1 (DIN 2527 B)	3.2 kg
	BH2	DN65	PN6 A	316L	Flange EN 1092-1 (DIN 2527 B)	2.4 kg
	BJ2	DN50	PN100 A	316L	(FTL51)	Flange EN 1092-1 (DIN 2527 B)

20	Process connection:					Additional weight
	BK2	DN65	PN25/40 A	316L	Flange EN 1092-1 (DIN 2527 B)	4.3 kg
	BM2	DN80	PN10/16 A	316L	Flange EN 1092-1 (DIN 2527 B)	4.8 kg
	BN2	DN80	PN25/40 A	316L	Flange EN 1092-1 (DIN 2527 B)	5.9 kg
	BQ2	DN100	PN10/16 A	316L	Flange EN 1092-1 (DIN 2527 B)	5.6 kg
	BR2	DN100	PN25/40 A	316L	Flange EN 1092-1 (DIN 2527 B)	7.5 kg
	B12	DN80	PN100 A	316L (FTL51)	Flange EN 1092-1 (DIN 2527 B)	
	B82	DN25	PN25/40 A	316L	Flange EN 1092-1 (DIN 2527 B)	1.4 kg
	CA2	DN32	PN6 B1	316L	Flange EN 1092-1 (DIN 2527 C)	1.1 kg
	CA6	DN32	PN6 B1	AlloyC22 >316L	Flange EN 1092-1 (DIN 2527)	1.1 kg
	CE2	DN50	PN6 B1	316L	Flange EN 1092-1 (DIN 2527 C)	1.5 kg
	CE6	DN50	PN6 B1	AlloyC22 >316L	Flange EN 1092-1 (DIN 2527)	1.5 kg
	CG2	DN50	PN25/40 B1	316L	Flange EN 1092-1 (DIN 2527 C)	2.9 kg
	CG6	DN50	PN25/40 B1	AlloyC22 >316L	Flange EN 1092-1 (DIN 2527)	2.9 kg
	CJ2	DN50	PN100 B2	316L (FTL51)	Flange EN 1092-1 (DIN 2527)	
	CN2	DN80	PN25/40 B1	316L	Flange EN 1092-1 (DIN 2527 C)	5.2 kg
	CN6	DN80	PN25/40 B1	AlloyC22 >316L	Flange EN 1092-1 (DIN 2527)	5.2 kg
	CQ2	DN100	PN10/16 B1	316L	Flange EN 1092-1 (DIN 2527 C)	5.3 kg
	CQ6	DN100	PN10/16 B1	AlloyC22 >316L	Flange EN 1092-1 (DIN 2527)	5.3 kg
	C12	DN80	PN100 B2	316L (FTL51)	Flange EN 1092-1 (DIN 2527)	
	C82	DN25	PN25/40 B1	316L	Flange EN 1092-1 (DIN 2527 C)	1.3 kg
	C86	DN25	PN25/40 B1	AlloyC22 >316L	Flange EN 1092-1 (DIN 2527)	1.3 kg
	DG2	DN50	PN40 B1	316L	Flange EN 1092-1 (DIN 2526 D)	
	DN2	DN80	PN40 B1	316L	Flange EN 1092-1 (DIN 2526 D)	
	D82	DN25	PN40 B1	316L	Flange EN 1092-1 (DIN 2526 D)	
	EG2	DN50	PN25/40 E	316L	Flange EN 1092-1	2.6 kg
	FG2	DN50	PN40 C	316L	Flange EN 1092-1 (DIN 2512 F)	2.6 kg
	NG2	DN50	PN40 D	316L	Flange EN 1092-1 (DIN 2512 N)	2.9 kg
	AA2*	1 1/4"	150 lbs	RF 316/316L	Flange ASME B16.5	1.2 kg
	AB2*	1 1/4"	300 lbs	RF 316/316L (FTL51)	Flange ASME B16.5	2.0 kg
	AC2*	1 1/2"	150 lbs	RF 316/316L	Flange ASME B16.5	1.5 kg
	AD2*	1 1/2"	300 lbs	RF 316/316L (FTL51)	Flange ASME B16.5	2.7 kg
	AE2*	2"	150 lbs	RF 316/316L	Flange ASME B16.5	2.4 kg
	AE6	2"	150 lbs	RF AlloyC22 >316/316L	Flange ASME B16.5	2.4 kg
	AF2*	2"	300 lbs	RF 316/316L	Flange ASME B16.5	3.2 kg
	AG2*	2"	600 lbs	RF 316/316L (FTL51)	Flange ASME B16.5	4.2 kg
	AJ2*	2 1/2"	300 lbs	RF 316/316L (FTL51)	Flange ASME B16.5	4.8 kg
	AL2*	3"	150 lbs	RF 316/316L	Flange ASME B16.5	4.9 kg
	AM2*	3"	300 lbs	RF 316/316L (FTL51)	Flange ASME B16.5	6.8 kg
	AM6	3"	300 lbs	RF AlloyC22 >316/316L	Flange ASME B16.5	6.8 kg
	AN2*	3"	600 lbs	RF 316/316L (FTL51)	Flange ASME B16.5	
	AP2*	4"	150 lbs	RF 316/316L	Flange ASME B16.5	7.0 kg
	AQ2*	4"	300 lbs	RF 316/316L (FTL51)	Flange ASME B16.5	11.5 kg
	AQ6	4"	300 lbs	RF AlloyC22 >316/316L	Flange ASME B16.5	11.5 kg
	AR2*	4"	600 lbs	RF 316/316L (FTL51)	Flange ASME B16.5	17.3 kg
	A82*	1"	150 lbs	RF 316/316L	Flange ASME B16.5	1.0 kg
	KA2	10 K 25 A		RF 316L	Flange JIS B2220	
	KC2	10 K 40 A		RF 316L	Flange JIS B2220	

20	Process connection:					Additional weight
	KE2	10 K 50 A	RF	316L	Flange JIS B2220	1.7 kg
	KE6	10 K 50 A	RF	AlloyC22 >316L	Flange JIS B2220	1.7 kg
	KL2	10 K 80 A	RF	316L	Flange JIS B2220	
	KP2	10 K 100 A	RF	316L	Flange JIS B2220	
	TC2*	DN25-38 (1 to 1½")		316L	ISO 2852 Tri-Clamp	
	TE2*	DN40-51 (2")		316L	ISO 2852 Tri-Clamp	0.1 kg
	YY9	Special version				
	* With CRN approval.					
30	Probe length; Type:					
	FTL50					
	AA	Compact;		Ra <3.2 µm/126 µin		
	IA	Compact;		Temperature spacer		0.6 kg
	QA	Compact;		Pressure-tight feedthrough		0.7 kg
	FTL51					
	BB	..... mm;	316L**	Ra <3.2 µm/126 µin		
	BE	..... mm;	Alloy**	Ra <3.2 µm/126 µin		
	CB	..... inch;	316L**	Ra <3.2 µm/126 µin		
	CE	..... inch;	Alloy**	Ra <3.2 µm/126 µin		2.3 kg/100 in
	DB	Length: type II*;	316L	Ra <3.2 µm/126 µin		0.1 kg
	DE	Length: type II*;	Alloy	Ra <3.2 µm/126 µin		0.1 kg
	JB	..... mm;	316L**	+ Temperature spacer		0.9 kg/m +0.6 kg
	JE	..... mm;	Alloy**	+ Temperature spacer		0.9 kg/m +0.6 kg
	KB	..... inch;	316L**	+ Temperature spacer		2.3 kg/100 in +0.6 kg
	KE	..... inch;	Alloy**	+ Temperature spacer		2.3 kg/100 in +0.6 kg
	LB	Length: type II*;	316L	+ Temperature spacer		0.1 kg +0.6 kg
	LE	Length: type II*;	Alloy	+ Temperature spacer		0.1 kg +0.6 kg
	RB	..... mm;	316L**	+ Pressure-tight feedthrough		0.9 kg/m +0.7 kg
	RE	..... mm;	Alloy**	+ Pressure-tight feedthrough		0.9 kg/m +0.7 kg
	SB	..... inch;	316L**	+ Pressure-tight feedthrough		2.3 kg/100 in +0.7 kg
	SE	..... inch;	Alloy**	+ Pressure-tight feedthrough		2.3 kg/100 in +0.7 kg
	TB	Length: type II*;	316L	+ Pressure-tight feedthrough		0.1 kg +0.7 kg
	TE	Length: type II*;	Alloy	+ Pressure-tight feedthrough		0.1 kg +0.7 kg
	YY	Special version				
	*) If replacing devices: when vertically mounting a Liquiphant <b>M</b> FTL51 with length II the switch point is at the same height as for a Liquiphant <b>II</b> FTL360, FTL365, FDL30, FDL35. See also Seite 36 "L II" depends on process connection.					
	**) Order 3001 to 6000 mm (116 to 235 in) via yy					
40	Electronics; output:					
	A	FEL50A	PROFIBUS PA			
	D	FEL50D	Density/concentration without WHG approval (Germany)			
	1	FEL51*	2-wire,	AC 19 to 253 V		
	2	FEL52*	3-wire PNP,	DC 10 to 55 V		
	4	FEL54	Relay DPDT,	AC 19 to 253 V, DC 19 to 55 V		
	5	FEL55	8/16 mA,	DC 11 to 36 V		
	6	FEL56	NAMUR (L-H signal)			
	7	FEL57	2-wire PFM			
	8	FEL58*	NAMUR + test keys (H-L signal)			
	9	Special version				
	*) Also available in compact housing					
50	Housing; cable entry:					
	C3	Compact 316L	IP66/68;	Cable 5 m		
	D3	Compact 316L	IP65;	Plug Pg11		ISO4400
	E1	F27 316L	NEMA 4X/6P;	Thread NPT ¾		

<b>50</b>					<b>Housing; cable entry:</b>
			E3	Compact 316L Hygiene	NEMA4X; IP66/68;
			N3	Compact 316L Hygiene	M12 connector
			E4	F16 Polyester	NEMA4X;
			E5	F13 Alu F17 Alu	NEMA4X/6P; NEMA4X
			E6	F15 316L hygiene	NEMA4X;
			E7	T13 Alu	NEMA4X/6P;
				Separate connection compartment	
			F1	F27 316L	IP66/68
			F4	F16 Polyester	IP66/67;
			F5	F13 Alu F17 Alu	IP66/68; IP66/67;
			F6	F15 316L Hygiene	IP66/67;
			F7	T13 Alu	coated IP66/68; thread G 1/2
				Separate connection compartment	
			G1	F27 316L	IP66/68;
				Ex d > M20 thread	M20 threaded joint
			G4	F16 Polyester	IP66/67;
			G5	F13 Alu F17 Alu	IP66/68; IP66/67;
					Ex d > thread M20
			G6	F15 316L Hygiene	IP66/67;
			G7	T13 Alu	coated IP66/68;
				Separate connection compartment	Ex d > thread M20
			N4	F16 Polyester	IP66/67;
			N5	F13 Alu F17 Alu	IP66/68; IP66/67;
			N6	F15 316L hygiene	IP66/67;
			Y9	Special version	M12 connector
<b>60</b>					<b>Additional option</b>
			A	Basic version	
			B	PWIS-free, PWIS = paint-wetting impairment substances, max 2000 mm (78.7 in)	
			C	EN 10204 - 3.1 material (316L wetted) inspection certificate	
			D	EN10204-3.1 AD2000 material, wetted, apart from cast parts, inspection certificate	
			K	Special adjustment, density H20	
			L	Special adjustment, density H20, EN10204-3.1, material (wetted), inspection certificate	
			N	EN 10204 - 3.1 material, NACE MR0175 (316L wetted) Inspection certificate	
			P	100 bar (1450 psi) process pressure (FTL51)	
			R	100 bar (1450 psi) process pressure, EN 10204 - 3.1 material, NACE MR0175 (316L wetted) Inspection certificate (FTL51)	
			S	GL/ABS marine approval for FTL51: ≤ 1600 mm (63 in)	
			Y	Special version	
<b>580</b>					<b>Test, certificate:</b>
			KD	Helium leak test, internal procedure, inspection certificate	
			KE	Pressure test, internal procedure, inspection certificate	
			KG	PMI test (XRF), internal procedure, wetted metal parts, EN10204-3.1 inspection certificate	
			KP	Dye penetration test AD2000-HP5-3(PT), wetted/pressurized metal parts, inspection certificate	
			KQ	Dye penetration test ISO23277-1 (PT), wetted/pressurized metal parts, inspection certificate	
			KR	Dye penetration test ASME VIII-1 (PT), wetted/pressurized metal parts, inspection certificate	
			KS	Welding documentation, wetted/pressurized seams	
			KV	Declaration of Conformity ASME B31.3	
			K9	Special version, TSP-No. to be spec.	
					Complete product designation
			FTL5x -		



## Note!

The basic weight includes the compact sensor, thread adapter G 3/4, electronic insert, polyester housing

**Product structure for  
Liquiphant M FTL50H,  
FTL51H**

<b>Design</b>		<b>Basic weight</b>			
FTL50H	Compact				0.7 kg
FTL51H	With extension pipe				0.7 kg
10	<b>Approval:</b>				
	A	Non-hazardous area			
	B	ATEX II 3G Ex nC IIC T6, WHG, ATEX II 3D Ex tc IIIC T85°C, NEPSI II 3G Ex nC IIC T6			
	C	ATEX II 3G Ex nA IIC T6, WHG, ATEX II 3D Ex tc IIIC T85°C, NEPSI II 3G Ex nA IIC T6			
	D	Non-hazardous area, WHG			
	E	ATEX II 1/2G Ex de IIC T6, WHG			
	F	ATEX II 1/2GD Ex ia IIC T6, WHG/IECEx			
	G	ATEX II 1/2GD Ex ia IIC T6/IECEx Zone0/1			
	H	ATEX II 1G Ex ia IIC T6			
	I	ATEX II 1/2G Ex de IIC T6/IECEx Zone0/1			
	J	ATEX II 1G Ex ia IIC T6, WHG			
	K	ATEX II 1/2G Ex d IIC T6/IECEx Zone0/1			
	L	ATEX II 1/2G Ex d IIC T6, WHG			
	M	NEPSI Ex ia IIC T6			
	N	NEPSI Ex d IIC T6			
	P	FM IS Cl.I,II,III Div.1 Gr.A-G, Zone 0,1,2,20,21,22			
	Q	FM XP Cl.I,II,III Div.1 Gr.B-G, Gr.A-G if E5 housing selected, Zone 1,2			
	R	FM NI Cl.I Div.2 Gr.A-D, Zone 0,1,2,20,21,22			
	S	CSA C/US Cl I,II,III Div.1 Gr.A-G, Zone 0,1,2			
	T	CSA C/US XP Cl I,II,III Div.1 Gr.A-G, Zone 1,2			
	U	CSA C/US General Purpose			
	V	TIIS Ex ia IIC T3			
	W	TIIS Ex d IIB T3			
	7	TIIS Ex d IIC T3			
	8	TIIS Ex d IIC T6			
	1	INMETRO Ex ia IIC T6 Ga/Gb			
	2	INMETRO Ex d IIC T6 Ga/Gb			
	3	INMETRO Ex de IIC T6 Ga/Gb			
	Y	Special version, TSP-No. to be spec.			
20	<b>Process connection:</b>				<b>Additional weight</b>
	GQ2	G ¾	316L	(FTL50H)	Thread ISO 228
		Installation > accessories: weld-in adapter			
	GW2*	G 1	316L		Thread ISO 228
		Installation > accessories: weld-in adapter			0.2 kg
	BA2	DN32 PN6 A	316L		Flange EN 1092-1 (DIN 2527 B)
	BB2	DN32 PN25/40 A	316L		Flange EN 1092-1 (DIN 2527 B)
	BC2	DN40 PN6 A	316L		Flange EN 1092-1 (DIN 2527 B)
	BD2	DN40 PN25/40 A	316L		Flange EN 1092-1 (DIN 2527 B)
	BE2	DN50 PN6 A	316L		Flange EN 1092-1 (DIN 2527 B)
	BG2	DN50 PN25/40 A	316L		Flange EN 1092-1 (DIN 2527 B)
	BH2	DN65 PN6 A	316L		Flange EN 1092-1 (DIN 2527 B)
	BK2	DN65 PN25/40 A	316L		Flange EN 1092-1 (DIN 2527 B)
	BM2	DN80 PN10/16 A	316L		Flange EN 1092-1 (DIN 2527 B)
	BN2	DN80 PN25/40 A	316L		Flange EN 1092-1 (DIN 2527 B)
	BQ2	DN100 PN10/16 A	316L		Flange EN 1092-1 (DIN 2527 B)
	BR2	DN100 PN25/40 A	316L		Flange EN 1092-1 (DIN 2527 B)
	B82	DN25 PN25/40 A	316L		Flange EN 1092-1 (DIN 2527 B)
	CG2	DN50 PN25/40 B1	316L		Flange EN 1092-1 (DIN 2527 C)
	CN2	DN80 PN25/40 B1	316L		Flange EN 1092-1 (DIN 2527 C)
	CO2	DN100 PN10/16 B1	316L		Flange EN 1092-1 (DIN 2527 C)

20	Process connection:					Additional weight
	EE2	1" flush-mounted (52001047)		316L		0.3 kg
	HE2	DN50	Pipe DIN 11850 slotted nut	316L	DIN 11864-1 A	0.3 kg
	AA2*	1 1/4"	150 lbs	RF 316/316L	Flange ASME B16.5	1.2 kg
	AC2*	1 1/2"	150 lbs	RF 316/316L	Flange ASME B16.5	1.5 kg
	AE2*	2"	150 lbs	RF 316/316L	Flange ASME B16.5	2.4 kg
	AF2*	2 1/2"	300 lbs	RF 316/316L	Flange ASME B16.5	3.2 kg
	AJ2*	3"	300 lbs	RF 316/316L (FTL51H)	Flange ASME B16.5	4.8 kg
	AL2*	4"	150 lbs	RF 316/316L	Flange ASME B16.5	4.9 kg
	AM2	3"	300 lbs	RF 316/316L (FTL51H)	Flange ASME B16.5	6.8 kg
	AP2*	4"	150 lbs	RF 316/316L	Flange ASME B16.5	7.0 kg
	AQ2*	4"	300 lbs	RF 316/316L (FTL51H)	Flange ASME B16.5	11.5 kg
	AB2*	1"	150 lbs	RF 316/316L	Flange ASME B16.5	1.0 kg
	KA2	10 K 25		RF 316L	Flange JIS B2220	
	KC2	10 K 40		RF 316L	Flange JIS B2220	
	KE2	10 K 50		RF 316L	Flange JIS B2220	1.7 kg
	KL2	10 K 80		RF 316L	Flange JIS B2220	
	KP2	10 K 100		RF 316L	Flange JIS B2220	
	MA2	DN32 PN25		316L	DIN 11851	0.1 kg
	MC2	DN40 PN25		316L	DIN 11851	0.2 kg
	ME2	DN50 PN25		316L	DIN 11851	0.3 kg
	PE2	DRD 65 mm		316L		0.3 kg
	TC2*	DN25-38 (1 to 1 1/2")		316L	ISO 2852 Tri-Clamp	
	TE2*	DN40-51 (2")		316L	ISO 2852 Tri-Clamp	0.1 kg
	TT2	Ingold fitting 25x46mm		316L		
	UE2	SMS 2" PN25		316L		0.2 kg
	WE2*	DN65-162 PN10		316L	Varivent N pipe	0.5 kg
	YY9	Special version				
		* CRN approval				

30	Probe length; Type:				
	FTL50H				
	AC	Compact;	Ra <1.5 µm/59 µin		
	AD	Compact;	Ra <0.3 µm/12 µin		
	IC	Compact;	Ra <1.5 µm/59 µin + temperature spacer		0.6 kg
	ID	Compact;	Ra <0.3 µm/12 µin / A3 + temperature spacer		0.6 kg
	QC	Compact;	Ra <1.5 µm/59 µin + pressure-tight feedthrough		0.7 kg
	QD	Compact;	Ra <0.3 µm/12 µin / A3 + pressure-tight feedthrough		0.7 kg
	FTL51H				
	BC	..... mm;	Ra <1.5 µm/59 µin		0.9 kg/m
	BD	..... mm;	Ra <0.3 µm/12 µin / A3		0.9 kg/m
	BF	..... mm;	Ra <0.76 µm/30 µin		0.9 kg/m
	CC	..... inch;	Ra <1.5 µm/59 µin		2.3 kg/100 in
	CD	..... inch;	Ra <0.3 µm/12 µin / A3		2.3 kg/100 in
	DC	Length: type II*;	Ra <1.5 µm/59 µin		0.1 kg
	DD	Length: type II*;	Ra <0.3 µm/12 µin / A3		0.1 kg
	JC	..... mm;	Ra <1.5 µm/59 µin + Temperature spacer		0.9 kg/m +0.6 kg
	JD	..... mm;	Ra <0.3 µm/12 µin + Temperature spacer		0.9 kg/m +0.6 kg
	KC	..... inch;	Ra <1.5 µm/59 µin + Temperature spacer		2.3 kg/100 in +0.6 kg
	KD	..... inch;	Ra <0.3 µm/12 µin + Temperature spacer		2.3 kg/100 in +0.6 kg
	LC	Length: type II*;	Ra <1.5 µm/59 µin + Temperature spacer		0.1 kg +0.6 kg
	LD	Length: type II*;	Ra <0.3 µm/12 µin + Temperature spacer,		0.1 kg +0.6 kg
	RC	..... mm;	Ra <1.5 µm/59 µin + Pressure-tight feedthrough		0.9 kg/m +0.7 kg
	RD	..... mm;	Ra <0.3 µm/12 µin + Pressure-tight feedthrough		0.9 kg/m +0.7 kg
	SC	..... inch;	Ra <1.5 µm/59 µin + Pressure-tight feedthrough		2.3 kg/100 in +0.7 kg
	SD	..... inch;	Ra <0.3 µm/12 µin + Pressure-tight feedthrough		2.3 kg/100 in +0.7 kg
	TC	Length: type II*;	Ra <1.5 µm/59 µin + Pressure-tight feed through,		0.1 kg +0.7 kg

<b>30</b>		<b>Probe length; Type:</b>		
		TD	Length: type II*; Ra <0.3 µm/12 µin + Pressure-tight feed through,	0.1 kg +0.7 kg
		YY	Special version *) If replacing devices: when vertically mounting a Liquiphant <b>M</b> FTL51H with length II the switch point is at the same height as for a Liquiphant <b>II</b> FTL360, FTL365, FDL30, FDL35. See also Seite 36 "L II" depends on process connection.	
<b>40</b>				
			<b>Electronics; output:</b>	
		A	FEL50A PROFIBUS PA	
		D	FEL50D Density/concentration without WHG approval (Germany)	
		1	FEL51* 2-wire, AC 19 to 253 V	
		2	FEL52* 3-wire PNP, DC 10 to 55 V	
		4	FEL54 Relay DPDT, AC 19 to 253 V, DC 19 to 55 V	
		5	FEL55 8/16 mA, DC 11 to 36 V	
		6	FEL56 NAMUR (L-H signal)	
		7	FEL57 2-wire PFM	
		8	FEL58* NAMUR + test keys (H-L signal)	
		9	Special version *) Also available in compact housing	
<b>50</b>		<b>Housing; cable entry:</b>		
		C3	Compact 316L IP66/68; Cable 5 m	
		D3	Compact 316L IP65; Plug Pg11 ISO4400	
		E3	Compact 316L NEMA4X; Plug NPT ½ ISO4400 Hygiene	
		N3	Compact 316L IP66/68; M12 connector Hygiene	
		E4	F16 Polyester NEMA4X; Thread NPT ½	
		E5	F13 Alu NEMA4X/6P; Thread NPT ¾ 0.5 kg	
		F17 Alu	NEMA4X	
		E6	F15 316L NEMA4X; Thread NPT ½ 0.1 kg	
		Hygiene		
		E7	T13 Alu NEMA4X/6P; Thread NPT ¾ 0.9 kg	
		Separate connection compartment		
		F4	F16 Polyester IP66/67; Thread G ½	
		F5	F13 Alu IP66/68; Thread G ½ 0.5 kg	
		F17 Alu	IP66/67;	
		F6	F15 316L hygiene IP66/67; Thread G ½ 0.1 kg	
		F7	T13 Alu coated IP66/68; thread G ½ 0.9 kg	
		Separate connection compartment		
		Ex d > M20 thread		
		G4	F16 Polyester IP66/67; M20 threaded joint	
		G5	F13 Alu IP66/68; M20 threaded joint 0.5 kg	
		F17 Alu	IP66/67;	
		G6	Ex d > thread M20 F15 316L IP66/67; M20 threaded joint 0.1 kg	
		Hygiene		
		G7	T13 Alu coated M20 threaded joint 0.9 kg IP66/68;	
		Separate connection compartment	Ex d > thread M20	
		N4	F16 Polyester IP66/67; M12 connector	
		N5	F13 Alu IP66/68; M12 connector	
		F17 Alu	IP66/67;	
		N6	F15 316L hygiene IP66/67; M12 connector	
		Y9	Special version	
<b>60</b>		<b>Additional option</b>		
		A	Basic version	
		B	CoC-ASME BPE, EN10204-3.1 material (316L wetted) Inspection certificate	
		C	EN 10204 - 3.1 material (316L wetted), Inspection certificate	
		D	EN10204-3.1 AD2000 material, wetted, apart from cast parts, inspection certificate	
		K	Special adjustment, density H2O	
		L	Special adjustment, density H2O, EN10204-3.1 (316L wetted) inspection certificate	
		S	GL/ABS marine approval for FTL51H: ≤ 1600 mm (63 in)	
		Y	Special version	
FTL5#H -		Complete product designation		



Note!

Basic weight = compact sensor, thread adapter G ¾, electronic insert, stainless steel housing

## Accessories









## Note!

- All dimensions in mm (in)!
- For additional information on weld-in adapters, refer to TI00426F.
- The tolerance of the thread start between the weld-in adapter and sensor is  $\pm 15^\circ$ .

## Weld-in adapter

## Overview

							
		a0008246	a0008251	a0008256	a0011924	a0008248	a0008253
Material roughness $\mu\text{m}$ ( $\mu\text{in}$ )		316L 1.5 (59.1)	316L 0.8 (31.5)	316L 0.8 (31.5)	316L 0.8 (31.5)	316L 0.8 (31.5)	316L 0.8 (31.5)
Without inspection certificate EN10204-3.1 material		71258357	71258355	52001052 <sup>3)</sup>	71258358	52001051 <sup>1), 3)</sup>	52001221 <sup>2), 3)</sup>
With inspection certificate EN10204-3.1 material		52028295 <sup>3)</sup>	52018765 <sup>3)</sup>	52011897 <sup>3)</sup>	71093129 <sup>1), 3)</sup>	52011896 <sup>1), 3)</sup>	52011898 <sup>2), 3)</sup>
Seal (replacement part: set of 5)		Silicone O-ring 52021717	Silicone O-ring 52021717	Silicone O-ring 52014473	Silicone O-ring 52014472	Silicone O-ring 52014472	Silicone profile gasket 52014424)
Weld-in dummy		–	–	71168889	71166879	71166879	71181945
Liquiphant M	Feature	Version					
FTL50	020			GQ2			
FTL5x					GW2	GW2	GW2
FTL50H				GQ2			
FTL5xH					GW2	GW2	GW2

1) This weld-in adapter replaces the weld-in adapter with the order number 917969-1000.

2) This weld-in adapter replaces the weld-in adapter with the order number 215159-0000.

3) A seal is included in the delivery.

		
	a0008252	a0008254
<b>RD52</b>	<b>DRD DN50 65 (2.56) (welding flange)</b>	
Material roughness $\mu\text{m}$ ( $\mu\text{in}$ ), process side	316L 0.8 (31.5)	316L/304 0.8 (31.5)
Without inspection certificate EN10204-3.1 material	52001047 <sup>1), 2)</sup>	52002041 <sup>2)</sup> / 916743-0000
With inspection certificate EN10204-3.1 material	52006909 <sup>1), 2)</sup>	52011899 <sup>2)</sup> / -
Seal (replacement part: set of 5)	Silicone profile gasket 52014424	PTFE flat seal 52024228
Weld-in dummy	M40167	-
<b>Device</b>	<b>Feature</b>	<b>Version</b>
<b>Liquiphant M</b>		
FTL5xH	020	EE2
		PE2

1) This weld-in adapter replaces the weld-in adapter with the order number 942329-0001.

2) A seal is included in the delivery.




#### Note!

All the weld-in adapters available are described in document TI00426F.

[www.endress.com](http://www.endress.com) --> Download -->Advanced--> Documentation code --> TI00426F.


#### Weather protection cover

For F16 housing

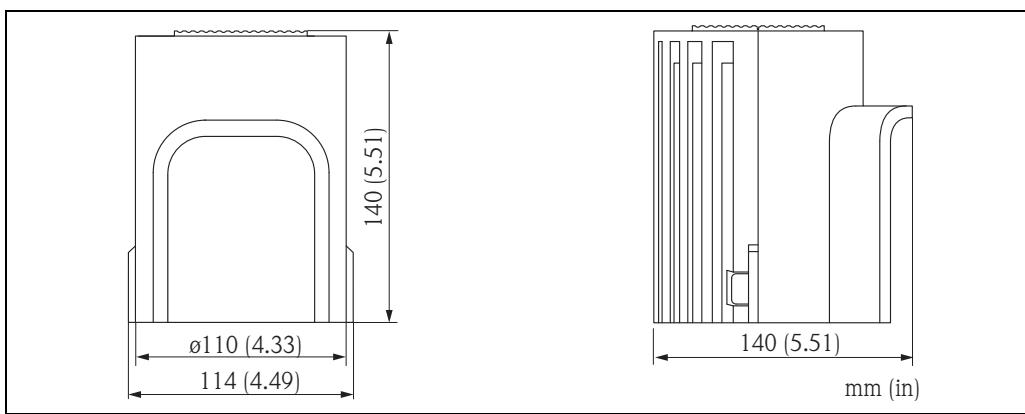

Material	Order No.	Weight
PBT, gray	71127760	240 g (8.46 oz)


For F13, F17 and F27 housing

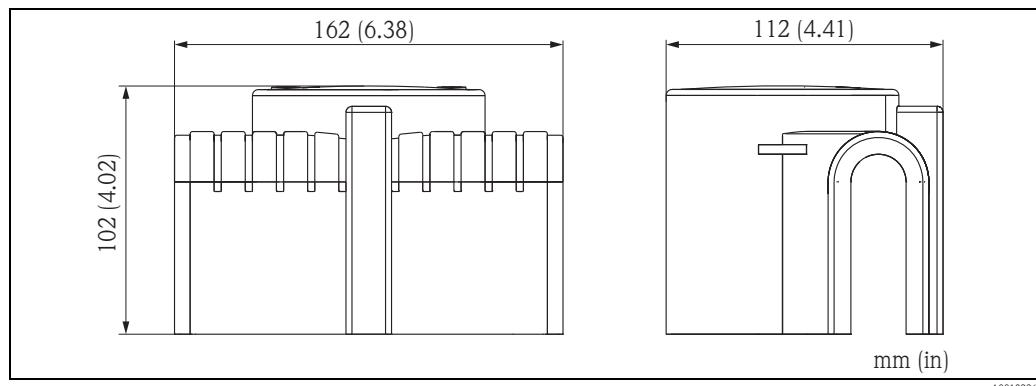


Material	Order No.	Weight
PA6, gray	71040497	300 g (10.58 oz)

**Lap joint flange**

Order number: 918158-0000  
 With G 1 thread for mounting  
 a Liquiphant FTL50, FTL51  
 with process connection GR2  
 Pressure up to 40 bar (580 psi)  
 Material: corrosion-resistant steel  
 1.4301 (AISI 304)  
 Weight: 0.54 kg (1.19 lbs)

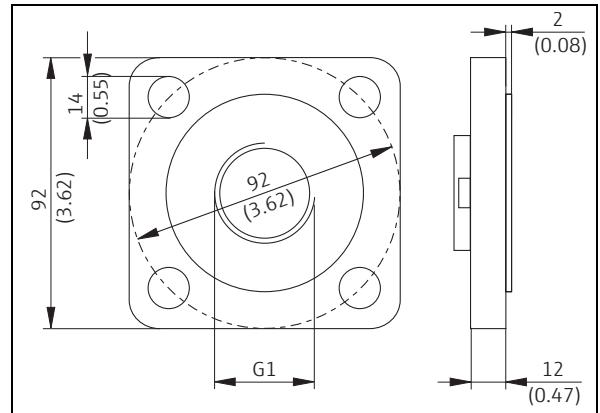**Lap joint flanges**

With G 1 thread for mounting  
 a Liquiphant FTL50, FTL51  
 with process connection GR2  
 Material: corrosion-resistant steel  
 1.4571 (AISI 316Ti)  
 - Order number: 918143-0000  
 Flange DN50 PN40, EN 1092-1  
 Weight: 3.11 kg (6.86 lbs)  
 - Order number: 918144-0000  
 Flange ASME 2", 150 psi, RF  
 Weight: 2.38 kg (5.25 lbs)

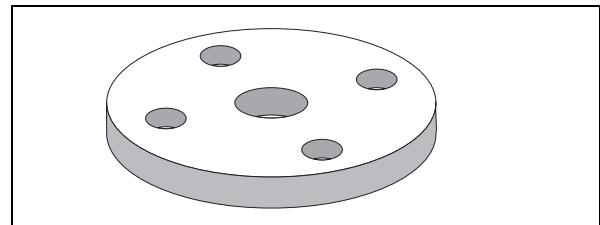


**Sliding sleeves for unpressurized operation**

Switch point infinitely variable for Liquiphant MFTL51

Material: corrosion-resistant steel 1.4435 (AISI 316 L)

Weight for G 1, NPT 1: 0.21 kg (0.46 lbs)  
Weight for G 1½, NPT 1½: 0.54 kg (1.19 lbs)

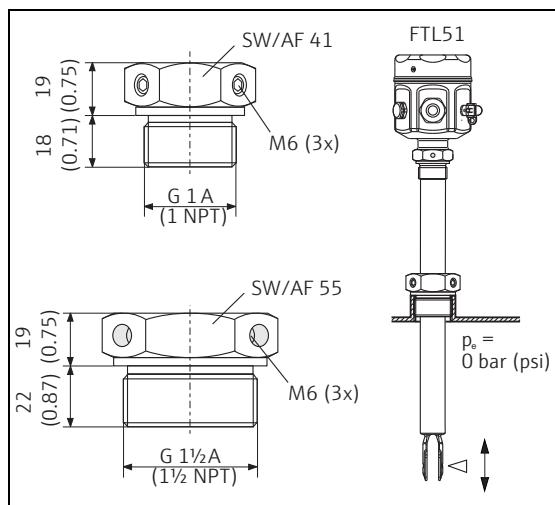

L00-FTL5xxxx-06-05-xx-xx-109

Thread	Standard	Material	Order number	Approval
G 1	DIN ISO 228/I	1.4435 (AISI 316 L)	52003978	
G 1	DIN ISO 228/I	1.4435 (AISI 316 L)	52011888	With inspection certificate EN 10204 - 3.1 material
NPT1	ASME B 1.20.1	1.4435 (AISI 316 L)	52003979	
NPT1	ASME B 1.20.1	1.4435 (AISI 316 L)	52011889	With inspection certificate EN 10204 - 3.1 material
G 1½	DIN ISO 228/I	1.4435 (AISI 316 L)	52003980	
G 1½	DIN ISO 228/I	1.4435 (AISI 316 L)	52011890	With inspection certificate EN 10204 - 3.1 material
NPT1½	ASME B 1.20.1	1.4435 (AISI 316 L)	52003981	
NPT1½	ASME B 1.20.1	1.4435 (AISI 316 L)	52011891	With inspection certificate EN 10204 - 3.1 material

**High pressure sliding sleeves**

For continuous adjustment of the switch point of a Liquiphant M FTL51.  
Also for use in hazardous areas. Additional information → 58ff. (ATEX, NEPSI).


Material: corrosion-resistant steel 1.4435 (AISI 316L) or AlloyC22

Weight for G 1, NPT 1: 1.13 kg (2.49 lbs)  
Weight for G 1½, NPT 1½: 1.32 kg (2.91 lbs)


Seal package made of graphite.

For G1, G 1½:

Seal is included in the delivery.

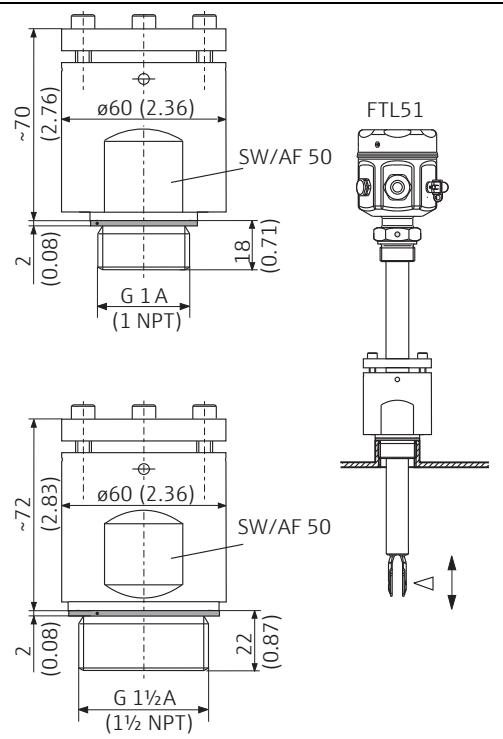

Thread	Standard	Material	Order number	Approval
G 1	DIN ISO 228/1	1.4435 (AISI 316 L)	52003663	
G 1	DIN ISO 228/1	1.4435 (AISI 316 L)	52011880	With inspection certificate EN 10204 - 3.1 material
G 1	DIN ISO 228/1	AlloyC22	71118691	With inspection certificate EN 10204 - 3.1 material
NPT1	ASME B 1.20.1	1.4435 (AISI 316 L)	52003667	
NPT1	ASME B 1.20.1	1.4435 (AISI 316 L)	52011881	With inspection certificate EN 10204 - 3.1 material
NPT1	ASME B 1.20.1	AlloyC22	71118694	With inspection certificate EN 10204 - 3.1 material
G 1½	DIN ISO 228/1	1.4435 (AISI 316 L)	52003665	
G 1½	DIN ISO 228/1	1.4435 (AISI 316 L)	52011882	With inspection certificate EN 10204 - 3.1 material
G 1½	DIN ISO 228/1	AlloyC22	71118693	With inspection certificate EN 10204 - 3.1 material
NPT1½	ASME B 1.20.1	1.4435 (AISI 316 L)	52003669	
NPT1½	ASME B 1.20.1	1.4435 (AISI 316 L)	52011883	With inspection certificate EN 10204 - 3.1 material
NPT1½	ASME B 1.20.1	AlloyC22	71118695	With inspection certificate EN 10204 - 3.1 material

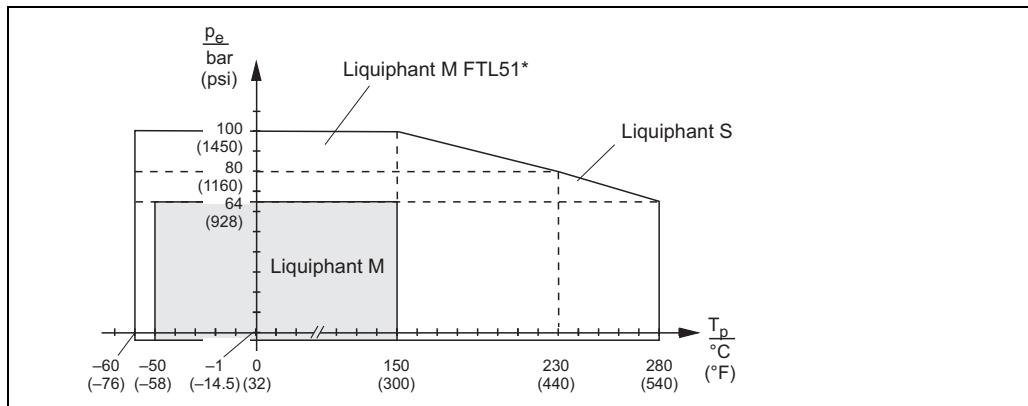

L00-FTL5xxxx-05-05-xx-xx-002


\* FTL51 with high-pressure sliding sleeve (100 bar (1450 psi)). See "Additional option" Seite 44 ff. option "P" or "R".

**Cover with sight glass**

Order number: 943461-0001  
for polyester housing F16

Material: PA 12

Weight: 0.04 kg (0.09 lbs)

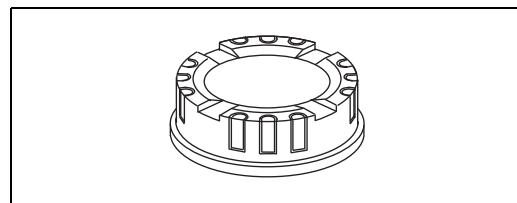

L00-FTL5xxxx-03-05-xx-xx-016

**Cover with sight glass**

For stainless steel housing F15

Material: AISI 316L

Weight: 0.16 kg (0.35 lbs)


- Order number: 52027002

With glass sight glass

- Order number: 52028207

With PC sight glass

(Not for CSA, General Purpose)

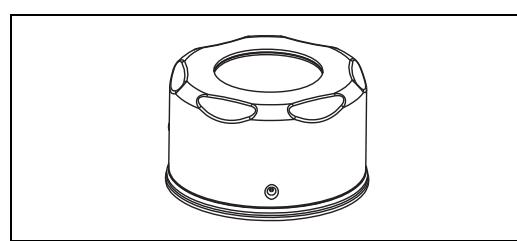

L00-FTL5xxxx-03-05-xx-xx-017

**Circular connector**

Order number: 52010285

4x0.34 M12 socket

Cable: PVC (gray) 5 m (16 ft)

Body: PUR (blue)

Thread adapter nut: Cu Sn/Ni


Degree of protection: IP67

Temperature range with fixed cable:

-25 to +70 °C (-13 to +158 °F)

Temperature range with flexible cable:

-5 to +70 °C (23 to +158 °F)

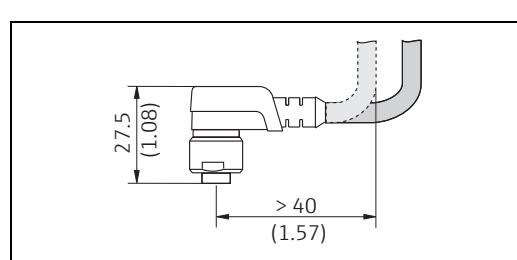

L00-FTL5xxxx-06-05-xx-xx-111

Order number: 52024216

4x0.34 M12 socket


Cable: PVC (orange) 5 m (16 ft)

Body: PVC (orange)

Thread adapter nut: 316L


Degree of protection: IP69 (fully locked)

Temperature range: -25 to +70 °C (-13 to +158 °F)

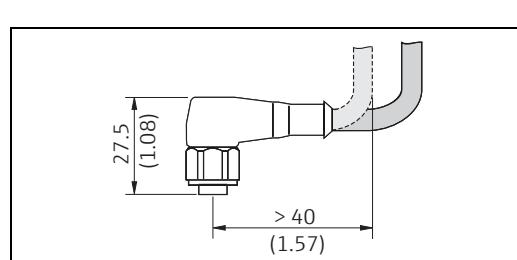

L00-FTL5xxxx-06-05-xx-xx-112

Order number: 52018763  
4x0.34 M12 socket with integrated LEDs  
Cable: PVC (orange) 5 m (16 ft)  
Body: PVC (transparent)  
Thread adapter nut: 316L  
Degree of protection: IP69/IP69 (fully locked)  
Temperature range: -25 to +70 °C (-13 to +158 °F)

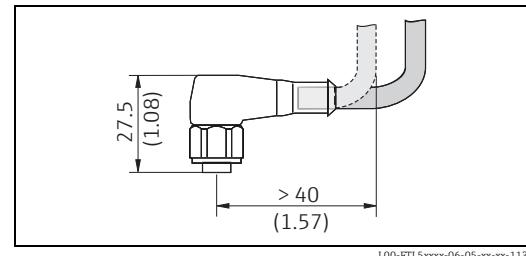

## Documentation



Note!

You can find supplementary documentation on the product pages at [www.endress.com](http://www.endress.com)

### Operating Instructions

Electronic insert FEL50A for Liquiphant M, PROFIBUS PA  
BA00141F

Liquiphant M Density, density computer FML621  
BA00335F

Liquiphant M FTL50, FTL51  
KA00143F

Liquiphant M FTL50(H), FTL51(H)  
KA00144F

Liquiphant M FTL51C  
KA00162F

Liquiphant M FTL50-##### # 7 #, FTL51-##### # 7 #  
KA00163F

Liquiphant M FTL50H-##### 7 #, FTL51H-##### 7 #  
KA00164F

Liquiphant M FTL51C-##### 7 ##  
KA00165F

Liquiphant M FTL5#-# #### ## # #3 #, FTL5#H-# #### ## # #3 #  
KA00220F

Electronic insert FEL50D for Liquiphant M Density FTL50, FTL51  
KA00284F

Electronic insert FEL50D for Liquiphant M Density FTL50H, FTL51H  
KA00285F

Electronic insert: FEL50D for Liquiphant M Density FTL51C  
KA00286F

Liquiphant M sliding sleeve for FTL51, G 1, NPT 1  
KA00151F

Liquiphant M sliding sleeve for FTL51, G 1½, NPT 1½  
KA00152F

Liquiphant M high-pressure sliding sleeve for FTL51, G 1, NPT 1  
KA00153F

Liquiphant M high-pressure sliding sleeve for FTL51, G 1½, NPT 1½  
KA00154F

<b>Technical Information</b>	<p>General instructions for electromagnetic compatibility (Test procedure, installation recommendation) TI00241F</p> <p>Liquiphant M FTL51C, wetted parts with highly corrosion-resistant coating ECTFE, PFA or enamel coating TI00347F</p> <p>Isolating amplifier FTL325P, 1- or 3-channel switching units for top-hat rail mounting for Liquiphant M with electronic insert FEL57 TI00350F</p> <p>Isolating amplifier FTL325N, 1- or 3-channel switching units for top-hat rail mounting for Liquiphant M with electronic insert FEL56, FEL58 TI00353F</p> <p>Liquiphant S FTL70/71, for medium temperatures up to 280 °C (536 °F) TI00354F</p> <p>Isolating amplifier FTL375P, 1 to 3-channel switching units for top-hat rail mounting for Liquiphant M with electronic insert FEL57 TI00360F</p> <p>Liquiphant M Density, density computer FML621 TI00420F</p> <p>Weld-in adapter, TI00426F</p>
<b>Functional safety (SIL)</b>	<p>Liquiphant M with electronic insert FEL51 (MAX) SD00164F</p> <p>Liquiphant M with electronic insert FEL51 (MIN) SD00185F</p> <p>Liquiphant M with electronic insert FEL52 (MAX) SD00163F</p> <p>Liquiphant M with electronic insert FEL52 (MIN) SD00186F</p> <p>Liquiphant M with electronic insert FEL54 (MAX) SD00162F</p> <p>Liquiphant M with electronic insert FEL54 (MIN) SD00187F</p> <p>Liquiphant M with electronic insert FEL55 (MAX) SD00167F</p> <p>Liquiphant M with electronic insert FEL55 (MIN) SD00279F</p> <p>Liquiphant M with electronic insert FEL57 + Nivotester FTL325P SD01508F (MAX + MIN)</p> <p>Liquiphant M with electronic insert FEL56 + Nivotester FTL325N SD01521F (MAX + MIN)</p> <p>Liquiphant M with electronic insert FEL58 + Nivotester FTL325N SD01522F (MAX + MIN)</p>
<b>Safety Instructions (ATEX)</b>	<p><b>CE</b> II 1/2 G, Ex d IIC/B (KEMA 99 ATEX 1157) XA00031F/00/a3</p> <p><b>CE</b> II 1/2 G, Ex ia/ib IIC/B (KEMA 99 ATEX 0523) XA00063F/00/a3</p> <p><b>CE</b> II 1 G, Ex ia IIC/B (KEMA 99 ATEX 5172 X) XA00064F/00/a3</p> <p><b>CE</b> II 1/2 G, Ex de IIC/B (KEMA 00 ATEX 2035)</p>

XA00108F/00/a3  
CE ⊗ II 3 G, Ex nA/nC II (EG 01 007-a)  
XA00182F/00/a3

---

**Safety Instructions (NEPSI)** Ex d IIC/IIB T3-T6 , Ex d IIC T2-T6  
(NEPSI GYJ06424)  
XA00401F/00/B2

Ex ia IIC T2-T6, Ex ia IIB T3-T6  
(NEPSI GYJ05556, NEPSI GYJ06464),  
XC00009F/00/b2

Ex nA II T3-T6, Ex nC/nL IIC T3-T6  
(NEPSI GYJ04360, NEPSI GYJ071414)  
XC00010F/00/b2

---

**Control Drawings** Liquiphant M (IS and NI) Current output PFM, NAMUR Entity installation  
Class I, Div. 1, 2, Groups A, B, C, D  
Class I, Zone 0  
Class II, Div. 1, 2, Groups E, F, G  
Class III  
ZD00041F

Liquiphant M, Liquiphant S (cCSAus / IS)  
Class I, Div. 1, Groups A, B, C, D Ex ia IIC T6  
Class II, Div. 1, Groups E, F, G  
Class III  
ZD00042F

Liquiphant M (NI), FTL50(H), FTL51(H), FTL51C, FTL70, FTL71  
Class I, Div. 2, Groups A, B, C, D  
Class II, Div. 2, Groups F, G  
Class III  
ZD00043F

Liquiphant M, Liquiphant S (cCSAus / XP)  
Class I, Groups A, B, C, D  
Class II, Groups E, F, G  
Class III  
ZD00240F

Liquiphant M (IS and NI) PROFIBUS PA, FOUNDATION Fieldbus Class I, Zone 0, IIC  
Class I, Division 1, 2, Groups A, B, C, D  
Class II, Division 1, 2, Groups E, F, G  
Class III  
ZD00244F

---

**System information** Liquiphant M  
SI00040F



71310301

[www.addresses.endress.com](http://www.addresses.endress.com)

---